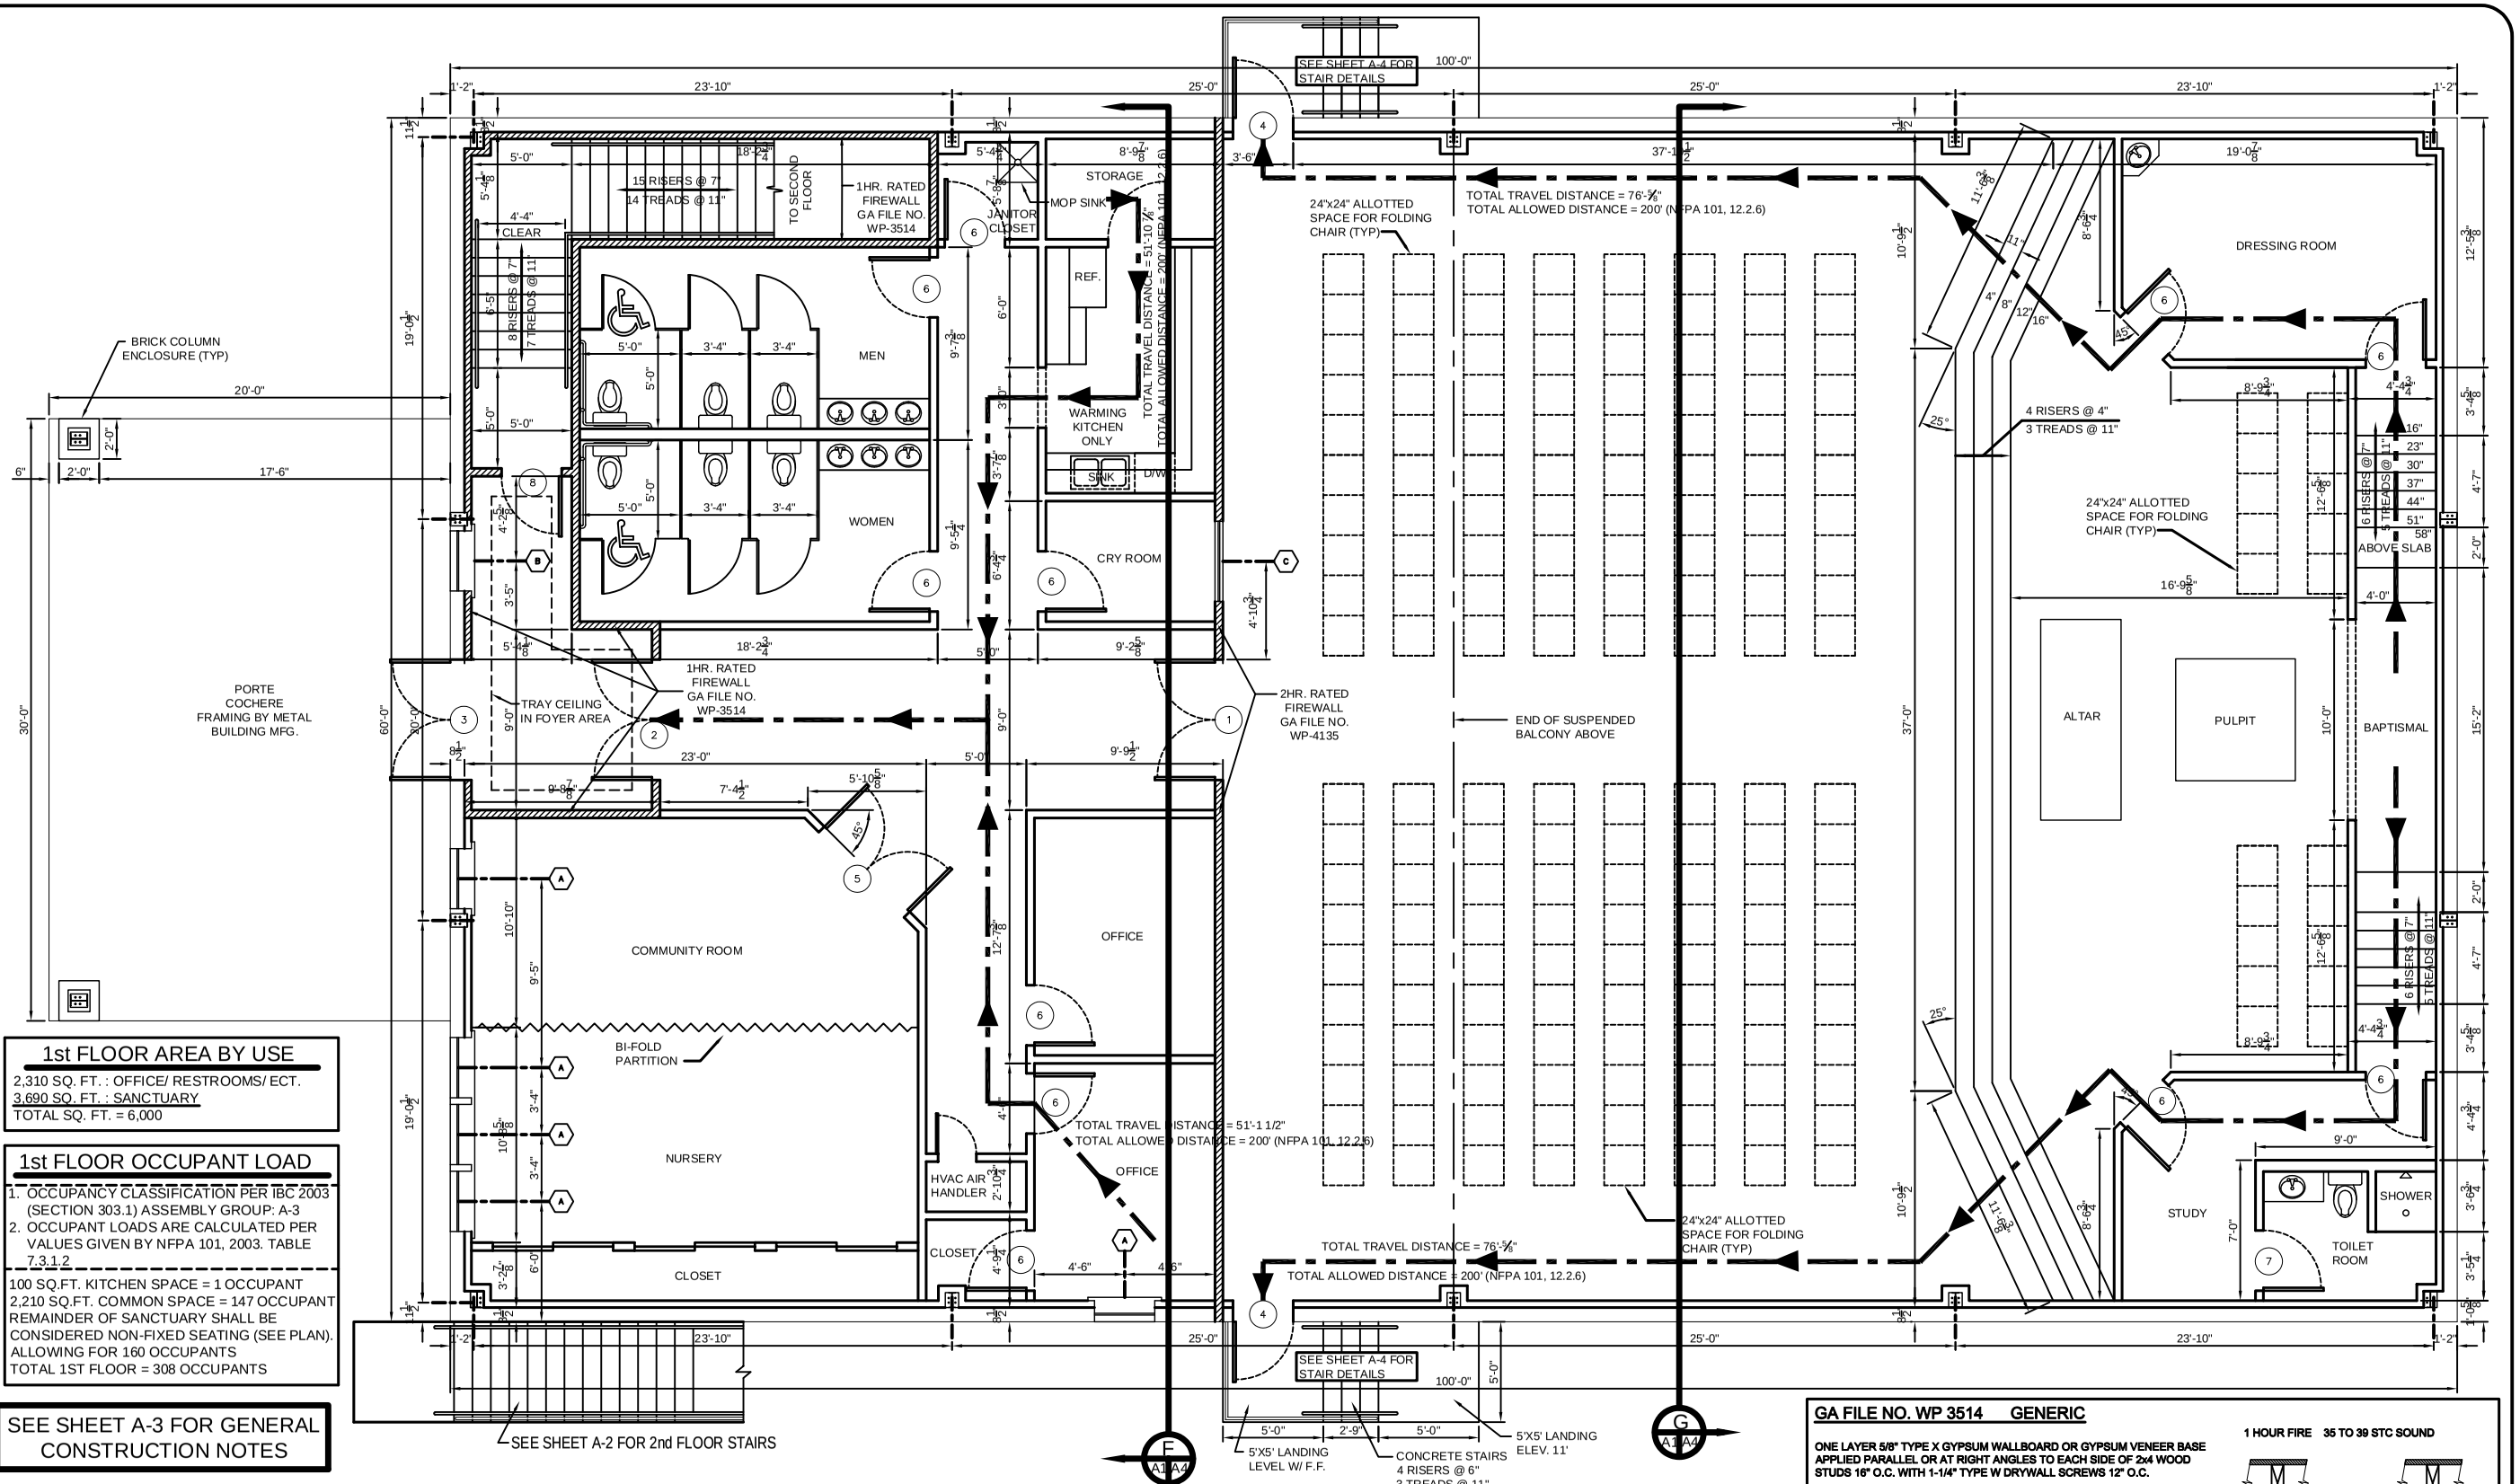

1st FLOOR AREA BY USE

2,310 SQ. FT. : OFFICE/ RESTROOMS/ ECT.
3,690 SQ. FT. : SANCTUARY
TOTAL SQ. FT. = 6,000

1st FLOOR OCCUPANT LOAD

1. OCCUPANCY CLASSIFICATION PER IBC 2003 (SECTION 303.1) ASSEMBLY GROUP: A-3
2. OCCUPANT LOADS ARE CALCULATED PER VALUES GIVEN BY NFPA 101, 2003. TABLE 7.3.1.2

100 SQ.FT. KITCHEN SPACE = 1 OCCUPANT
2,210 SQ.FT. COMMON SPACE = 147 OCCUPANT
REMAINDER OF SANCTUARY SHALL BE CONSIDERED NON-FIXED SEATING (SEE PLAN). ALLOWING FOR 160 OCCUPANTS
TOTAL 1ST FLOOR = 308 OCCUPANTS

SEE SHEET A-3 FOR GENERAL CONSTRUCTION NOTES

FIRST FLOOR FINISH SCHEDULE

NAME	FLOOR	BASE	WALLS	CEILING	REMARKS
	CARPET, CONCRETE, VCT, WOOD	CERAMIC TILE, RUBBER WALL BASE, WOOD BASE, NONE	CERAMIC TILE, GYPSUM BOARD	2'x2' LAY-IN PANELS, GYPSUM BOARD	
OFFICES	●	●	●	●	CEILING HEIGHT 10'
OFFICE CLOSET	●	●	●	●	CEILING HEIGHT 10'
TOILET ROOMS	●	●	●	●	CEILING HEIGHT 10'
COMMUNITY ROOM	●	●	●	●	CEILING HEIGHT 10'
WARMING KITCHEN	●	●	●	●	CEILING HEIGHT 10'
KITCHEN STORAGE ROOM	●	●	●	●	CEILING HEIGHT 10'
JANITORS CLOSET	●	●	●	●	CEILING HEIGHT 10'
HALLWAYS	●	●	●	●	CEILING HEIGHT 10'
STAIRWELL	●	●	●	●	CEILING HEIGHT 10'
SANCTUARY	●	●	●	●	CEILING HEIGHT 10'

OWNER TO SELECT STYLE, COLOR, AND BRAND
CROWN MOLDING TO BE INSTALLED IN LOCATIONS SELECTED BY OWNER

FIRST FLOOR DOOR AND HARDWARE SCHEDULE (x)

#	SIZE	TYPE: WOOD	TYPE: METAL	TYPE: SLIDING GLASS	TYPE: STOREFRONT	FRAME: STEEL	FRAME: ALUMINUM	HINGE: WOOD	HINGE: DOUBLE ACTING	LOCK: BURGLER PRF	LOCK: PASSAGE	LOCK: PRIVACY	LOCK: DEADBOLT	LOCK: CYLINDER LK	ACCESSORIES: PUSH PULL	ACCESSORIES: PANIC BAR	ACCESSORIES: THRESHOLD	ACCESSORIES: WEATH STRIP	ACCESSORIES: ALARM	ACCESSORIES: PEEP HOLE	ACCESSORIES: CLOSER	REMARKS
1	(2) 3'0x6'8x1-3/4"	●				●		●													●	20 MIN. FIRE RATED, NOTE 2
2	(2) 3'0x6'8x1-3/4"	●				●		●													●	20 MIN. FIRE RATED, NOTE 2
3	(2) 3'0x6'8x1-3/4"	●				●		●													●	NOTE #2, WOOD FINISH
4	3'0x6'8x1-3/4"	●				●		●													●	NOTE #2
5	(2) 3'0x6'8x1-3/4"		●				●		●		●					●						
6	3'0x6'8x1-3/4"		●				●		●		●					●						
7	3'0x6'8x1-3/4"		●				●		●			●				●						
8	3'0x6'8x1-3/4"		●				●		●		●					●						60 MIN. FIRE RATED

1. DOORS IN PATH OF EGRESS SHALL BE READILY OPENABLE FROM THE EGRESS SIDE WITHOUT THE USE OF A KEY OR SPECIAL KNOWLEDGE OR EFFORT. (IBC 2003 - 1008.1.8)
2. A READILY VISIBLE SIGN SHALL BE POSTED ON THE EGRESS SIDE ON OR ADJACENT TO THE DOOR STATING: THIS DOOR SHALL REMAIN UNLOCKED WHEN BUILDING IS OCCUPIED. THE SIGN SHALL BE IN LETTERS 1" (25MM) HIGH ON A CONTRASTING BACKGROUND. (IBC 2003 - 1008.1.8.3.: 2.2.)
3. ALL HEADERS SHALL HAVE SOLID BLOCKING.

FRAMING NOTE: ALL LOAD BEARING STUD WALLS SHALL BE 16GA. 2x6 STEEL STUDS @16" O.C.

1st FLOOR PLAN
SCALE: 1/4"=1'-0"

FIRST FLOOR WINDOW SCHEDULE (x)

#	SIZE	TYPE: FIXED	TYPE: STOREFRONT	TYPE: SLIDE	FRAME: STEEL	FRAME: ALUMINUM	GLASS: WOOD	GLASS: TINTED	GLASS: NONE	GLASS: INSULATED	LITES: 1 LITE	LITES: 2 LITE	ACCESS: SCREEN	ACCESS: SHUTTER	ACCESS: ALARM	ACCESS: NONE	REMARKS
A	3'-0" x 6'-8"	●				●			●	●		●				●	45 MIN. FIRE RATED
B	3'-0" x 6'-0"	●				●			●	●		●				●	45 MIN. FIRE RATED
C	3'-6" x 5'-0"	●				●			●	●		●				●	60 MIN. FIRE RATED

GA FILE NO. WP 3514 GENERIC

ONE LAYER 5/8" TYPE X GYPSUM WALLBOARD OR GYPSUM VENEER BASE APPLIED PARALLEL OR AT RIGHT ANGLES TO EACH SIDE OF 2x4 WOOD STUDS 16" O.C. WITH 1-1/4" TYPE W DRYWALL SCREWS 12" O.C.

JOINTS STAGGERED 16" ON OPPOSITE SIDES. (LOAD BEARING)

1 HOUR FIRE 35 TO 39 STC SOUND

THICKNESS: 4-3/4"
APPROX. WEIGHT: 7 PSF
FIRE TEST: SWRI 01-4511-619, 8-19-02
SOUND TEST: SEE WP 3520 (G&H NG-246FT, 7-2-65)

GA FILE NO. WP 4136 GENERIC

BASE LAYER 5/8" TYPE X GYPSUM WALLBOARD OR VENEER BASE APPLIED PARALLEL OR AT RIGHT ANGLES TO EACH SIDE OF 2 X 4 WOOD STUDS 16" O.C. WITH 1 1/4" TYPE W DRYWALL SCREWS 12" O.C. FACE LAYER 5/8" TYPE X GYPSUM WALLBOARD OR VENEER BASE APPLIED PARALLEL OR AT RIGHT ANGLES TO EACH SIDE WITH 1 7/8" TYPE W DRYWALL SCREWS 12" O.C. AND OFFEST 6" FROM SCREWS IN BASE LAYER.

JOINTS STAGGERED 16" EACH LAYER AND SIDE. (LOAD BEARING)

2 HOUR FIRE 40 TO 44 STC SOUND

THICKNESS: 6 1/8"
APPROX. WEIGHT: 12 PSF
FIRE TEST: SWRI 01-5620-614, 12-5-94
SOUND TEST: SEE WP 4135 (NGC 2383, 4-1-70)

EL-BETHEL PENTECOSTAL CHURCH

DAMMON ENGINEERING. INC.
1095 FLORIDA AVENUE 985-649-5832 SLIDELL, LA. 70458
DAMMONENGINEERING.COM

1st FLOOR PLAN

EUGENE WELLINGTON
ALLEN ROAD
SLIDELL, LOUISIANA

SCALE:AS NOTED
FILE:
JOB NO. 1819
DATE: 3-29-07
SHEET 10
A-1
OF 22