

**TABERNACLE BAPTIST CHURCH HVAC CALCULATIONS**

**SANCTUARY & REAR AREAS:**

Project Tabernacle Church Sanctuary & Rear Area HVAC Calculations  
Wed Nov 18 16:02:39 EST 2009

The Bluh Gain for 65,8206 SqFt of North and Stated Single Pane Glass = 1974.618  
The Bluh Gain for 65,8206 SqFt of South Single Pane Glass = 5265.648

The Bluh Gain for 727 SqFt of Wood R-13 & 1/2" Gypsum Wall Number 1 = 1672.1  
The Bluh Gain for 727 SqFt of Wood R-13 & 1/2" Gypsum Wall Number 2 = 1672.1  
The Bluh Gain for 874.552 SqFt of Wood R-13 & 1/2" Gypsum Wall Number 3 = 2011.4696  
The Bluh Gain for 874.552 SqFt of Wood R-13 & 1/2" Gypsum Wall Number 4 = 2011.4696

The Bluh Gain for 3702 SqFt of Ceiling and Roof Combo R-19: Ceiling Number 1 = 18585.6

The Bluh Gain for 3702 SqFt of Area Lighting in an Office = 11616

The Sanctuary & Rear Area Outside Fresh Air #1 = 3484.8 cfm  
The Bluh Gain for Outside Fresh Air #1 = 104544

The Total Outside Fresh Air CFM = 3484.8  
This is in accordance with International Mechanical Code 2006

The Total BTUh Gain = 149353.0052

The Total Tons of HVAC needed = 12.4460837666667

**LOBBY & FRONT AREAS:**

Project Tabernacle Baptist Church Lobby & Front Area HVAC Calculations  
Wed Nov 18 16:09:12 EST 2009

The Bluh Gain for 87,7608 SqFt of East and West Single Pane Glass = 9653.688  
The Bluh Gain for 51,7524 SqFt of Windows in Doors = 683.13168

The Bluh Gain for 180 SqFt of Wood R-13 & 1/2" Gypsum Wall Number 1 = 414  
The Bluh Gain for 180 SqFt of Wood R-13 & 1/2" Gypsum Wall Number 2 = 414  
The Bluh Gain for 711.5 SqFt of Wood R-13 & 1/2" Gypsum Wall Number 3 = 1636.45  
The Bluh Gain for 711.5 SqFt of Wood R-13 & 1/2" Gypsum Wall Number 4 = 1636.45

The Bluh Gain for 723 SqFt of Ceiling and Roof Combo R-19: Ceiling Number 1 = 3470.4

The Bluh Gain for 723 SqFt of Area Lighting in an Office = 2169

The Lobby & Front Area Outside Fresh Air #1 = 650.7 cfm  
The Bluh Gain for Outside Fresh Air #1 = 19521

The Total Outside Fresh Air CFM = 650.7  
This is in accordance with International Mechanical Code 2006

The Total BTUh Gain = 39598.11968

The Total Tons of HVAC needed = 3.2998433066667

**TOTAL CHURCH BUILDING:**


The Total Tons of HVAC needed for the Sanctuary & Rear Areas = 12.4460837666667

The Total Tons of HVAC needed for the Lobby & Front Areas = 3.2998433066667


Therefore, the Total Tons of HVAC needed for the entire Church = 15.7459233333334 Minimum

**HVAC NOTES**

1. CONCEALED DUCTWORK TO BE UL-181, CLASS 1, FIBERGLASS DUCTBOARD. DUCTS SHALL BE SIZED TO LIMIT AIR DUCTS TO 1000 CFM & SECONDARY DUCTS TO 800 CFM. TO BE INSTALLED PER SMACNA STANDARDS.
2. EXPOSED DUCTWORK TO BE GALVANIZED SHEET METAL PER SMACNA STANDARDS. LINE WITH NEOPRENE COATED 1.0" x 1.5 POUNDS PER CUBIC FOOT DUCT INSULATION.
3. ROUND FLEXIBLE DUCT TO BE UL-181, CLASS 1, AIR DUCT MATERIALS.
4. DUCT SIZES SHOWN ARE CLEAR INSIDE DIMENSIONS.
5. IN ALL SYSTEMS 2000 CFM AND OVER, BUT LESS THAN 15,000 CFM, SMOKE DETECTORS SHALL BE INSTALLED, IN ACCORDANCE WITH NFPA 72E & NFPA 90A, IN THE RETURN DUCT DOWNSTREAM OF THE AIR HANDLING UNIT AND ALL FILTERS TO AUTOMATICALLY STOP THE FAN.
6. PROVIDE U.L. LISTED 125 °F FUSES/TAP IN RETURN AIR OF EACH SYSTEM UNDER 2000 CFM TO SHUT DOWN THE FAN IN THE EVENT OF FIRE.
7. PROVIDE U.L. RATED FIRE DAMPERS WHERE REQUIRED AT ALL DUCT PENETRATIONS OF FIRE-RATED ASSEMBLIES AND WHERE REQUIRED BY CODE, INCLUDING OUTSIDE AIR INTAKES.
8. CONDENSATE DRAINS TO BE PVC PIPE RUN TO PLUMBERS P-TAP WITHIN FIVE FEET OF AIR HANDLING UNITS.
9. ALL AIR HANDLING SYSTEMS TO BE BALANCED TO ASSURE PROPER AIR FLOWS PER PLANS.
10. ALL THERMOSTATS TO BE AUTOMATIC CHANGEOVER WITH HEAT SWITCH.
11. EXHAUST FAN EQUAL TO BROAN MODEL NO. 100 CF. OR EQUAL. FAN SHALL BE CONTROLLED BY A SWITCH ON THE WALL IN THE SAME LOCATION AS LIGHT SWITCH(S).
12. PROVIDE BACK DRAFT DAMPER.
13. PROVIDE AND INSTALL WATER-PROOF GRILLE VENT IN PROPER ROOF LOCATION FOR PLUMBING FIXTURE EXHAUST.
14. LOCATE OUTDOOR UNITS AS SHOWN ON ARCH. DWGS.
15. REFRIGERANT LINES SHALL BE SIZED BY UNIT MANUFACTURER AND INSTALLED ACCORDING TO MANUFACTURERS' INSTRUCTIONS.
16. FRESH AIR SHALL BE SUPPLIED TO EACH AIR HANDLER THROUGH EXTERIOR WALL DUCT SUPPLIED WITH A CONTROL DAMPER.
17. INSTALL FIRE DAMPER WHERE S.A. & R.A. DUCTS PENETRATE 1 HOUR RATED CEILINGS.
18. ALL ELECTRICAL, MECHANICAL, AND PLUMBING PENETRATING FIRE WALLS SHALL BE FIRE CALKED. PENETRATIONS THROUGH RATED CONSTRUCTION SHALL BE SEALED WITH A MATERIAL CAPABLE OF PREVENTING THE PASSAGE OF FLAMES AND HOT GASES WHEN TESTED IN ACCORDANCE WITH ASTM E-154.
19. ALL MECHANICAL SYMBOLS ARE DRAWN DIAGRAMMATICALLY. CONTRACTOR TO VERIFY WITH OWNER LOCATIONS OF VENTS, DAMPERS, REGISTERS, ETC.
20. REFER TO STRUCTURAL DRAWINGS TO COORDINATE LOCATIONS.
21. FLEXIBLE DUCTWORK LENGTH NOT TO EXCEED 10'-0".
22. REFER TO REFLECTED CEILING PLAN FOR FINAL GRILLE AND DIFFUSER LOCATIONS AND COORDINATE AS REQUIRED.
23. FINAL LOCATION OF TEMPERATURE CONTROLS AS APPROVED BY LOCAL AHJ'S. PLACE NEAR R/A AND S/A OPENINGS OF AHU AND PROVIDE WITH ACCESS PANEL. WIRING BY ELECTRICAL CONTRACTOR.
24. PROVIDE AND INSTALL SMOKE DETECTORS AS APPROVED BY LOCAL AHJ'S. PLACE NEAR R/A AND S/A OPENINGS OF AHU AND PROVIDE WITH ACCESS PANEL. WIRING BY ELECTRICAL CONTRACTOR.
25. FRESH AIR INTAKES ARE REQUIRED TO HAVE MOTORIZED OR GRAVITY DAMPERS TO SHUT OFF WHEN SYSTEM IS NOT RUNNING. ALL THERMOSTATS MUST BE PROGRAMMABLE. SEE SECTIONS 502.4.4 OR 503.2.4.3 OF THE 2006 INTERNATIONAL ENERGY CODE

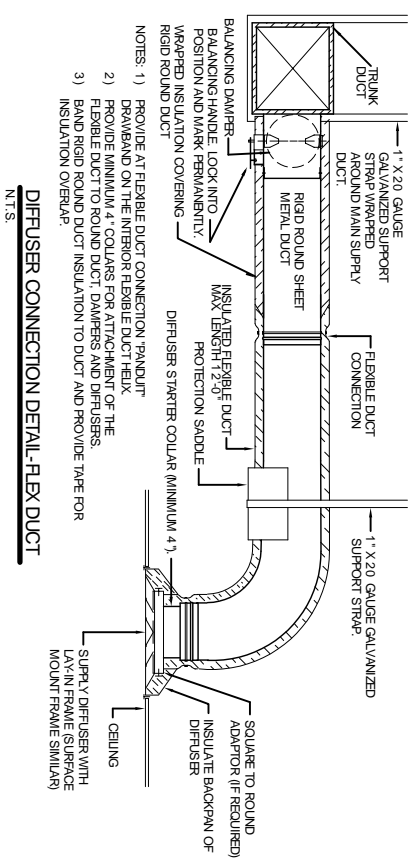

**DIFFUSER CONNECTION DETAIL-FLEX DUCT**  
N.T.S.



**DAMMON ENGINEERING, INC.**

CHIEF ENGINEER  
EMMETT DAMMON, P.E.  
CHIEF ARCHITECT  
ROBERT WILTSE

1095 FLORIDA AVENUE  
SUDELL, LA, 70458  
OFFICE: 985-649-5832  
FAX: 985-641-5950

WWW.DAMMONENGINEERING.COM  
EMAIL: DAMMONENG@BELL.SOUTH.NET

ARCHITECTURE  
ENGINEERING  
STUDIES  
PLANNING  
INVESTIGATION  
EXPERT WITNESS

NEW  
CHURCH

TABERNACLE  
BAPTIST  
CHURCH  
2445 FOURTH ST.  
SUDELL, LA

MECHANICAL  
NOTES

REV:  
SCALE: AS NOTED  
JOB#: 2050  
DATE: 2-8-10  
SHEET 21  
**M-2**  
OF 25