

**DAMMON**  
ENGINEERING, INC.

CHIEF ENGINEER  
EMMETT  
DAMMON, P.E.  
CHIEF ARCHITECT  
ROBERT  
WILTSE

554 OLD SPANISH TRAIL  
SUITE LL, LA, 70458  
OFFICE: 985-649-5532  
FAX: 985-641-5950

WEBSITE:  
WWW.DAMMONENGINEERING.COM  
EMAIL:  
DAMMONENG@BELL.SOUTH.NET

ARCHITECTURE  
ENGINEERING  
STUDIES  
PLANNING  
INVESTIGATION  
EXPERT WITNESSES

LIVING THE WORD  
INTERNATIONAL  
2528  
OLD SPANISH TRAIL  
SLIDELL, LA  
70461

FLOOR  
PLAN

REV.:

SCALE: AS NOTED

JOB#: 2128

DATE: 01-27-12

SHEET 9

A-1

OF 21

**DOOR & HARDWARE SCHEDULE**

MARK	SIZE	DOOR TYPE	FRAME	HWDR. NO.	STC	PANIC HWDR.	REMARKS
<b>EXTERIOR DOORS</b>							
1	PR. 30x7/0	STORE FRONT	TO WATCH DOOR	1	NA		
2	PR. 30x7/0	FLUSH GALV. HOL. MET. STEEL INSUL.		1	NA		GALVANIZING TO BE G90
<b>INTERIOR DOORS</b>							
3	PR. 30x7/0	FLUSH SOLID CORE WD.	PTD. HOL. MET.	3	NA		PROVIDE 4x36 VISION LITE
4	30x7/0	FLUSH GALV. FLUSH MET. STEEL INSUL.	PTD. HOL. MET.	3	NA		
5	30x7/0	STORE FRONT	TO WATCH DOOR	4	NA		W/ SIDELITES, MULLION BAR, TRANSDOM LITE ABOVE
6	30x7/0	FLUSH SOLID CORE WD.	PTD. HOL. MET.	4	NA		PROVIDE 4x36 VISION LITE
7	30x7/0	FLUSH SOLID CORE WD.	PTD. HOL. MET.	4	NA		
8	30x7/0	FLUSH SOLID CORE WD.	PTD. HOL. MET.	5	NA		
9	30x7/0	FLUSH SOLID CORE WD.	PTD. HOL. MET.	3	NA		
10	30x7/0	FLUSH SOLID CORE WD.	PTD. HOL. MET.	2	NA		1 HR. FIRE RATED
11	20x7/0	FLUSH SOLID CORE WD.	PTD. HOL. MET.	3	NA		
12	30x7/0	FLUSH SOLID CORE WD.	PTD. HOL. MET.	2	NA		

**DOOR HARDWARE SCHEDULE**  
 1. AUTO CLOSER, AIR REGULATOR, WEATHERSTRIP, DOOR STOP, EXTERIOR COUNTER LOCK (OFFICEDOCUMENTED), BALL BEARING US38D HINGES.  
 2. AUTO CLOSER, DOOR STOP, CYLINDER LOCK (GLOBE/ROUND LOCK), BALL BEARING US38D HINGES.  
 3. KNOB AND LEVER LOCK (GLOBE/ROUND LOCK), BALL BEARING US38D HINGES.  
 4. AUTO CLOSER, DOOR STOP, PRIVACY LOCK, BALL BEARING US38D HINGES.


**WINDOW SCHEDULE**

MARK	SIZE	WINDOW TYPE	FRAME	GLASS	REMARKS
A	OVERALL UNIT 5/2E = 40 W x 1'4 1/8 H	ALUMINUM STOREFRONT	ALUMINUM 2' x 4'	LOW E	SEE EXT. ELEVATIONS FOR ARCHITOP
B	OVERALL UNIT 5/2E = 40 W x 1'6 1/8 H	ALUMINUM STOREFRONT	ALUMINUM 2' x 4'	LOW E	SEE EXT. ELEVATIONS FOR ARCHITOP
C	OVERALL UNIT 5/2E = 60 W x 1'0 1/10 H	ALUMINUM STOREFRONT	ALUMINUM 2' x 4'	LOW E	SEE EXT. ELEVATIONS FOR ARCHITOP

**WINDOW SCHEDULE NOTES:**  
 1. GLAZING TO BE DBL. GLAZED LAMINATED LOW E.  
 2. EXTERIOR WINDOW SYSTEM SHALL BE CAPABLE OF RESISTING 130 MPH WIND LOAD.

**GENERAL NOTES**

- INSULATION AND INSULATION ASSEMBLIES SHALL MEET THE REQUIREMENTS OF SECTION 71.9.
  - CONCEALED INSULATION SHALL HAVE A FLAME SPREAD OF 0-25 AND SMOKE DEVELOPED INDEX OF 0-450. EXCEPT IN COMBUSTIBLE (WOOD FRAME) CONSTRUCTION.
  - FACING SHALL COMPLY WITH IBC 2009.
  - THRESHOLDS SHALL BE NOT MORE THAN 1/2" IN HEIGHT AND SHALL BE BEVELLED IF MORE THAN 1/4".
- CONTRACTOR TO VERIFY ALL SITE CONDITIONS, BUILDING LOCATIONS, AND DIMENSIONS PRIOR TO CONSTRUCTION.
- MATERIALS SHALL BE NEW AND U.L. LISTED.
- NO WORK SHALL BE CONCEALED UNTIL APPROVED BY LOCAL INSPECTORS.
- CONSTRUCTION SHALL COMPLY WITH ALL PARISH, STATE, AND LOCAL CODES.
- CONTRACTOR TO GUARANTEE WORK FOR ONE YEAR.
- CONTRACTOR SHALL FURNISH WATER AND POWER FROM EXISTING SOURCES.
- EXTERIOR CAULKING SHALL BE THICK CAULK.
- PAINT GRADE TO SHALL BE SHERWIN WILLIAMS OR EQUIVALENT. ALL WORK TO RECEIVE 3 COATS. COLOR SELECTION BY OWNER.
- PROVIDE CLEANUP ON A REGULAR BASIS. NO TRASH STORED IN BUILDING.
- ALL BATT INSULATION SHALL HAVE A CLASS "A" (0-25) FLAME SPREAD IN COMPLIANCE WITH APPLICABLE CODE.
- USE 6" STUDS, OR 4" STAGGERED STUDS AT ALL PLUMBING WALLS.
- PROVIDE GALVANIZED METAL PAN WITH DRAIN AT WATER HEATER LOCATION.
- ALL CORNERS SHALL BE PROPERLY BRAGED FOR WIND LOADS. A 48" SHEATHING SHALL BE PROVIDED EVERY 20 FEET OF WALL LENGTH.
- INTERIOR LOCKS ON DOORS IN MEANS OF EGRESS SHALL NOT REQUIRE THE USE OF A KEY, SPECIAL KNOWLEDGE, OR SPECIAL DEVICE TO OPEN IN THE DIRECTION OF EGRESS. ALL DOORS SHALL HAVE LEVER TYPE HANDLES.
- INTERIOR WALLS AND CEILING SHALL HAVE A FLAME SPREAD OF 0-25 AND A SMOKE DEVELOPMENT RATING OF 0-450.
- ALL WORK SHALL COMPLY WITH THE LATEST EDITION OF ALL LOCAL, STATE, AND NATIONAL CODES COVERING THE TYPE OF WORK BEING PERFORMED.
- PROVIDE PORTABLE FIRE EXTINGUISHERS IN ACCORDANCE WITH NFPA 101.1. SEE APPENDIX "E" OF NFPA 101 FOR DISTRIBUTION OF EXTINGUISHERS.
- ALL FIRE WALLS SHALL EXTEND TIGHT TO ROOF DECK AND BE SEALED WITH AN APPROVED FIRE CAULK.
- ALL ELECTRICAL, MECHANICAL, AND PLUMBING MATERIALS PENETRATING FIRE WALLS SHALL BE FIRE CALKED. PENETRATIONS THROUGH BATH CONSTRUCTION SHALL BE SEALED WITH A MATERIAL CAPABLE OF PREVENTING THE PASSAGE OF FLAMES AND HOT GASES WHEN TESTED IN ACCORDANCE WITH ASTM E814.
- SERVICE COUNTER SHALL HAVE A HCP ACCESSIBLE WRITING SURFACE. MAX. 36" FROM F.F. (ADAAG MANUAL 1998, PG 135)

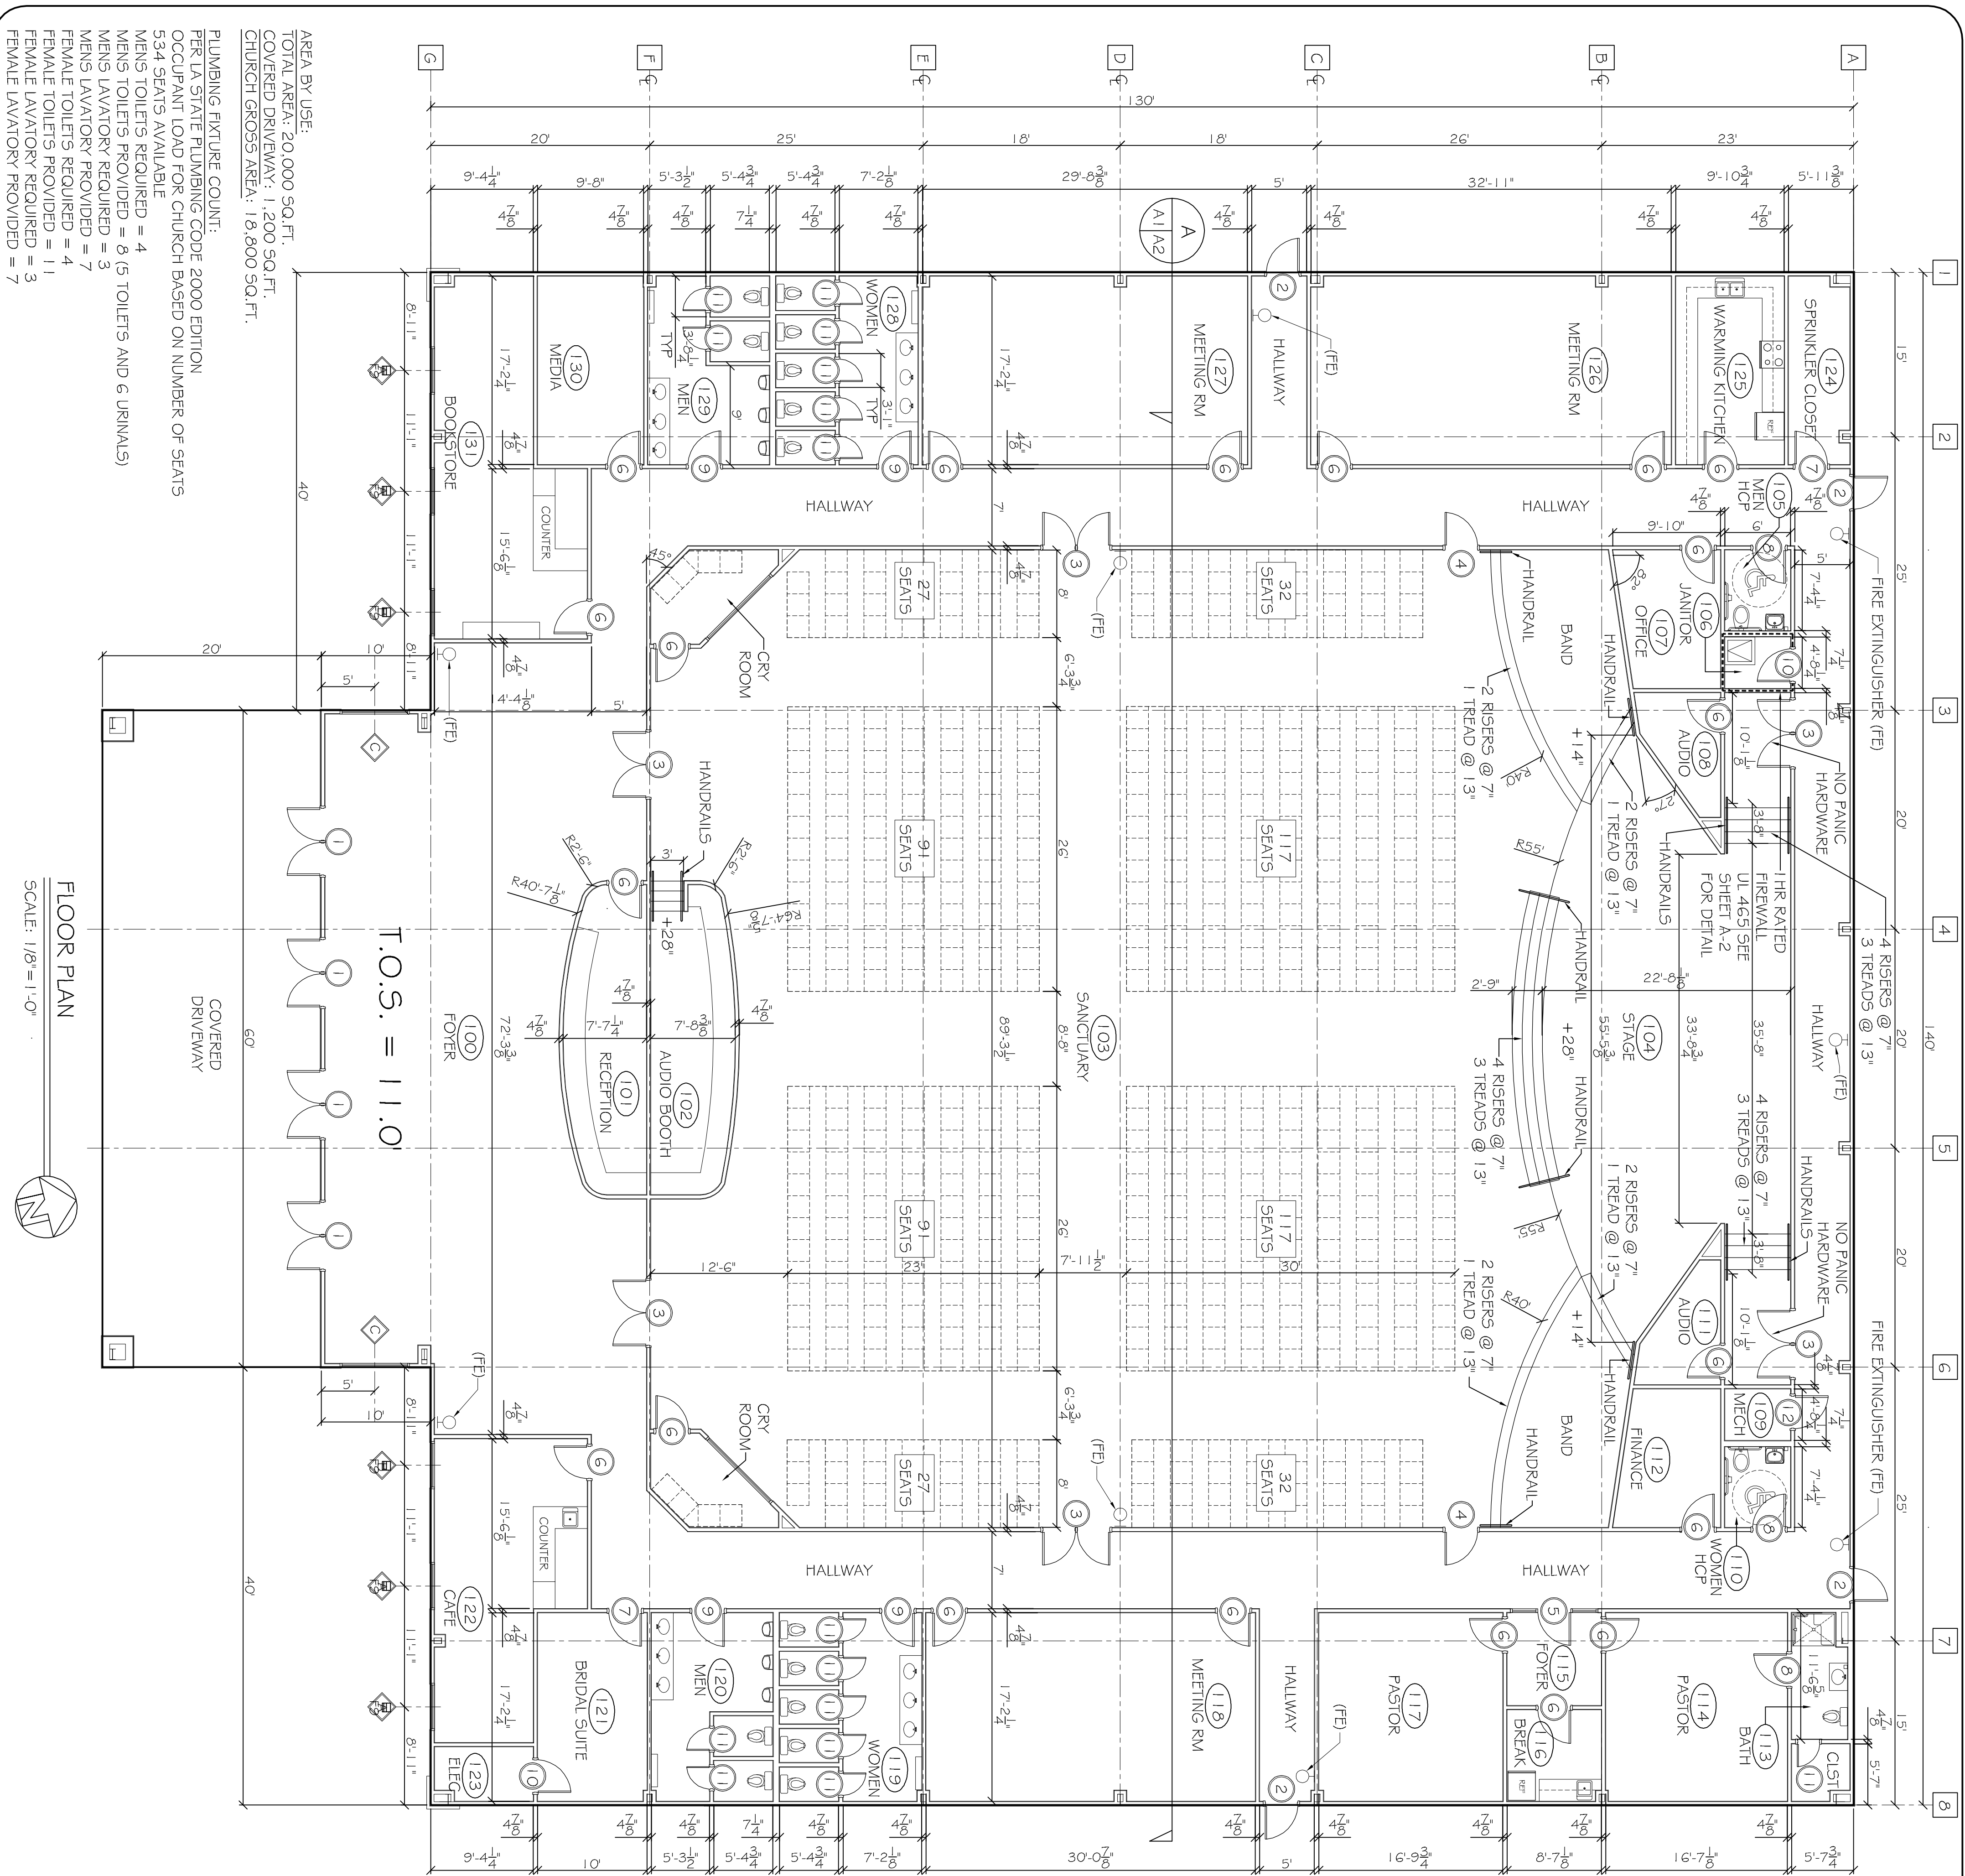

T.O.S. = 11.0'

FLOOR PLAN  
SCALE: 1/8" = 1'-0"

AREA BY USE:  
 TOTAL AREA: 20,000 SQ.FT.  
 COVERED DRIVEWAY: 1,200 SQ.FT.  
 CHURCH GROSS AREA: 18,800 SQ.FT.

PLUMBING FIXTURE COUNT:  
 PER LA STATE PLUMBING CODE 2000 EDITION  
 OCCUPANT LOAD FOR CHURCH BASED ON NUMBER OF SEATS  
 534 SEATS AVAILABLE  
 MENS TOILETS REQUIRED = 4  
 MENS LAVATORY PROVIDED = 3  
 MENS LAVATORY REQUIRED = 3  
 FEMALE TOILETS REQUIRED = 4  
 FEMALE TOILETS PROVIDED = 11  
 FEMALE LAVATORY REQUIRED = 3  
 FEMALE LAVATORY PROVIDED = 7