



- ONE LAYER 5/8" TYPE X GYPSUM WALLBOARD OR GYPSUM VENEER BASE APPLIED PARALLEL OR AT RIGHT ANGLES TO EACH SIDE OF 3-5/8" STEEL STUDS 24" O.C. WITH 1" TYPE S DRYWALL SCREWS 8" O.C. AT VERTICAL JOINTS AND 12" O.C. AT FLOOR AND CEILING RUNNERS AND INTERMEDIATE STUDS.
- JOINTS STAGGERED 24" ON EACH SIDE AND ON OPPOSITE SIDES. SOUND TESTED WITH 3-12" GLASS FIBER FRICTION FIT IN STUD SPACE. (NON-LOAD BEARING)

1 HOUR FIRE 45 TO 49 STC SOUND




APPROX. CEILING HEIGHT: 6 PSF  
FIRE TEST: SEE WP 1200 (FM WP-45 6-19-68); OSU T-1170, 8-61; ULC T9T484, T9T500, T9T491, 8-12-81; ULC DESIGN M415 NRCC 816-NV, 2-3-81

SOUND TEST:

- ALL GLAZING TO BE LAMINATED SAFETY GLASS.
- DOOR HINGES TO BE STANLEY FULL MORTISE STANDARD HEIGHT, BALL BEARING HINGES; STAINLESS STEEL WITH DARK BRONZE FINISH @ EXTERIOR & MATCHING DARK BRONZE FINISH ON STANDARD STEEL @ INTERIOR.
- PROVIDE LEVER HANDLE ADA APPROVED LOCKSETS WITH MATCHING DARK BRONZE FINISH, TO BE SELECTED BY OWNER.
- COORDINATE KEYING SCHEDULE WITH OWNER.
- DOOR STOPS TO BE EQUAL TO IVES NO. 436 OR 437, AS REQUIRED IN MATCHING FINISH.
- WEATHER-STRIP & THRESHOLD FINISH TO COMPLEMENT OTHER HARDWARE.
- TWISTER ONLY @ INTERIOR.

- INSULATION AND INSULATION ASSEMBLIES SHALL MEET THE REQUIREMENTS OF SECTION 714.
- CONCEALED INSULATION SHALL HAVE A FLAME SPREAD OF 0-25 AND SMOKE DEVELOPED INDEX OF 0-450, EXCEPT THAT IN COMBUSTIBLE (WOOD FRAME) CONSTRUCTION.
- FACING SHALL COMPLY WITH IBC 2006.
- PROVIDE 5X5' LANDINGS, LEVEL WITH FINISHED FLOOR, OUTSIDE EXTERIOR DOORS. THRESHOLDS SHALL BE NOT MORE THAN 1/2" IN HEIGHT AND SHALL BE BEVELED IF MORE THAN 1/4".
- DIMENSIONS ARE TO CENTERLINE, FACE OF STUDS, CENTER OF COLUMNS, OR FACE OF VENEER.
- CONTRACTOR TO VERIFY ALL SITE CONDITIONS, BUILDING LOCATIONS, AND DIMENSIONS PRIOR TO CONSTRUCTION.
- MATERIALS SHALL BE NEW AND U.L. LISTED.
- NO WORK SHALL BE CONCEALED UNTIL APPROVED BY LOCAL INSPECTORS.
- CONSTRUCTION SHALL COMPLY WITH ALL PARISH, STATE, AND LOCAL CODES.
- CONTRACTOR TO GUARANTEE WORK FOR ONE YEAR.
- CONTRACTOR SHALL FURNISH WATER AND POWER FROM EXISTING SOURCES.
- EXTERIOR CAULK SHALL BE DOW CORNING 790 SILICONE. INSTALL IN ACCORDANCE WITH MANUFACTURER RECOMMENDATIONS. COORDINATE WITH ARCHITECT/OWNER AS TO COLOR. INTERIOR CAULKING TO BE EQUAL TO DAP PAINTABLE LATEX WITH SILICONE.
- PAIN GRADE TO BE SHERVIN WILLIAMS OR EQUIVALENT. ALL WORK TO RECEIVE 3 COATS. COLOR SELECTION BY OWNER.
- PROVIDE CLEANUP ON A REGULAR BASIS. NO TRASH STORED IN BUILDING.

- ALL BATT INSULATION SHALL HAVE A CLASS "A" (0-25) FLAME SPREAD IN COMPLIANCE WITH APPLICABLE CODE.
- USE 6" STUDS, OR 4" STAGGERED STUDS AT ALL FLIMBING WALLS.
- PROVIDE GALVANIZED METAL PAN WITH DRAIN AT WATER HEATER LOCATION.
- ALL CORNERS SHALL BE PROPERLY BRACED FOR WIND LOADS. A 48" SHEATHING SHALL BE PROVIDED EVERY 20 FEET OF WALL LENGTH.
- FLOORING SHALL BE NON-SLIP.
- INTERIOR LOCKS ON DOORS IN MEANS OF EGRESS SHALL NOT REQUIRE THE USE OF A KEY, SPECIAL KNOWLEDGE, OR SPECIAL DEVICE TO OPEN IN THE DIRECTION OF EGRESS. ALL DOORS SHALL HAVE LEVER TYPE HANDLES.
- ALL ELECTRICAL, MECHANICAL, AND PLUMBING MATERIALS PENETRATING FIRE WALLS SHALL BE FIRE CAULKED. (PENETRATIONS THROUGH RATED CONSTRUCTION SHALL BE SEALED WITH A MATERIAL CAPABLE OF PREVENTING THE PASSAGE OF FLAMES AND HOT GASES WHEN TESTED IN ACCORDANCE WITH ASTM-E814.)
- SERVICE COUNTER SHALL HAVE A HCP ACCESSIBLE WRITING SURFACE, MAX. 36" FROM F.F. (ADAAG MANUAL 1998, PG 135)

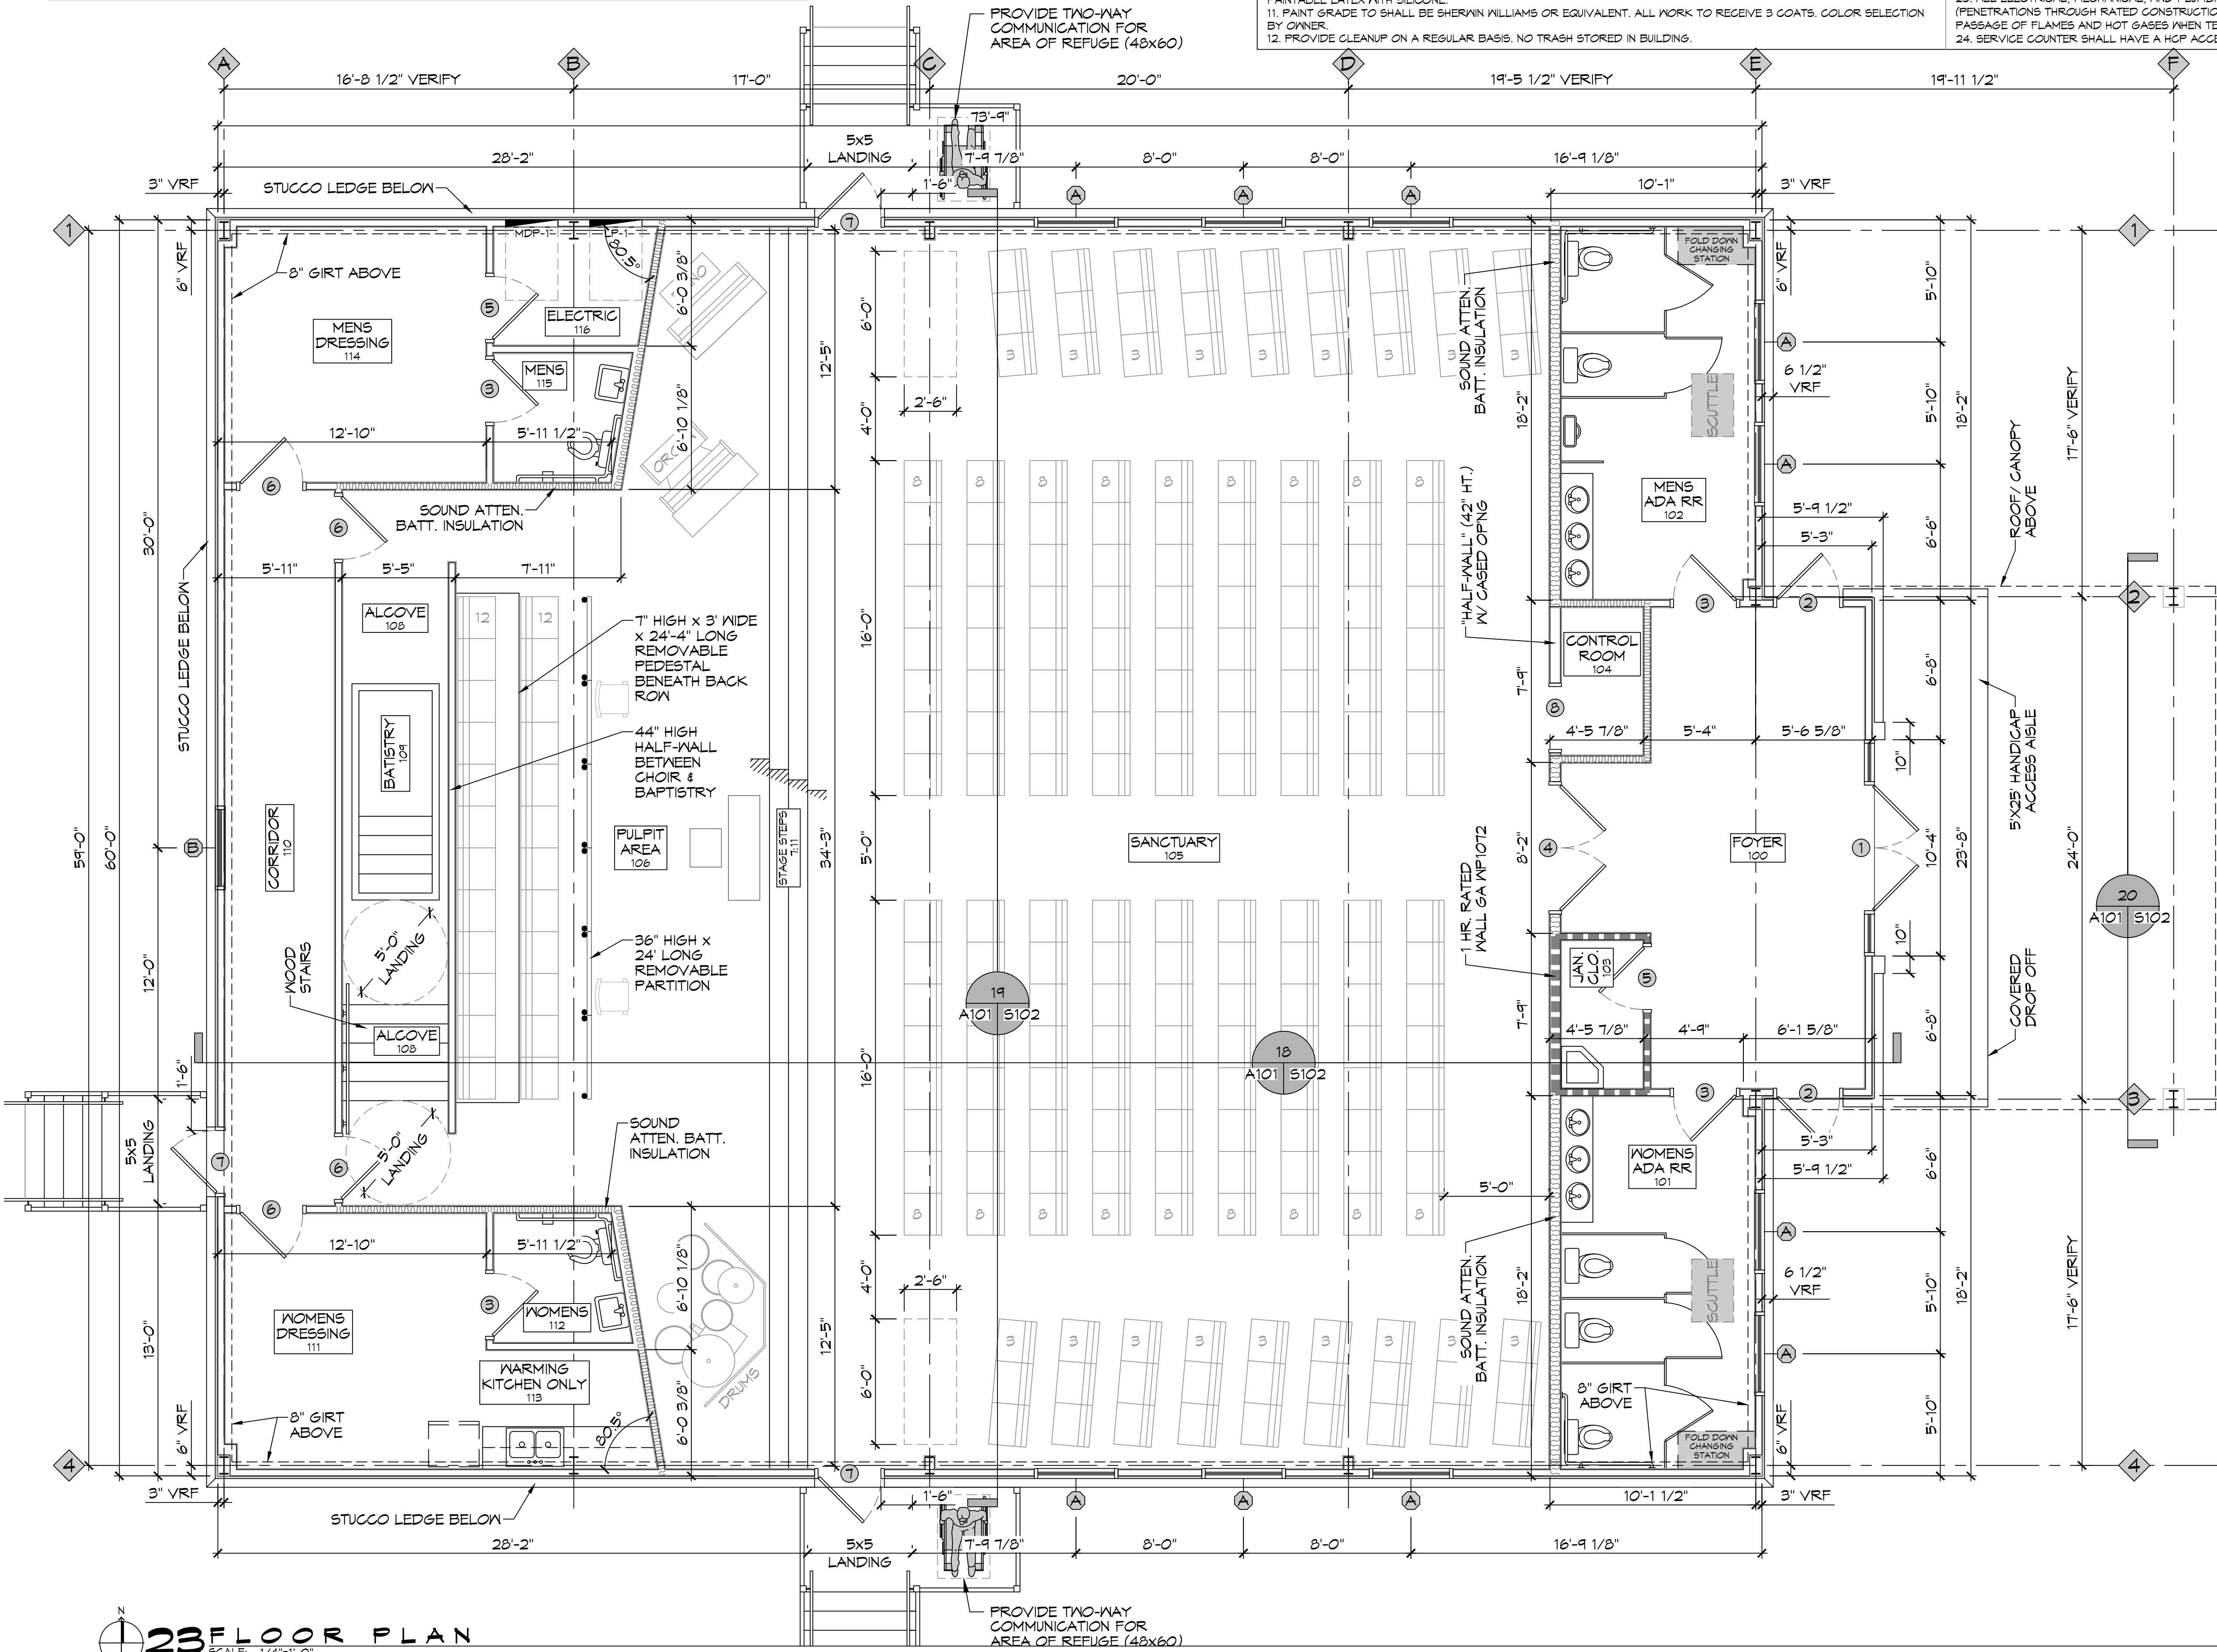

ROOM FINISH SCHEDULE

MK	FLR	BB	WALL	CEILING	HGT
100	VGT	VINYL	PAINTED GYP BD	2X2 LAY-IN	12'-0"
101	CERAMIC TILE	CERAMIC TILE	M.R. PAINTED GYP. W/ CERAMIC TILE TO 42"	M.R. PAINTED GYP.	9'-0"
102	CERAMIC TILE	CERAMIC TILE	M.R. PAINTED GYP. W/ CERAMIC TILE TO 42"	M.R. PAINTED GYP.	9'-0"
103	CONC	-	M.R. PAINTED GYP.	M.R. PAINTED GYP.	9'-0"
104	VGT	VINYL	PAINTED GYP BD	PAINTED GYP BD	9'-0"
105	CARPET	RUBBER	PAINTED GYP BD	SLOPPED 2X2 LAY-IN	VAR
106	CARPET	RUBBER	PAINTED GYP BD	SLOPPED 2X2 LAY-IN	VAR
107	CARPET	RUBBER	PAINTED GYP BD	SLOPPED 2X2 LAY-IN	VAR
108	CARPET	RUBBER	PAINTED GYP BD	SLOPPED 2X2 LAY-IN	VAR
109	FIBER GLASS	-	M.R. PAINTED GYP. W/ FIBERGLASS	SLOPPED 2X2 LAY-IN	VAR
110	VGT	VINYL	PAINTED GYP BD	2X2 LAY-IN	8'-6"
111	VGT	VINYL	PAINTED GYP BD	2X2 LAY-IN	9'-0"
112	CERAMIC TILE	CERAMIC TILE	M.R. PAINTED GYP. W/ CERAMIC TILE TO 42"	M.R. PAINTED GYP.	9'-0"
113	VGT	VINYL	M.R. PAINTED GYP.	2X2 LAY-IN	9'-0"
114	VGT	VINYL	PAINTED GYP BD	2X2 LAY-IN	9'-0"
115	CERAMIC TILE	CERAMIC TILE	M.R. PAINTED GYP. W/ CERAMIC TILE TO 42"	M.R. PAINTED GYP.	9'-0"
116	CONCRETE	-	PAINTED GYP BD	PAINTED GYP BD	9'-0"

INSTALL MOISTURE RESISTANT GYPSUM BOARD (PAINTED) ON WALLS ABOVE CERAMIC TILE IN RESTROOMS/BATHROOMS WITH CERAMIC TILE TO 42" HEIGHT AND ON WALLS ABOVE FIBERGLASS BAPTISTRY.

DOOR SCHEDULE

MK	WD	HT	THK	MAT	FRM	FR	NOTES
1	(2) 3'-0"	8'-0"	1-3/4"	WD W/ GLASS	METAL	NR	EXT DBL DR W/ CLOUSER
2	3'-0"	6'-8"	1-3/4"	WD W/ GLASS	METAL	NR	EXT DR W/ CLOUSER
3	3'-0"	6'-8"	1-3/4"	WD	METAL	NR	RR DR W/ CLOUSER
4	(2) 3'-0"	6'-8"	1-3/4"	WD	METAL	NR	
5	3'-0"	6'-8"	1-3/4"	WD	METAL	1 HR	
6	3'-0"	6'-8"	1-3/4"	WD	METAL	NR	
7	3'-0"	6'-8"	1-3/4"	METAL	METAL	NR	BACK DR W/ CLOUSER
8	3'-0"	6'-8"	1-3/4"	-	METAL	-	CASED OPENING

WINDOW SCHEDULE

MK	WD	HT	FRAME	TYPE	NOTES
A	4'-0"	8'-0"	METAL	FIXED	TEMPERED & TINTED
B	4'-0"	ROUND	METAL	FIXED	TEMPERED & STAINED

NOTE: VERIFY ALL STEEL SIZES AND/OR LOCATIONS WITH METAL BUILDING MANUFACTURER PRIOR TO CONSTRUCTION.

**DAMMON ENGINEERING, INC.**  
LOUISIANA & MISSISSIPPI  
www.dammonengineering.com  
info@dammonengineering.com  
Chief Engineer: Brian Mischke, PE  
554 Old Spanish Trail  
Slidell, LA 70688  
PH: 985.649.5832 F: 985.641.5950

#	DESCRIPTION	DATE

23 FLOOR PLAN  
SCALE: 1/4"=1'-0"

**LOVE CHURCH**  
SHEET TITLE: FLOOR PLAN  
DRAWING NUMBER: A101  
SHEET No: 6 of 16

DATE: 11-21-2022  
JOB No: 2245  
DRAWN BY: JMS  
CHECKED BY: CKD