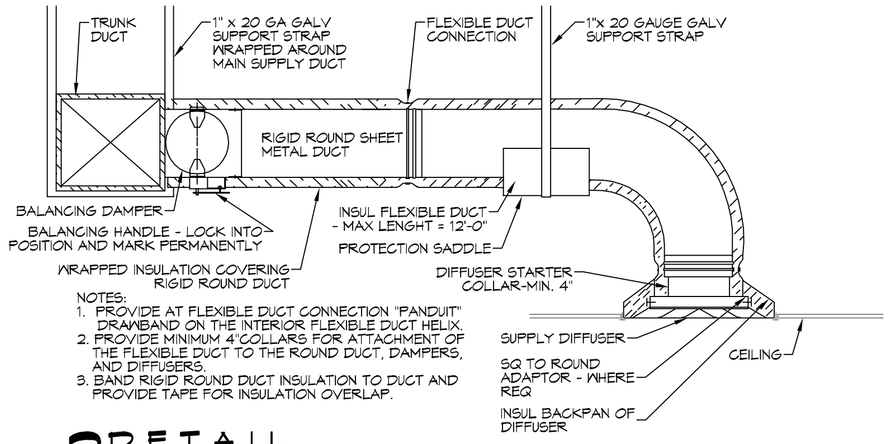

NOTES:
1. PROVIDE AT FLEXIBLE DUCT CONNECTION "PANDUIT" DRAWBAND ON THE INTERIOR FLEXIBLE DUCT HELIX.
2. PROVIDE MINIMUM 4"COLLARS FOR ATTACHMENT OF THE FLEXIBLE DUCT TO THE ROUND DUCT, DAMPERS, AND DIFFUSERS.
3. BAND RIGID ROUND DUCT INSULATION TO DUCT AND PROVIDE TAPE FOR INSULATION OVERLAP.

2 DETAIL
SCALE: 1/4"=1'-0"

FLEX DUCT CONNECTION

A/C SYSTEM SCHEDULE - PHASE B

TAG	Make	Model	NOMINAL TONS	AIRHANDLER TOTAL CFM	OA CFM	Motor HP	FLA	SUPPLY Total ESP (" WC)	SUPPLY Motor ESP (" WC)	SUPPLY Total ESP (" WC)	CONDENSER Type	CONDENSER Model	CONDENSER Max Fuse Size (Amps)	CONDENSER Min Circuit Ampacity (Amps)	CONDENSER Power (VOLTS)	CONDENSER Phase	CONDENSER Hertz	NOTES
AH-1	CARRIER	FX4DJB0616	5	1900	350	3/4	1.4	1	0.30	0.69	1.14	DX	38AHB036	60	30	3	60	1, 3
AH-2	CARRIER	42RMA048	7.5	2580	640	2.4	1.5	1	0.30	0.69	1.17	DX	38AHB042	80	40	3	60	1, 3
AH-3	CARRIER	FX4DJB042	3.5	1450	420	1/2	1.4	1	0.30	0.69	1.15	DX	38AHB036	60	25	3	60	1, 3
AH-4	CARRIER	42RMA048	7.5	2270	630	2.4	1.5	1	0.30	0.69	1.17	DX	38AHB042	80	40	3	60	1, 3
AH-5	CARRIER	42RMA042	10	4340	900	2.4	1.5	1	0.30	0.69	1.17	DX	38AHB042	80	40	3	60	1, 3, 4
AH-5	CARRIER	FX4DJB0616	5	1900	450	3/4	1.4	1	0.30	0.69	1.14	DX	38AHB036	60	30	3	60	1, 3
AH-7	CARRIER	FX4DJB0616	5	1900	450	3/4	1.4	1	0.30	0.69	1.14	DX	38AHB036	60	30	3	60	1, 3
AH-8	CARRIER	42RMA048	7.5	3000	680	2.4	1.5	1	0.30	0.69	1.17	DX	38AHB042	80	40	3	60	1, 3
AH-9	CARRIER	FX4DJB0616	2	900	160	3/4	1.4	1	0.30	0.69	1.14	DX	38AHB036	60	30	3	60	1, 3

NOTES:
(1) INCLUDES BLOWER MOTOR AMPS
(2) INSTALL UNITS / DUCTWORK IN ACCORDANCE WITH ASHRAE, SMACNA AND MANUFACTURER SPECIFICATIONS.
(3) TURN SYSTEM WIRED 24 / 7 THERMOSTAT AND LOCKABLE COVER.
(4) DUAL SETS GERANT CIRCUIT

MIN-SPLIT SCHEDULE

AIRHANDLER Tag	Make/Model	Cooling (MBH)	Power VAC	Power Ph	Power Amps	Remarks	HEAT PUMP Tag	Make/Model	Cooling Capacity (MBH)	Heating Capacity (MBH)	Power VAC
EV-11	DAIKIN FFQ18/2/VJU	15	208	1	0.29	1, 2, 3					
EV-12	DAIKIN FFQ18/2/VJU	15	208	1	0.29	1, 2, 3					
EV-13	DAIKIN FFQ18/2/VJU	15	208	1	0.29	1, 2, 3	CU-10	DAIKIN RMXS48LVJU	48	54	208

NOTES:
1 Wired Remote Control
2 Wired Condensate Pump
3 Fresh Air Kit with Vent Fan
4 Branch Provider Unit
5 Reset Kit

DIFFUSER SCHEDULE

Mark No.	Service	Neck Size	Description
A	Supply Air	Ref. Plan	Adjustable Double Deflection Register with Volume Damper
B	Supply Air	Ref. Plan	Louvered Directional Ceiling Diffuser with Volume Damper
C	Return Air	Ref. Plan	Perforated Face Ceiling Diffuser

1. Coordinate with Architect / Owner for colors and finish.
2. Provide neck size as noted

LEGEND

- SUPPLY AIR GRILLE
- EXHAUST FAN
- THERMOSTAT
- SUPPLY AIR DUCT
- DAMPER CONTROL
- ROUND FLEX DUCT, MAX. LENGTH 12'-0", MIN. R-6. PROVIDE MAN. DAMPER AT DIFFUSER CONNECTIONS, DUCT SIZE AS FOLLOWS:
  300 CFM TO 450 CFM = 12"
  200 CFM TO 300 CFM = 10"
  100 CFM TO 200 CFM = 8"
  40 CFM TO 100 CFM = 6"

MECHANICAL HVAC NOTES

1. CONCEALED DUCTWORK TO BE GALVANIZED SHEET METAL LINED WITH FIBROUS GLASS DUCT LINER, MIN R-6. INSTALLED PER SMACNA STANDARDS.
2. EXPOSED DUCTWORK TO BE GALVANIZED SHEET METAL LINED WITH FIBROUS GLASS DUCT LINER, MIN R-6. INSTALLED PER SMACNA STANDARDS.
3. ROUND FLEXIBLE DUCT TO BE UL-181, CLASS 1, AIR DUCT MATERIALS.
4. DUCT SIZES SHOWN ARE CLEAR INSIDE DIMENSIONS.
5. IN ALL SYSTEMS OVER 2000 CFM AND LESS THAN 15,000 CFM, SMOKE DETECTORS SHALL BE INSTALLED IN ACCORDANCE WITH NFPA 72E IN THE RETURN DUCT DOWNSTREAM OF THE AIR HANDLING UNIT AND ALL FILTERS TO AUTOMATICALLY STOP THE FAN.
6. PROVIDE UL LISTED 125 °F FIRESTAT IN RETURN AIR OF EACH SYSTEM UNDER 2000 CFM TO SHUT DOWN THE FAN IN THE EVENT OF FIRE.
7. PROVIDE UL RATED FIRE DAMPERS WHERE REQUIRED AT ALL DUCT PENETRATIONS OF FIRE-RATED ASSEMBLIES AND WHERE REQUIRED BY CODE, INCLUDING OUTSIDE AIR INTAKES AND EXHAUST FANS.
8. CONDENSATE DRAINS TO BE PVC PIPE RUN TO PLUMBERS P-TRAP WITHIN FIVE FEET OF AIR HANDLING UNITS.
9. ALL THERMOSTATS TO BE AUTOMATIC CHANGEOVER WITH HEAT SWITCH.
10. ALL RESTROOM EXHAUST FAN(S) SHALL BE CONTROLLED BY A SWITCH ON THE WALL IN THE SAME LOCATION AS LIGHT SWITCH(S). PROVIDE BACK DRAFT DAMPER.
11. PROVIDE AND INSTALL WATER PROOF GRILLE VENT IN PROPER ROOF LOCATION FOR PLUMBING FIXTURE EXHAUST.
12. ALL SUPPLY AIR VENTS SHALL BE EQUIPPED WITH AIR CONTROL DAMPERS AT THE REGISTER.
13. FRESH AIR SHALL BE SUPPLIED TO EACH AIR HANDLER THROUGH EXTERIOR WALL DUCT SUPPLIED WITH A CONTROL DAMPER.
14. ALL ELECTRICAL, MECHANICAL, AND PLUMBING PENETRATING FIRE WALLS SHALL BE FIRE CAULKED. (PENETRATIONS THROUGH RATED CONSTRUCTION SHALL BE SEALED WITH A MATERIAL CAPABLE OF PREVENTING THE PASSAGE OF FLAMES AND HOT GASES WHEN TESTED IN ACCORDANCE WITH ASTM-E8-14).
15. ALL MECHANICAL SYMBOLS ARE DRAWN DIAGRAMMATICALLY. CONTRACTOR TO VERIFY WITH OWNER LOCATIONS OF VENTS, DAMPERS, REGISTERS, ETC.
16. FLEXIBLE DUCTWORK LENGTH NOT TO EXCEED 12'-0".
17. REFER TO REFLECTED CEILING PLAN FOR FINAL GRILLE AND DIFFUSER LOCATIONS AND COORDINATE AS REQUIRED.
18. FINAL LOCATION OF TEMPERATURE CONTROLS TO BE COORDINATED WITH OWNER AT JOB SITE.
19. PROVIDE AND INSTALL SMOKE DETECTORS AS APPROVED BY LOCAL AHJS. PLACE NEAR R/A AND S/A OPENINGS OF AHU AND PROVIDE, WITH ACCESS PANEL, WIRING BY ELECTRICAL CONTRACTOR, IF REQUIRED.
20. FRESH AIR INTAKES ARE REQUIRED TO HAVE MOTORIZED OR GRAVITY DAMPERS TO SHUT OFF WHEN SYSTEM IS NOT RUNNING.
21. PROVIDE BIRD SCREENS AT ALL EXTERIOR MECHANICAL PENETRATIONS.
22. CONTRACTOR SHALL PROVIDE A MEANS FOR ATTIC VENTILATION FOR THE MOVEMENT OF AIR ABOVE DROP CEILING(S) EITHER BY MECHANICAL VENTS OR POWER VENTS.

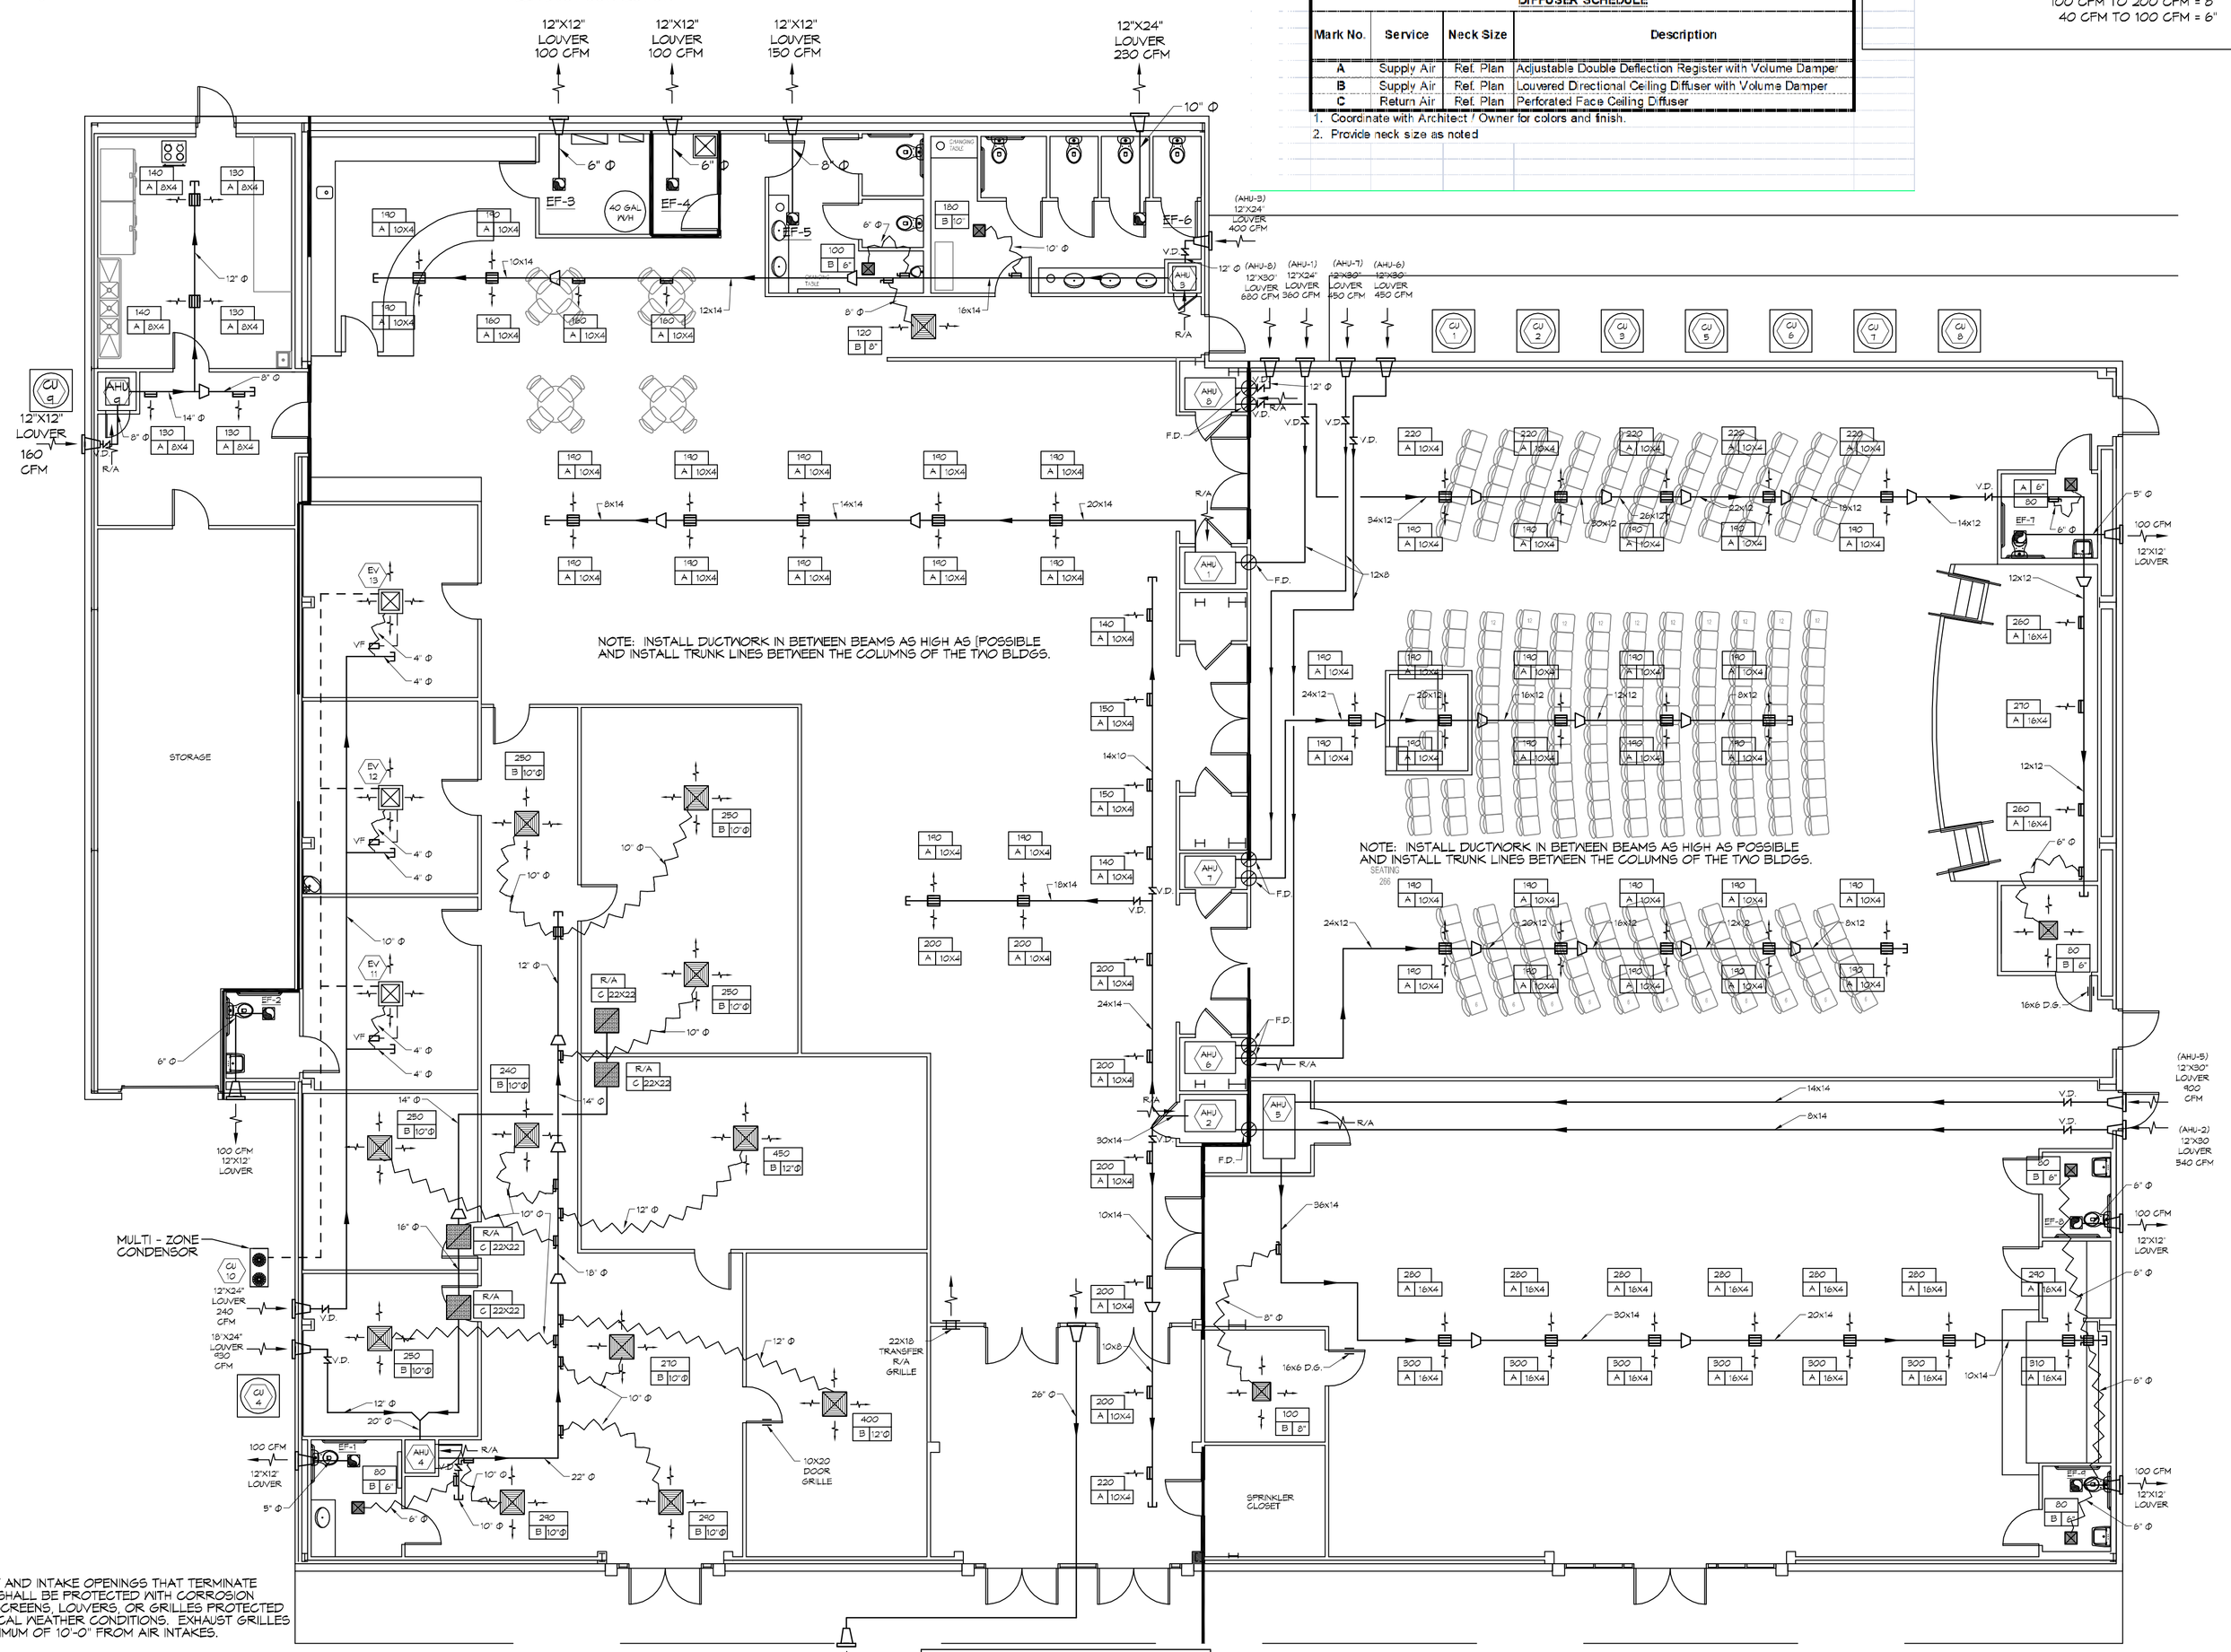

NOTE: AIR EXHAUST AND INTAKE OPENINGS THAT TERMINATE OUTDOORS SHALL BE PROTECTED WITH CORROSION RESISTANT SCREENS, LOUVERS, OR GRILLES PROTECTED AGAINST LOCAL WEATHER CONDITIONS. EXHAUST GRILLES TO BE A MINIMUM OF 10'-0" FROM AIR INTAKES.

1 MECHANICAL PLAN PHASE "B"
SCALE: 1/8"=1'-0"

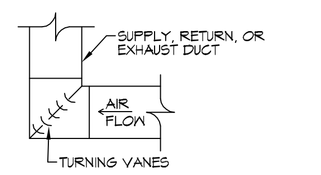

3 DETAIL
SCALE: 1/4"=1'-0" HARD DUCT ELBOW

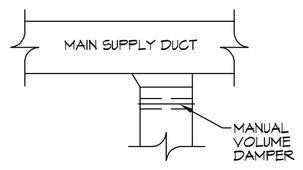

4 DETAIL
SCALE: 1/4"=1'-0" HARD DUCT BRANCH

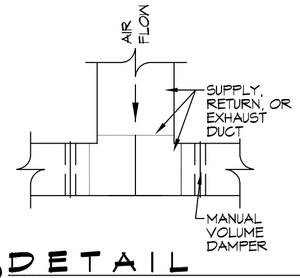

5 DETAIL
SCALE: 1/4"=1'-0" HARD DUCT SPLIT

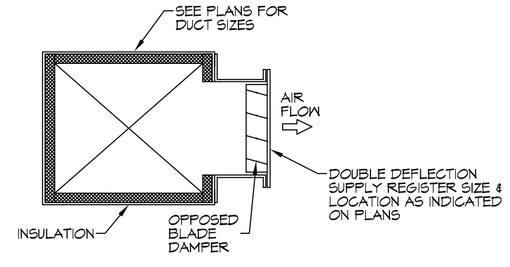

6 DETAIL
SCALE: 1/4"=1'-0" GRILLE ON EXPSOED DUCT

DAMMON ENGINEERING, INC.
LOUISIANA & MISSISSIPPI
www.dammonengineering.com
info@dammonengineering.com
PH: 985.649.3832 F: 985.641.5950
Chief Engineer: Brian Mistich, PE
554 Old Spanish Trail
Slidell, LA 70458

REVISIONS

#	DESCRIPTION	DATE

GRACE FELLOWSHIP
34482 NILLS ALLEY
PEARL RIVER LA

JOB No:	2340
DATE:	02/07/2018
DRAWN BY:	JTL
CHECKED BY:	BAM

The client retains the property in drawings and other documents prepared by Dammon Engineering, Inc. and may use them for any purpose consistent with the agreement between the client and Dammon Engineering, Inc. Reproduction by others, or use for purposes not in accordance with any check or greater) other than the specific project for which they were prepared and publication thereof is expressly reserved. Dammon Engineering, Inc. shall not be responsible for any use of the drawings or other documents for any purpose other than the specific project for which they were prepared. © 2018 Dammon Engineering, Inc.

SHEET TITLE:
MECHANICAL PLAN PHASE B

DRAWING NUMBER:
M102

SHEET No: 12 of ?