

DOOR SCHEDULE				FINISH SCHEDULE			
NO.	WIDTH	HEIGHT	THICKNESS	DOOR MAT	FRAME MAT	FINISH	REMARKS
100A	123'-0"	6'-8"	1-3/4"	ALUM/GLASS	ALUM	FR	ALUMINUM STRENGTH WITH DOOR CLOSURE
100B	123'-0"	6'-8"	1-3/4"	INSUL MTL	STEEL	NR	WITH DOOR CLOSURE
100C	9'-0"	6'-8"	1-3/4"	INSUL MTL	STEEL	NR	WITH DOOR CLOSURE
101	3'-0"	6'-8"	1-3/4"	WOOD	WOOD	NR	WITH DOOR CLOSURE
102	2'-8"	6'-8"	1-3/4"	MASONITE	WOOD	NR	MASONITE
103	123'-0"	6'-8"	1-3/4"	MASONITE	WOOD	NR	WITH DOOR CLOSURE
104	123'-0"	6'-8"	1-3/4"	MASONITE	WOOD	NR	WITH DOOR CLOSURE
105	9'-0"	6'-8"	1-3/4"	MASONITE	WOOD	NR	WITH DOOR CLOSURE
105F	9'-0"	6'-8"	1-3/4"	SOLID WOOD	STEEL	1-1/2 HR	WITH DOOR CLOSURE (1-1/2 HR FIRE RATING)
106	2'-0"	6'-8"	1-3/4"	INSUL MTL	WOOD	NR	MASONITE
106F	2'-0"	6'-8"	1-3/4"	SOLID WOOD	STEEL	1-1/2 HR	WITH DOOR CLOSURE (1-1/2 HR FIRE RATING)
107	3'-0"	6'-8"	1-3/4"	MASONITE	WOOD	NR	WITH DOOR CLOSURE WITH COUNTER ON TOP TO MATCH ADJACENT
107F	3'-0"	6'-8"	1-3/4"	MASONITE	WOOD	NR	WITH DOOR CLOSURE WITH COUNTER ON TOP TO MATCH ADJACENT

FINISH SCHEDULE				REMARKS			
NO.	ROOM NAME	ROOM NO.	FLOOR	BASE	WALL	CEILING	REMARKS
100	FOYER	100	VCT	5/8" GYP BD	ACT	ACT	
101	LANTORS SUPPLIES	101	VCT	5/8" GYP BD	ACT	ACT	
102	WOMEN'S RESTROOM	102	CERAMIC TILE	5/8" GYP BD	ACT	ACT	
103	MEN'S RESTROOM	103	CERAMIC TILE	5/8" GYP BD	ACT	ACT	
104	ELECTRICAL CLOSET	104	VCT	5/8" GYP BD	ACT	ACT	
105	SOUND VIDEO ROOM	105	VCT	5/8" GYP BD	ACT	ACT	
106	CAMERA BOOTH	106	VCT	5/8" GYP BD	ACT	ACT	
107	CHURCH STORE	107	VCT	5/8" GYP BD	ACT	ACT	
108	CORRIDOR	108	VCT	5/8" GYP BD	ACT	ACT	

- ### GENERAL PLAN NOTES
- INSULATION AND INSULATION ASSEMBLIES SHALL MEET THE REQUIREMENTS OF IBC 2015 SECTION 120. A CONCEALED INSULATION SHALL HAVE A FLAME SPREAD OF 0-25 AND SMOKE DEVELOPED INDEX OF 0-450 EXCEPT THAT IN COMBUSTIBLE (WOOD FRAME) CONSTRUCTION.
 - B. FINISH SHALL COMPLY WITH IBC 2015.
 - ALL MATERIALS SHALL BE NEW AND UL LISTED.
 - NO WORK SHALL BE CONCEALED UNTIL APPROVED BY LOCAL INSPECTORS.
 - CONTRACTOR SHALL COMPLY WITH ALL PARISH, STATE, AND LOCAL CODES.
 - CONTRACTOR TO GUARANTEE WORK FOR ONE YEAR FROM DATE OF SUBSTANTIAL COMPLETION.
 - CONTRACTOR SHALL FINISH WATER AND POWER FROM EXISTING SOURCES.
 - EXTERIOR CALCULATING SHALL BE THICK CALK.
 - PAINT SHALL BE SHERWIN WILLIAMS OR EQUIVALENT AND APPROPRIATE FOR THE SUBSTRATE TO WHICH IT IS APPLIED AS RECOMMENDED BY PAINT MANUFACTURER. ALL WORK TO RECEIVE THREE COATS (ONE PRIMER COAT, TWO FINISH COATS) UNLESS OTHERWISE RECOMMENDED BY PAINT MANUFACTURER. COLORS TO BE SELECTED BY OWNER.
 - PROVIDE CLEANUP ON A REGULAR BASIS. NO TRASH SHALL BE STORED INSIDE BUILDING PREMISES.
 - ALL BATT INSULATION SHALL HAVE A CLASS "X" (0-25) FLAME SPREAD IN COMPLIANCE WITH IBC 2015.
 - USE 2X6 WOOD STUDS, OR TWO 2X4 WOOD STAGGERED STUDS WITH 2X6 SILL PLATE AT ALL WALLS HERE & PIPE IS INDICATED. SEE PLUMBING RISER DIAGRAM FOR PIPE SIZES.
 - PROVIDE GALVANIZED METAL PAN WITH DRAIN AT ALL WATER HEATERS.
 - ALL FLOORING SHALL MEET OR EXCEED ADA GUIDELINES REQUIREMENTS FOR SLIP RESISTANCE.
 - INTERIOR LOCKS ON DOORS IN MEANS OF EGRESS SHALL NOT REQUIRE THE USE OF A KEY, SPECIAL KNOWLEDGE OR SPECIAL DEVICE TO OPEN IN THE DIRECTION OF EGRESS. ALL DOORS SHALL HAVE LEVER TYPE HANDLES.
 - INTERIOR WALLS AND CEILINGS SHALL HAVE A FLAME SPREAD OF 0-200 AND A SMOKE DEVELOPMENT RATING OF 0-450.
 - ALL NEW WORK SHALL COMPLY WITH THE LATEST EDITION OF ALL LOCAL, STATE, AND NATIONAL CODES COVERING THE TYPE OF WORK BEING PERFORMED.
 - PROVIDE PORTABLE FIRE EXTINGUISHERS IN ACCORDANCE WITH NFPA 101. SEE APPENDIX "E" OF NFPA 101 FOR DISTRIBUTION OF EXTINGUISHERS.
 - ALL FIRE WALLS SHALL EXTEND TIGHT TO ROOF DECK AND BE SEALED WITH AN APPROVED FIRE GULK.
 - ALL ELECTRICAL, MECHANICAL, AND PLUMBING MATERIALS PENETRATING FIRE WALLS SHALL BE FIRE GULKED. (PENETRATIONS THROUGH RATED CONSTRUCTION SHALL BE SEALED WITH A MATERIAL CAPABLE OF PREVENTING THE PASSAGE OF FLAMES AND HOT GASES WHEN TESTED IN ACCORDANCE WITH ASTM E814.)
 - SERVICE COUNTERS SHALL HAVE AN ACCESSIBLE FINISH SURFACE IN COMPLIANCE WITH ADAAG ACCESSIBILITY GUIDELINES 2010 SECTION 902.3.


DAMMON

ENGINEERING, INC.

LOUISIANA & MISSISSIPPI

Chief Engineer: Brian Mistic, PE
 554 Old Spanish Trail
 Slidell, LA 70458

www.dammonengineering.com
 info@dammonengineering.com
 PH: 985.649.5832 F: 985.641.5950

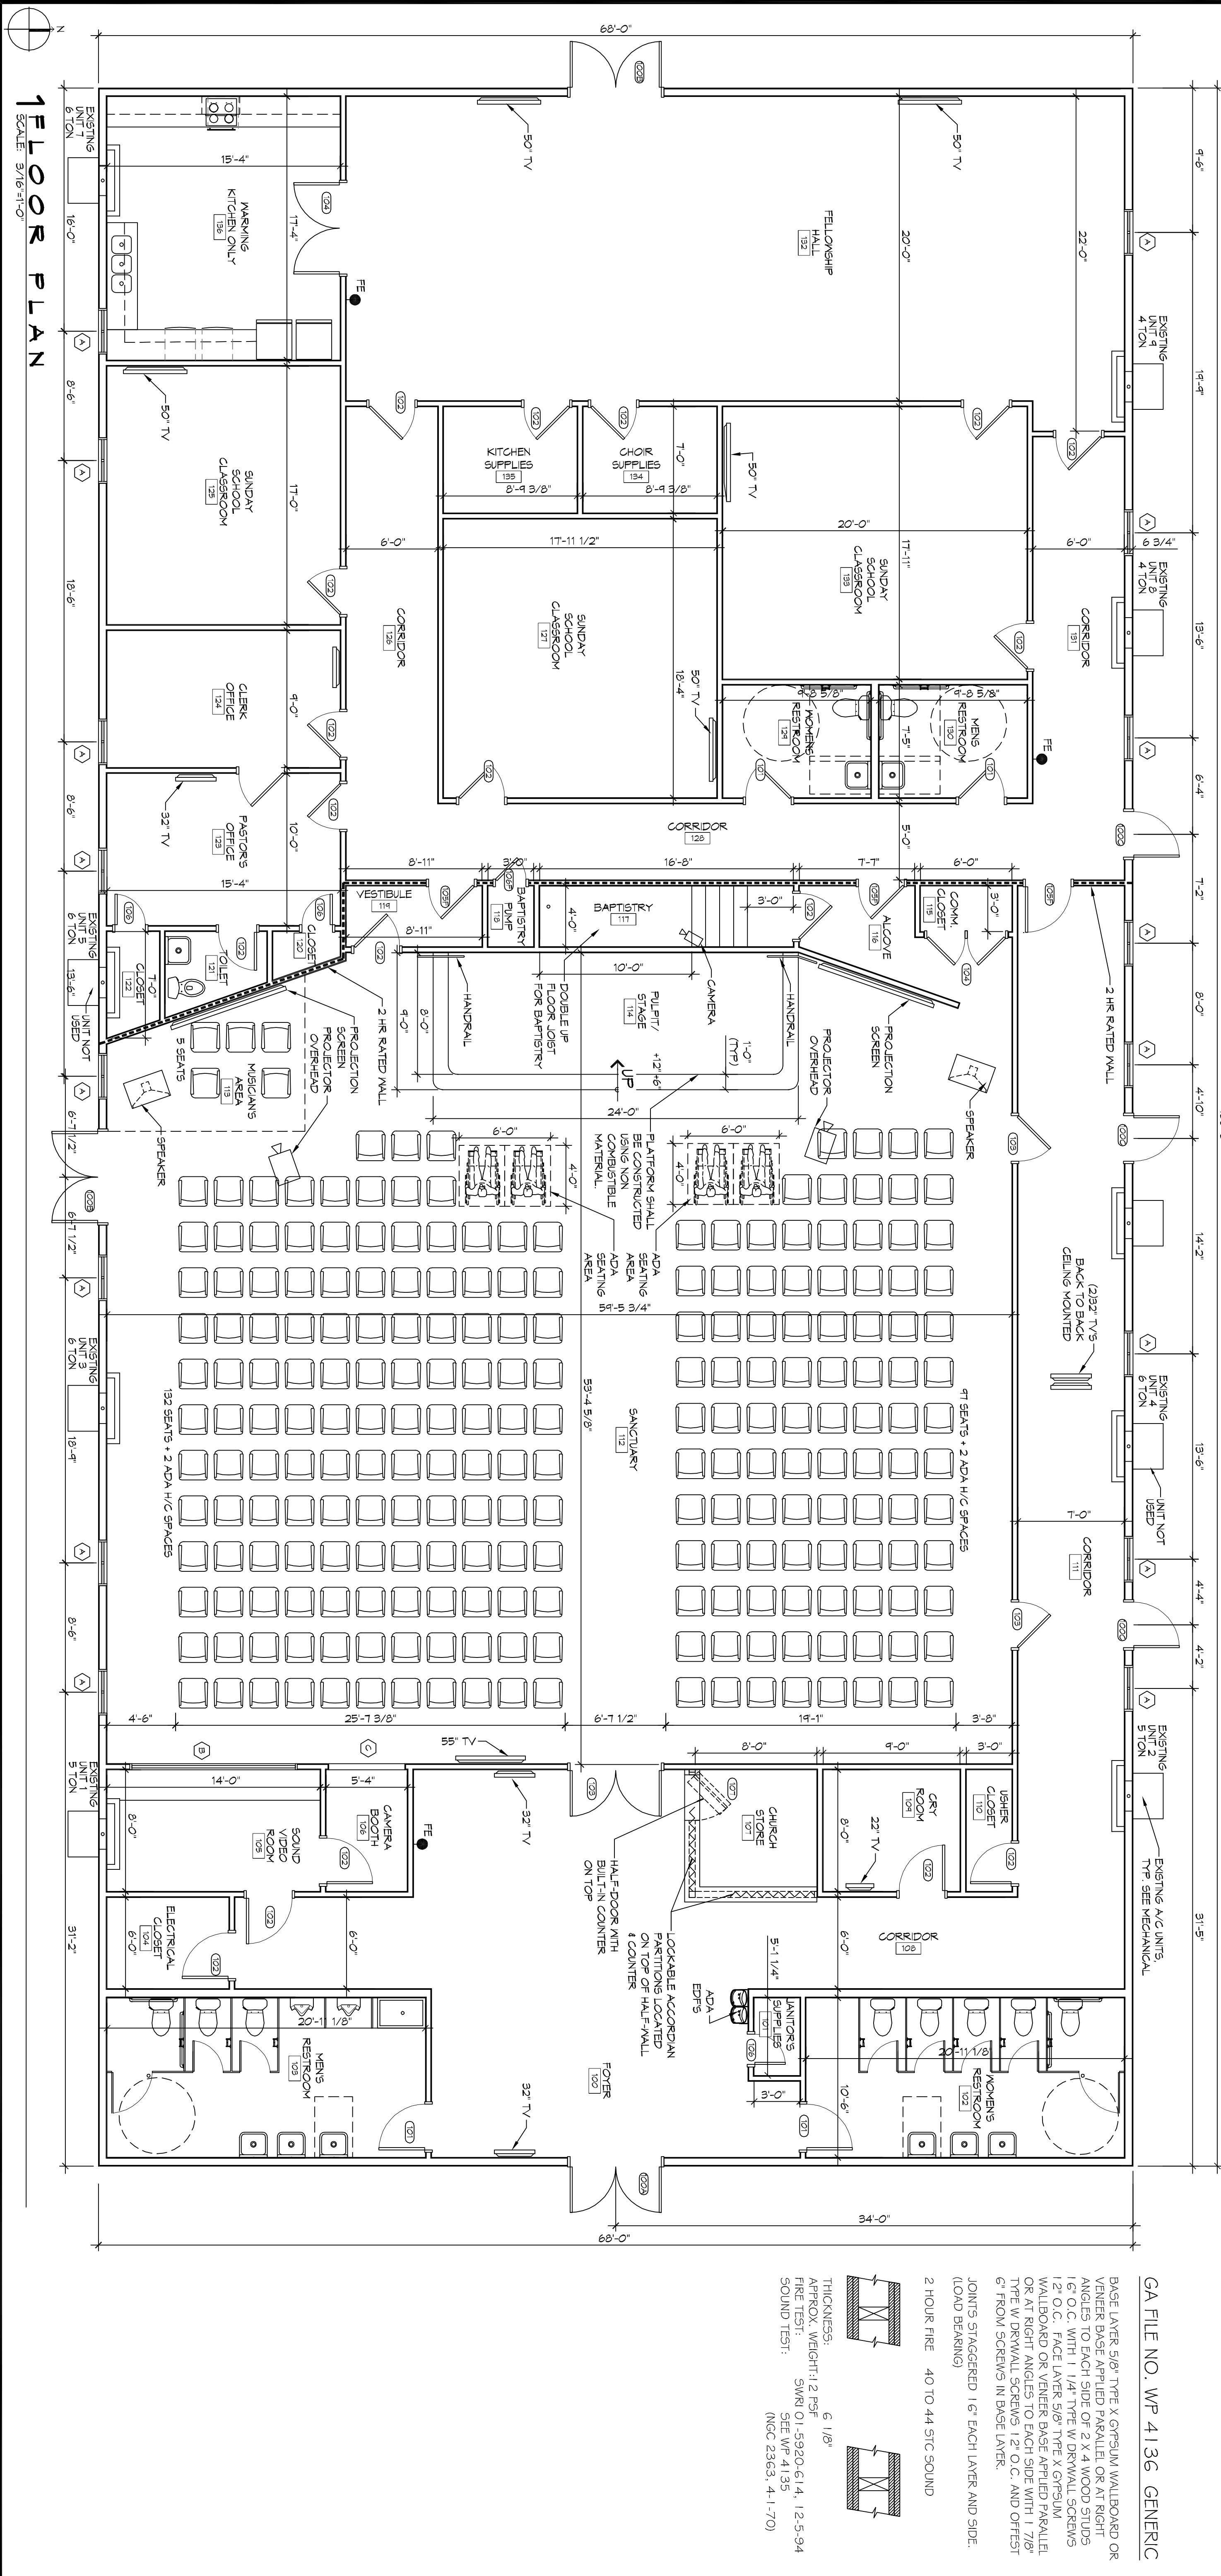

Missing or invalid
 File: P:\Stamps
 Sheet: 1

THICKNESS:
 APPROX. WEIGHT: 2.95F
 FIRE TEST: SWRI 01-5920-614, 12-5-94
 SOUND TEST: SIE WF 41-35
 (MSC 2565; 4-1-70)

3170 LEGGETT ROAD
 SLIDELL, LA 70460

JOB No: 2245 DATE: 4/15/2017
 DRAWN BY: CKD CHECKED BY: JMS

REVISIONS

#	DESCRIPTION	DATE

A101

1 of 15