DOOR SCHEDULE

MK	WIDTH	HEIGHT	THK	DOOR MAT	FRAME MAT	FR	REMARKS
100A	(2)3'-0"	6'-8"	1-3/4"	ALUM/GLASS	ALUM	NR	ALUMINUM STOREFRONT WITH DOOR CLOSURE
100B	(2)3'-0"	6'-8"	1-3/4"	SOLID WOOD	STEEL	2 HR	WITH DOOR CLOSURE (2 HR FIRE RATING)
100C	3'-0"	6'-8"	1-3/4"	MASONITE	WOOD	NR	WITH DOOR CLOSURE
101	3'-0"	6'-8"	1-3/4"	MASONITE	WOOD	NR	WITH DOOR CLOSURE
102	3'-0"	6'-8"	1-3/4"	SOLID WOOD	STEEL	1 HR	WITH DOOR CLOSURE (1 HR FIRE RATING)

WINDOW SCHEDULE

MK	SIZE	FRAME	TYPE	REMARKS
A	3'-0"W x 5'-0"H	ALUM	SLIDER	EXISTING TO REMAIN
B	11'-0"W x 5'-0"H	ALUM	FIXED	NEW WINDOW

FINISH SCHEDULE

ROOM NAME	ROOM NO	FLOOR	BASE	WALL	CEILING	REMARKS
LOBBY	100	VCT	VINYL	5/8" GYP BD	ACT	
AUDITORIUM	101	VCT	VINYL	5/8" GYP BD	ACT	
SOUND ROOM	102	VCT	VINYL	5/8" GYP BD	ACT	
CRY ROOM	103	VCT	VINYL	5/8" GYP BD	ACT	
WOMEN'S TOILET	104	CERAMIC TILE	CERAMIC TILE	5/8" GYP BD	ACT	MOISTURE RESISTANT
CLOSET	105	VCT	VINYL	5/8" GYP BD	ACT	
CLOSET	106	VCT	VINYL	5/8" GYP BD	ACT	
MEN'S TOILET	107	CERAMIC TILE	CERAMIC TILE	5/8" GYP BD	ACT	MOISTURE RESISTANT
CORRIDOR	108	VCT	VINYL	5/8" GYP BD	ACT	
CLASSROOM	109	VCT	VINYL	5/8" GYP BD	ACT	
CLASSROOM	110	VCT	VINYL	5/8" GYP BD	ACT	
CLASSROOM	111	VCT	VINYL	5/8" GYP BD	ACT	
CLASSROOM	112	VCT	VINYL	5/8" GYP BD	ACT	

GENERAL PLAN NOTES

1. INSULATION AND INSULATION ASSEMBLIES SHALL MEET THE REQUIREMENTS OF IBC 2015 SECTION 720.
   A. CONCEALED INSULATION SHALL HAVE A FLAME SPREAD OF 0-25 AND SMOKE DEVELOPED INDEX OF 0-450. EXCEPT THAT IN COMBUSTIBLE (WOOD FRAME) CONSTRUCTION.
   B. FACING SHALL COMPLY WITH IBC 2015.
2. ALL MATERIALS SHALL BE NEW AND UL LISTED.
3. NO WORK SHALL BE CONCEALED UNTIL APPROVED BY LOCAL INSPECTORS.
4. CONSTRUCTION SHALL COMPLY WITH ALL PARISH, STATE, AND LOCAL CODES.
5. CONTRACTOR TO GUARANTEE WORK FOR ONE YEAR FROM DATE OF SUBSTANTIAL COMPLETION.
6. CONTRACTOR SHALL FURNISH WATER AND POWER FROM EXISTING SOURCES.
7. EXTERIOR CAULKING SHALL BE THICKAL CAULK.
8. PAINT SHALL BE SHERWIN WILLIAMS OR EQUIVALENT AND APPROPRIATE FOR THE SUBSTRATE TO WHICH IT IS APPLIED AS RECOMMENDED BY PAINT MANUFACTURER. ALL WORK TO RECEIVE THREE COATS (ONE PRIMER COAT, TWO FINISH COATS) UNLESS OTHERWISE RECOMMENDED BY PAINT MANUFACTURER. COLORS TO BE SELECTED BY OWNER.
9. PROVIDE CLEANUP ON A REGULAR BASIS. NO TRASH SHALL BE STORED INSIDE BUILDING PREMISES.
10. ALL BATT INSULATION SHALL HAVE A CLASS "A" (0-25) FLAME SPREAD IN COMPLIANCE WITH IBC 2015.
11. USE 2x6 WOOD STUDS, OR TWO 2x4 WOOD STAGGERED STUDS WITH 2x6 SILL PLATE AT ALL WALLS WHERE 4" PIPE IS INDICATED. SEE PLUMBING RISER DIAGRAM FOR PIPE SIZE.
12. PROVIDE GALVANIZED METAL PAN WITH DRAIN AT ALL WATER HEATERS.
13. ALL FLOORING SHALL MEET OR EXCEED ADA GUIDELINES REQUIREMENTS FOR SLIP RESISTANCE.
14. INTERIOR LOCKS ON DOORS IN MEANS OF EGRESS SHALL NOT REQUIRE THE USE OF A KEY, SPECIAL KNOWLEDGE, OR SPECIAL DEVICE TO OPEN IN THE DIRECTION OF EGRESS. ALL DOORS SHALL HAVE LEVER TYPE HANDLES.
15. INTERIOR WALLS AND CEILINGS SHALL HAVE A FLAME SPREAD OF 0-200 AND A SMOKE DEVELOPMENT RATING OF 0-450.
16. ALL NEW WORK SHALL COMPLY WITH THE LATEST EDITION OF ALL LOCAL, STATE, AND NATIONAL CODES COVERING THE TYPE OF WORK BEING PERFORMED.
17. PROVIDE PORTABLE FIRE EXTINGUISHERS IN ACCORDANCE WITH NFPA 101, SEE APPENDIX "E" OF NFPA 101 FOR DISTRIBUTION OF EXTINGUISHERS.
18. ALL FIRE WALLS SHALL EXTEND TIGHT TO ROOF DECK AND BE SEALED WITH AN APPROVED FIRE CAULK.
19. ALL ELECTRICAL, MECHANICAL, AND PLUMBING MATERIALS PENETRATING FIRE WALLS SHALL BE FIRE CAULKED. (PENETRATIONS THROUGH RATED CONSTRUCTION SHALL BE SEALED WITH A MATERIAL CAPABLE OF PREVENTING THE PASSAGE OF FLAMES ANF HOT GASES WHEN TESTED IN ACCORDANCE WITH ASTM-E814.)
20. SERVICE COUNTERS SHALL HAVE AN ACCESSIBLE WRITING SURFACE IN COMPLIANCE WITH ADAAG ACCESSIBILITY GUIDELINES 2010, SECTION 902.3.

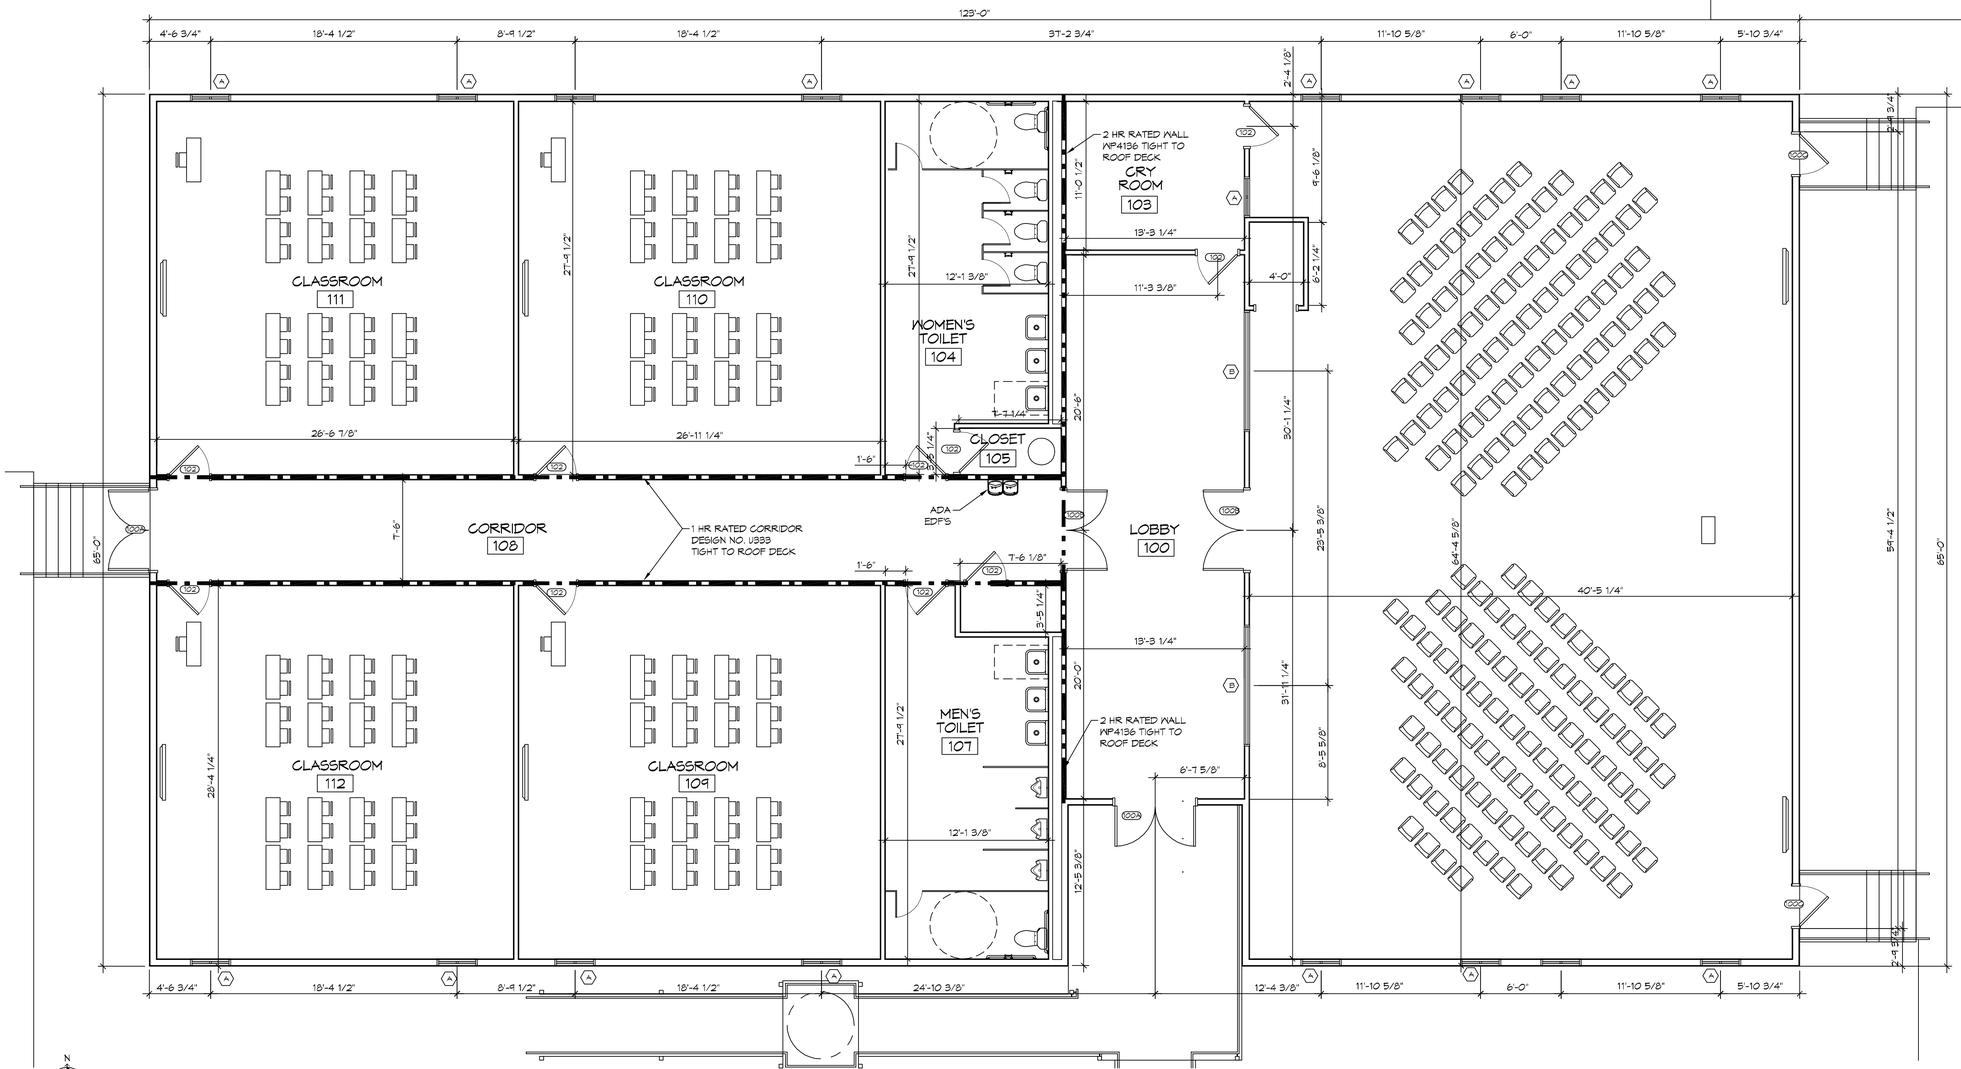

BEARING WALL RATING 1 HR. FINISH RATING-23 MIN.

DESIGN NO. U333 — 1 HOUR FIRE

1. WOOD STUDS:
   NOM 2" BY 4 IN., SPACED 16 IN. O.C. EFFECTIVELY CROSS BRACED.
2. GYPSUM BOARD:
   5/8 IN. (TYPICAL, 4 FT. WIDE, APPLIED EITHER VERTICALLY OR HORIZONTALLY. SCREW ATTACHED TO STUDS AND PLATES WITH 1 1/4 IN. LONG
   TYPE W STEEL SCREWS, SPACED 12 IN. O. C.
   AMERICAN GYPSUM CO.- TYPES GWB-C, ASHC.
   BPB AMERICA INC.- PRO-ROCK-C.
   CANADIAN GYPSUM COMPANY- TYPES C, IP-X2, IPC-AR.
   G-P GYPSUM CORP.- SUB. OF GEORGIA PACIFIC CORP.- TYPE S.
   LAFARGE NORTH AMERICA, INC.- TYPES LGFG-C, LGFC-CA.
   NATIONAL GYPSUM CO.- TYPES FSW-C, FSW-G.
   PABCO GYPSUM, DIV. OF PACIFIC COAST BUILDING PROD., INC.- TYPE C OR PG-C.
   STANDARD GYPSUM, LLC- TYPE SG-C.
   TEMPLE-INLAND FOREST PRODUCTS CORP.- TYPE TG-C.
   UNITED STATES GYPSUM CO.- TYPES C, IP-X2, IPC-AR.
   USG MEXICO S A DE C V.- TYPES C, IP-X2, IPC-AR.
3. BATTS AND BLANKETS, (OPTIONAL):
   MINERAL WOOL INSULATION, PARTIALLY OR COMPLETELY FILLING STUD CAVITY.
   THERMAFIBER LLC- TYPE SAFB.
   U. S. GREENFIBER LLC:
   AS AN ALTERNATE TO BATTS AND BLANKETS (ITEM 3); SPRAY APPLIED CELLULOSE INSULATION MATERIAL. THE FIBER IS APPLIED WITH WATER TO COMPLETELY FILL THE ENCLOSED CAVITY IN ACCORDANCE WITH THE APPLICATION INSTRUCTIONS SUPPLIED WITH THE PRODUCT. NOMINAL DRY DENSITY OF 3.0 LB/FT3.
   U. S. GREENFIBER LLC- COCOON STABILIZED CELLULOSE INSULATION.
   3A. FIBER, SPRAYED:*
   AS AN ALTERNATE TO BATTS AND BLANKETS (ITEM 3); AND ITEM 3A- SPRAY APPLIED CELLULOSE INSULATION MATERIAL. THE FIBER IS APPLIED WITH WATER TO INTERIOR SURFACES IN ACCORDANCE WITH THE APPLICATION INSTRUCTIONS SUPPLIED WITH THE PRODUCT. APPLIED TO COMPLETELY FILL THE ENCLOSED CAVITY. MINIMUM DRY DENSITY OF 4.3 POUNDS PER CUBIC FT.
   NU-WOOL CO., INC.- CELLULOSE INSULATION.
4. JOINTS AND NAILHEADS:
   WALLBOARD JOINTS COVERED WITH PAPER TAPE AND JOINT COMPOUND.

*BEARING THE UL CLASSIFICATION MARK.

GA FILE NO. WP 4136 GENERIC

BASE LAYER 5/8" TYPE X GYPSUM WALLBOARD OR VENEER BASE APPLIED PARALLEL OR AT RIGHT ANGLES TO EACH SIDE OF 2 X 4 WOOD STUDS 16" O.C. WITH 1 1/4" TYPE W DRYWALL SCREWS 12" O.C. FACE LAYER 5/8" TYPE X GYPSUM WALLBOARD OR VENEER BASE APPLIED PARALLEL OR AT RIGHT ANGLES TO EACH SIDE WITH 1 7/8" TYPE W DRYWALL SCREWS 12" O.C. AND OFFEST 6" FROM SCREWS IN BASE LAYER.

JOINTS STAGGERED 16" EACH LAYER AND SIDE. (LOAD BEARING)

2 HOUR FIRE 40 TO 44 STC SOUND

THICKNESS: 6 1/8"
APPROX. WEIGHT: 12 PSF
FIRE TEST: SWRI 01-5920-614, 12-5-94
SOUND TEST: SEE WP 4135 (NGC 2363, 4-1-70)

8 FLOOR PLAN
SCALE: 3/16"=1'-0"

DAMMON ENGINEERING, INC.
LOUISIANA & MISSISSIPPI
www.dammonengineering.com
info@dammonengineering.com
PH: 985.649.5832 F: 985.641.5950
Chief Engineer: Brian Mistich, PE
554 Old Spanish Trail
Slidell, LA 70458

REVISIONS

#	DESCRIPTION	DATE

THE CROSSING
64452 HIGHWAY 41
PEARL RIVER, LA 70452

The client shall hold and indemnify Dammon Engineering harmless against any claim or liability for any alterations made to these plans without the written approval of Dammon Engineering. Reproduction or publication of these plans, in whole or in part, without the written permission of Dammon Engineering is prohibited. Dammon Engineering shall not be liable for any damages resulting from such unauthorized publication or reproduction.

JOB No:	23594
DATE:	11/05/2019
DRAWN BY:	RLD
CHECKED BY:	JAS

SHEET TITLE: FLOOR PLAN

DRAWING NUMBER: A101

SHEET No: 5 of 13