GENERAL NOTES:

1. INSULATION AND INSULATION ASSEMBLES SHALL MEET THE REQUIREMENTS OF SECTION 718, INTERNATIONAL BUILDING CODE, 2006.
   A. CONCEALED INSULATION SHALL HAVE A FLAME SPREAD OF NOT MORE THAN 25 AND A SMOKE DEVELOPED INDEX OF NOT MORE THAN 450.
   B. FACING SHALL COMPLY WITH IBC 718.2.1.
2. PROVIDE 5'X5' LANDINGS OUTSIDE EXTERIOR DOOR LEVEL WITH THE FLOOR. THRESHOLDS SHALL BE NOT MORE THAN 1/2" IN HEIGHT AND SHALL BE BEVELED IF MORE THAN 1/4". ALL GROUND AND FLOOR SURFACES SHALL BE NON SLIP.
3. DIMENSIONS ARE TO CENTER LINE OR FACE OF STUDS, CENTER LINES OF COLUMNS OR FACE OF VINYL.
4. CONTRACTOR TO VERIFY ALL SITE CONDITIONS AND ALL DIMENSIOINS PRIOR TO CONSTRUCTION.
5. MATERIALS SHALL BE NEW AND U.L. LISTED.
6. NO WORK SHALL BE CONCEALED UNTIL APPROVED BY LOCAL INSPECTORS.
7. CONSTRUCTION SHALL COMPLY WITH ALL CITY, STATE AND LOCAL CODES.
8. CONTRACTOR TO GUARANTEE WORK FOR ONE YEAR.
9. CONTRACTOR SHALL FURNISH WATER AND POWER FROM EXISTING SOURCES.
10. EXTERIOR CAULKING SHALL BE THIOKAL CAULK.
11. PAINT GRADE TO BE SHERWIN WILLIAMS OR EQUIVALENT. ALL WORK TO RECEIVE 2 COATS.
12. PROVIDE CLEANUP ON A REGULAR BASIS. NO TRASH STORED IN BUILDING.
13. ALL BATT INSULATION SHALL HAVE A CLASS "A" (0-25) FLAME SPREAD IN COMPLIANCE WITH APPLICABLE CODE.
14. USE 6" STUDS AT ALL PLUMBING WALLS.
15. PROVIDE GAL. METAL PAN WITH DRAIN AT WATER HEATER LOCATION.
16. ALL CORNERS SHALL BE PROPERLY BRACED FOR WIND LOADS. A 48" SHEATHING SHALL BE PROVIDED EVERY 20 FEET OF WALL LENGTH.
17. FLOORING SHALL BE NON-SLIP.
18. LOCKS ON DOORS IN MEANS OF EGRESS SHALL NOT REQUIRE THE USE OF A KEY (INTERIOR SIDE), SPECIAL DEVICE OR SPECIAL KNOWLEDGE TO OPEN IN THE DIRECTION OF EGRESS. ALL DOORS SHALL HAVE LEVER TYPE HANDLES.
19. INTERIOR WALLS AND CEILINGS SHALL HAVE A FLAME SPREAD OF 0-200 AND A SMOKE DEVELOPMENT RATING OF 0-450.
20. ALL WORK SHALL COMPLY WITH THE LATEST EDITION OF ALL LOCAL STATE AND NATIONAL CODES THAT COVER THE SECTION OF WORK BEING PERFORMED.
21. PROVIDE PORTABLE FIRE EXTINGUISHERS IN ACCORDANCE WITH NFPA 10. SEE APPENDIX "E" OF NFPA 10 FOR DISTRIBUTION OF EXTINGUISHERS.
22. ALL FIRE WALLS SHALL EXTEND TIGHT TO ROOF SHEATHING & SEALED WITH APPROVED FIRE CAULK. CONTRACTOR TO VERIFY.
23. ALL ELECTRICAL, MECHANICAL & PLUMBING PENETRATING FIRE PARTITIONS SHALL BE FIRE CAULKED. (PENETRATIONS THROUGH RATED CONSTRUCTION SHALL BE SEALED WITH A MATERIAL CAPABLE OF PREVENTING THE PASSAGE OF FLAMES AND HOT GASES WHEN TESTED IN ACCORDANCE WITH ASTM-E814.)

DETAILED BUILDING REQUIREMENTS

(MAIN WIND FORCE RESISTING COMPONENTS)

- THE DESIGN, FABRICATION AND ERECTION OF STRUCTURAL STEEL FOR BUILDINGS AND STRUCTURES SHALL BE IN ACCORDANCE WITH EITHER THE AISC LOAD AND RESISTANCE FACTOR DESIGN SPECIFICATION FOR STRUCTURAL STEEL BUILDINGS (AISC-LRFD), AISC SPECIFICATION FOR STRUCTURAL STEEL BUILDINGS-ALLOWABLE STRESS DESIGN (AISC-ASD) OR AISC SPECIFICATION FOR THE DESIGN OF STEEL HOLLOW STRUCTURAL SECTIONS (AISC-HSS). WIND LOAD DESIGN OF 130 MPH.
- ROOF COVERING SHALL BE DESIGNED IN ACCORDANCE WITH THE REQUIRMENTS SET FORTH IN IBC SECTION 1507
- VINYL SIDING SHALL CONFORM TO THE REQUIREMENTS OF ASTM D3679 (IBC 1404.9)
- 1609.1.4 PROTECTION OF OPENINGS
- 7/16" THICK STRUCTURAL WOOD PANELS AND ATTACHMENT HARDWARE SHALL BE PROVIDED FOR BUILDING OCCUPANCY THE PANELS SHALL BE NUMBERED FOR EACH GLAZED OPENING AND SHALL BE STORED ON SITE PERMANENTLY (IBC 1609.1.4, EXCEPTION)

CONTRACTOR NOTE!
EACH CONTRACTOR RESPONSIBLE FOR THE CONSTRUCTION OF A MAIN WIND-FORCE-RESISTING COMPONENT OF THIS BUILDING SHALL SUBMIT A A WRITTEN CONTRACTOR'S STATEMENT OF RESPONSIBILITY TO THE BUILDING OFFICIAL AND OWNER PRIOR TO COMMENCEMENT OF THE WORK ON THAT COMPONENT. (IBC 1706.3)

DOOR & HARDWARE SCHEDULE

NO.	SIZE	TYPE: RAISED PNL. MAS.	TYPE: HOLLOW METAL	TYPE: ALUM.	TYPE: VERT. ROLLING	TYPE: FOLDING	FRAME: STEEL	FRAME: ALUMINUM	FRAME: WOOD	FRAME: CASED OPENING	HINGE: DBL. SWING	HINGE: BUTT	HINGE: BURGLERPRF	LOCK: ROLL UP	LOCK: PASSAGE	LOCK: PRIVACY	LOCK: DEADBOLT	LOCK: KEYED HANDLE	ACCESSORIES: PUSH PULL	ACCESSORIES: PANIC	ACCESSORIES: THRESHOLD	ACCESSORIES: WEATHERSTRIP	ACCESSORIES: DOOR STOP	ACCESSORIES: FULL GLASS	ACCESSORIES: CLOSER	RATINGS	REMARKS
1	3/0x7/0		●				●	●				●						●	●		●	●			●		EXTERIOR
2	3/0x7/0	●					●					●						●									•
3	3/0X7/0	●					●					●						●							●		
4	2/8x7/0	●					●					●						●									
5	3/0x7/0	●					●					●						●			●				●	1-1/2 HR.	EXTERIOR
6	3/0x7/0	●					●					●						●			●	●			●		EXTERIOR
7	10/0x14/0	●																●									GARAGE DOOR

ROOM FINISH SCHEDULE

NAME	FLOOR: CARPET	FLOOR: CONC.	FLOOR: TILE	FLOOR: VCT	BASE: WOOD BASE	BASE: CERAMIC TILE	BASE: VINYL BASE	BASE: NONE	WALL: GYP.BD	WALL: STRUCT. W/FIL. MSNA	WALL: CERAMIC TILE	WALL: CEMENT. BD.	WALL: WAINSCOAT	CEILING: LAY-IN ACOUST.	CEILING: 5/8" GYP.BD.	CEILING: STRUCT. W/FIL. MSNA	CLG. HGT.	REMARKS
ENTRY-HALL				●			●		●					●			9'-0"	
LINDA'S OFFICE	●						●		●					●			9'-0"	
DISPATCH	●						●		●					●			9'-0"	
BREAKROOM				●			●		●					●			9'-0"	
H/C MENS REST.				●			●		●						●		9'-0"	
H/C WOMENS REST.				●			●		●						●		9'-0"	
WAREHOUSE		●						●		●						●	OPEN	

WINDOW SCHEDULE

MK	SIZE	TYPE: FIXED	TYPE: VERT. SLIDE	TYPE: HORIZ. SLIDE	TYPE: CIRCLEHEAD	FRAME: STEEL	FRAME: VINYL	FRAME: WOOD	GLASS: TINTED	GLASS: PLAIN	GLASS: INSULATED	GLASS: WIRED GLASS	LITES: 2/2	LITES: 15 LITES	LITES: 9 LITES	LITES: NONE	ACCESS.: SCREEN	ACCESS.: SHUTTER	ACCESS.: NONE	ACCESS.: ALARM	REMARKS: MAX. U-FACTOR
A	3'-0"x4'-0"	●					●			●						●			●		.45

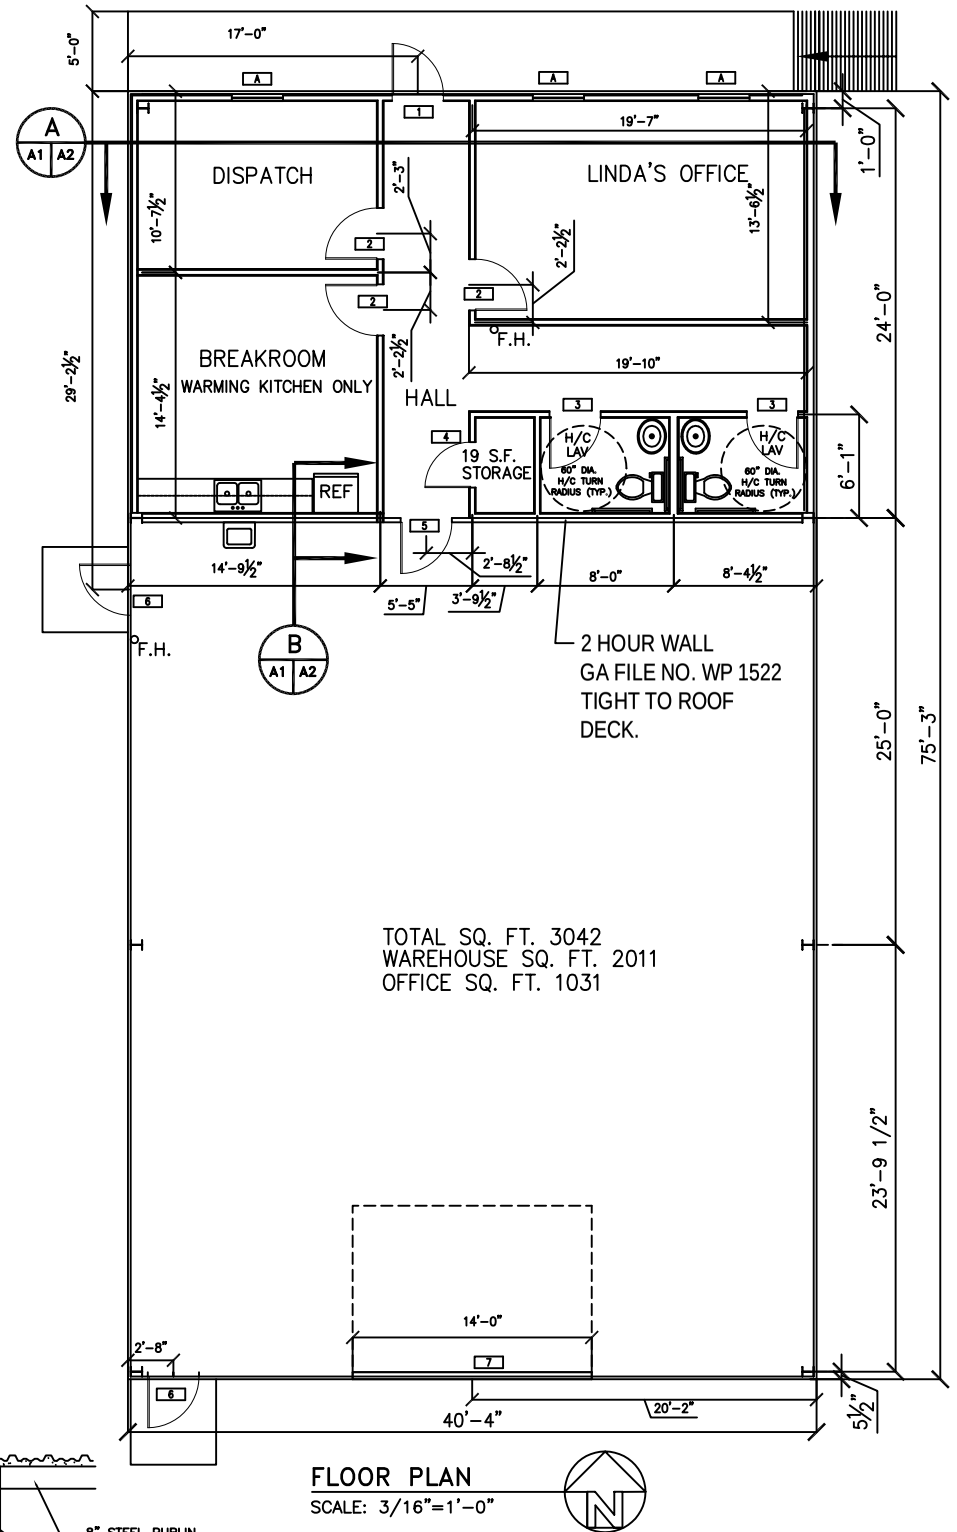

FLOOR PLAN
SCALE: 3/16"=1'-0"

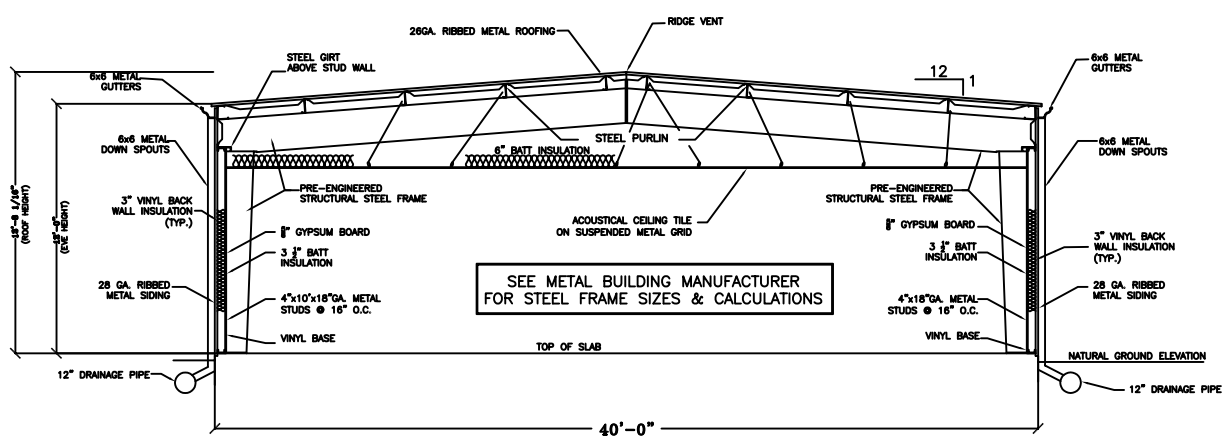

SECTION A (A1 | A2)
N.T.S.

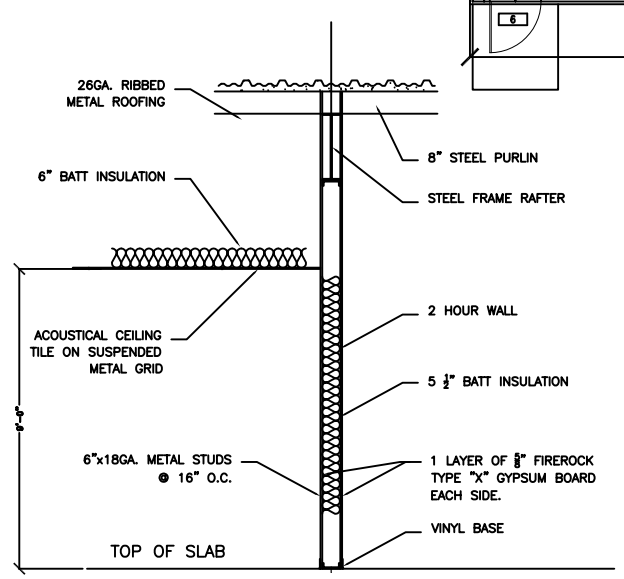

TYP. SECTION B (A1 | A2)
N.T.S.

DAMMON ENGINEERING, INC.
1095 FLORIDA AVENUE 985-649-5832 SLIDELL, LA. 70458
DAMMONENGINEERING.COM

PARISH CAB
1189 FREMAUX AVENUE
SLIDELL, LOUISIANA

FLOOR PLAN

PARISH CAB

SCALE:AS NOTED
FILE:
JOB NO.1847
DATE:3-17-07
SHEET A-1
OF