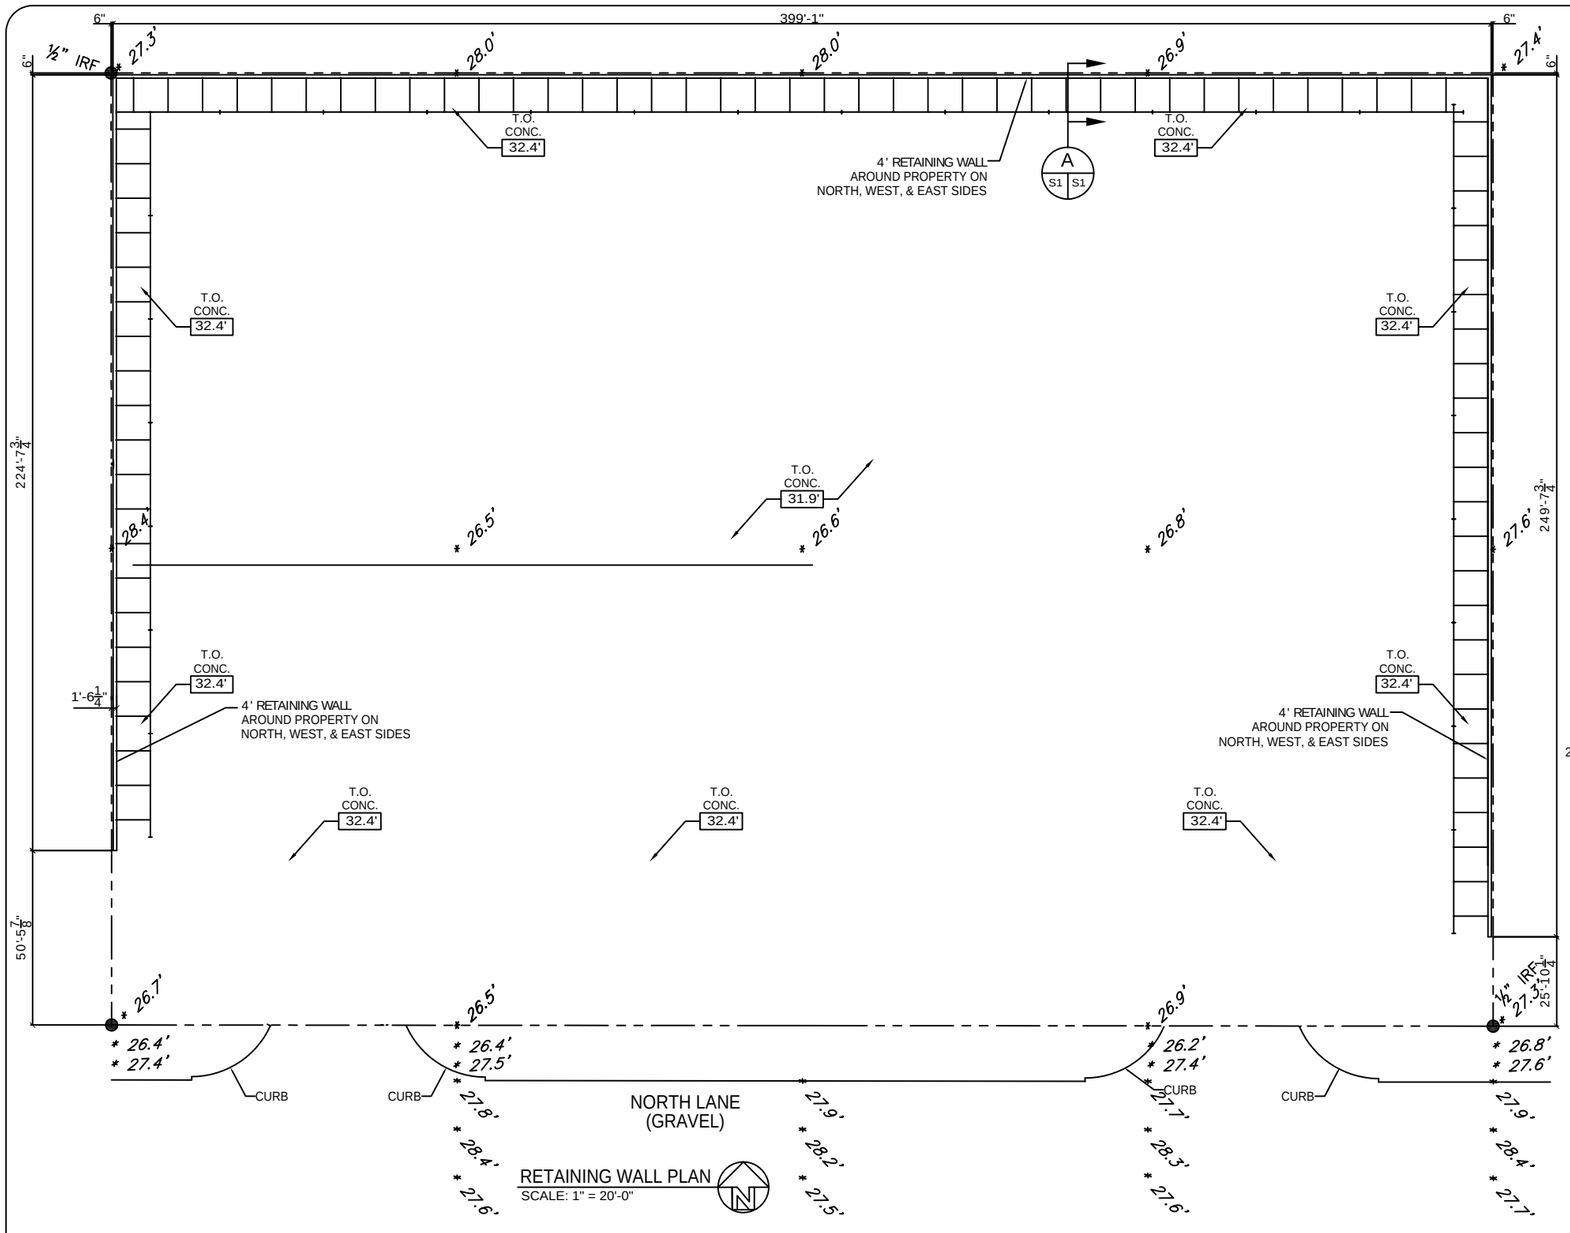

NOTES:

1. CONTRACTOR SHALL FIELD VERIFY ALL DIMENSIONS, DEPRESSIONS PRIOR TO COMMENCING WORK.
2. COMPACT EXISTING FILL TO 95% OF THE MAXIMUM DRY DENSITY DETERMINED BY ASTM D 698, STANDARD PROCTOR.
3. TREAT SOIL BELOW SLAB FOR TERMITES UNDER BUILDINGS.
4. CONCRETE MIX SHALL BE 3000 PSI. MINIMUM.
5. MUCK OUT 24" DEEP FOR FOUNDATION PLAN MINIMUM

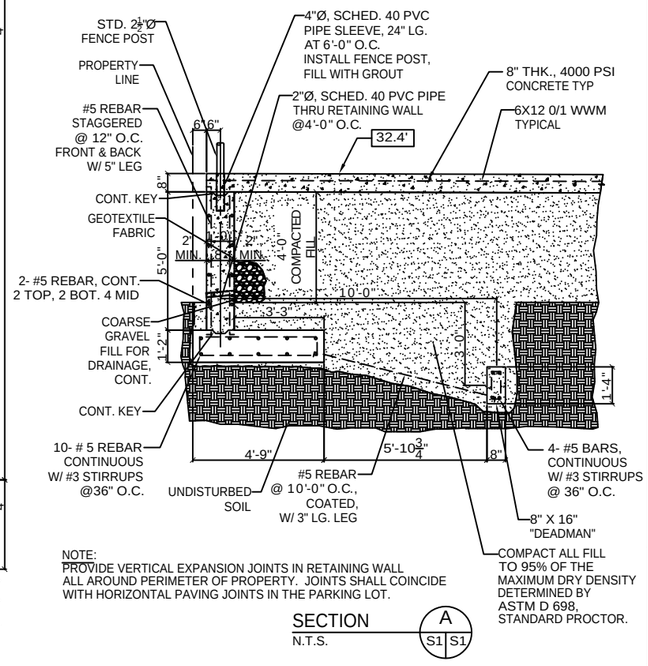

NOTE:
PROVIDE VERTICAL EXPANSION JOINTS IN RETAINING WALL ALL AROUND PERIMETER OF PROPERTY. JOINTS SHALL COINCIDE WITH HORIZONTAL PAVING JOINTS IN THE PARKING LOT.

SECTION A
S1 S1
N.T.S.

LEGEND

- PROPERTY LINE
- NEW RETAINING WALL OUTLINE
- 6' CHAIN LINK FENCE
- "DEADMAN", 30'-0" LG. W/ 3 #5 REBAR TIES @10'-0" O.C.

DAMMON
ENGINEERING, INC.

CHIEF ENGINEER
EMMETT
DAMMON, P.E.

CHIEF ARCHITECT
ROBERT
WILTSE

1095 FLORIDA AVENUE
SLIDELL, LA. 70458
OFFICE: 985-649-5832
FAX: 985-641-5950

WEBSITE:
WWW.DAMMONENGINEERING.COM

EMAIL:
DAMMONENG@BELLSOUTH.NET

ARCHITECTURE

ENGINEERING

STUDIES

PLANNING

INVESTIGATION

EXPERT WITNESS

NEW FACILITY

STANDARD MATERIALS
1601 NORTH LANE
MANDEVILLE, LA

RETAINING WALL PLAN

REV:

SCALE: AS NOTED

JOB#: 1906

DATE: 01-09-09

SHEET

S-1

OF