


PLUMBING FIXTURE SCHEDULE


FIXTURE	DESCRIPTION
WATER CLOSET - "WC"	SEE WOODHOUSE SPECIFICATION; ALTO 137-160.
LAVATORY - "LAV"	SEE WOODHOUSE SPECIFICATION; KOHLER K2196.
FACIAL VANITY - "FV"	SEE WOODHOUSE SPECIFICATION; PORTLAND SINGLE VANITY.
VINATAGE TUB "TUB"	SEE WOODHOUSE SPECIFICATION; 67" VICTORIAN ACRYLIC SLIPPER TUB.
ECHO FOOT SPA "EFS"	SEE WOODHOUSE SPECIFICATION; CONTINUUM ECHO FOOT SPA. FOLLOW MANUFACTURER'S PLACEMENT OF FLOOR SINK.
BAR SINK	SEE WOODHOUSE SPECIFICATION; B155-2.
TWO COMP SINK "2CS"	SEE WOODHOUSE SPECIFICATION; MIDDLETON DOUBLE-BASIN SINK.
DISHWASHER	SEE WOODHOUSE SPECIFICATION; FRIGIDAIR 24" BUILT-IN DISHWASHER.
ICE MAKER	SEE WOODHOUSE SPECIFICATION; WHIRLPOOL GOLD 15" ICE MAKER.
UTILITY SINK - "US"	SEE WOODHOUSE SPECIFICATION; DURATONE HOSPITALITY/UTILITY SINK.
WATER HEATER - "WH"	3" ZURN # ZN-415 W/TRAP PRIMER.
FLOOR DRAIN - "FD"	EQUAL TO ZURN MODEL Z-1900-3; PROVIDE AIR GAP FOR INDIRECT CONNECTION.
FLOOR SINK - "FS"	EQUAL TO WATT'S NO. 909QT; CONFIRM MODEL # 15 APPROVED BY LOCAL AUTHORITY PRIOR TO INSTALLATION. ASSE 1013 VERTICAL INSTALLATION APPROVED REDUCED PRESSURE ZONE BACK-FLOW PREVENTER. PROVIDE WITH STRAINER.
BACK-FLOW PREVENTER	

PLUMBING SITE NOTES:

1. IT IS THE RESPONSIBILITY OF THIS CONTRACTOR TO FIELD VERIFY ALL SITE CONDITIONS PRIOR TO STARTING ANY PHASE OF CONSTRUCTION. ANY CHANGES OR COSTS NOT SHOWN ON THESE DRAWINGS SHALL BE BROUGHT TO THE ATTENTION OF THE ARCHITECT, ENGINEER.
2. ALL EXISTING UTILITIES SHOWN ON THIS PLAN ARE ASSUMED TO BE CORRECT. IT IS THE RESPONSIBILITY OF THIS CONTRACTOR TO PROPERLY VERIFY ALL UNDERGROUND UTILITIES.
3. KEEP ALL CUTTING AND PATCHING TO A MINIMUM.
4. IT IS RECOMMENDED THAT THE SUBCONTRACTOR ARRANGE A PRE-JOB CONFERENCE WITH THE CONSTRUCTION SUPERVISOR FOR REVIEW & CLARIFICATION PRIOR TO STARTING ANY WORK.

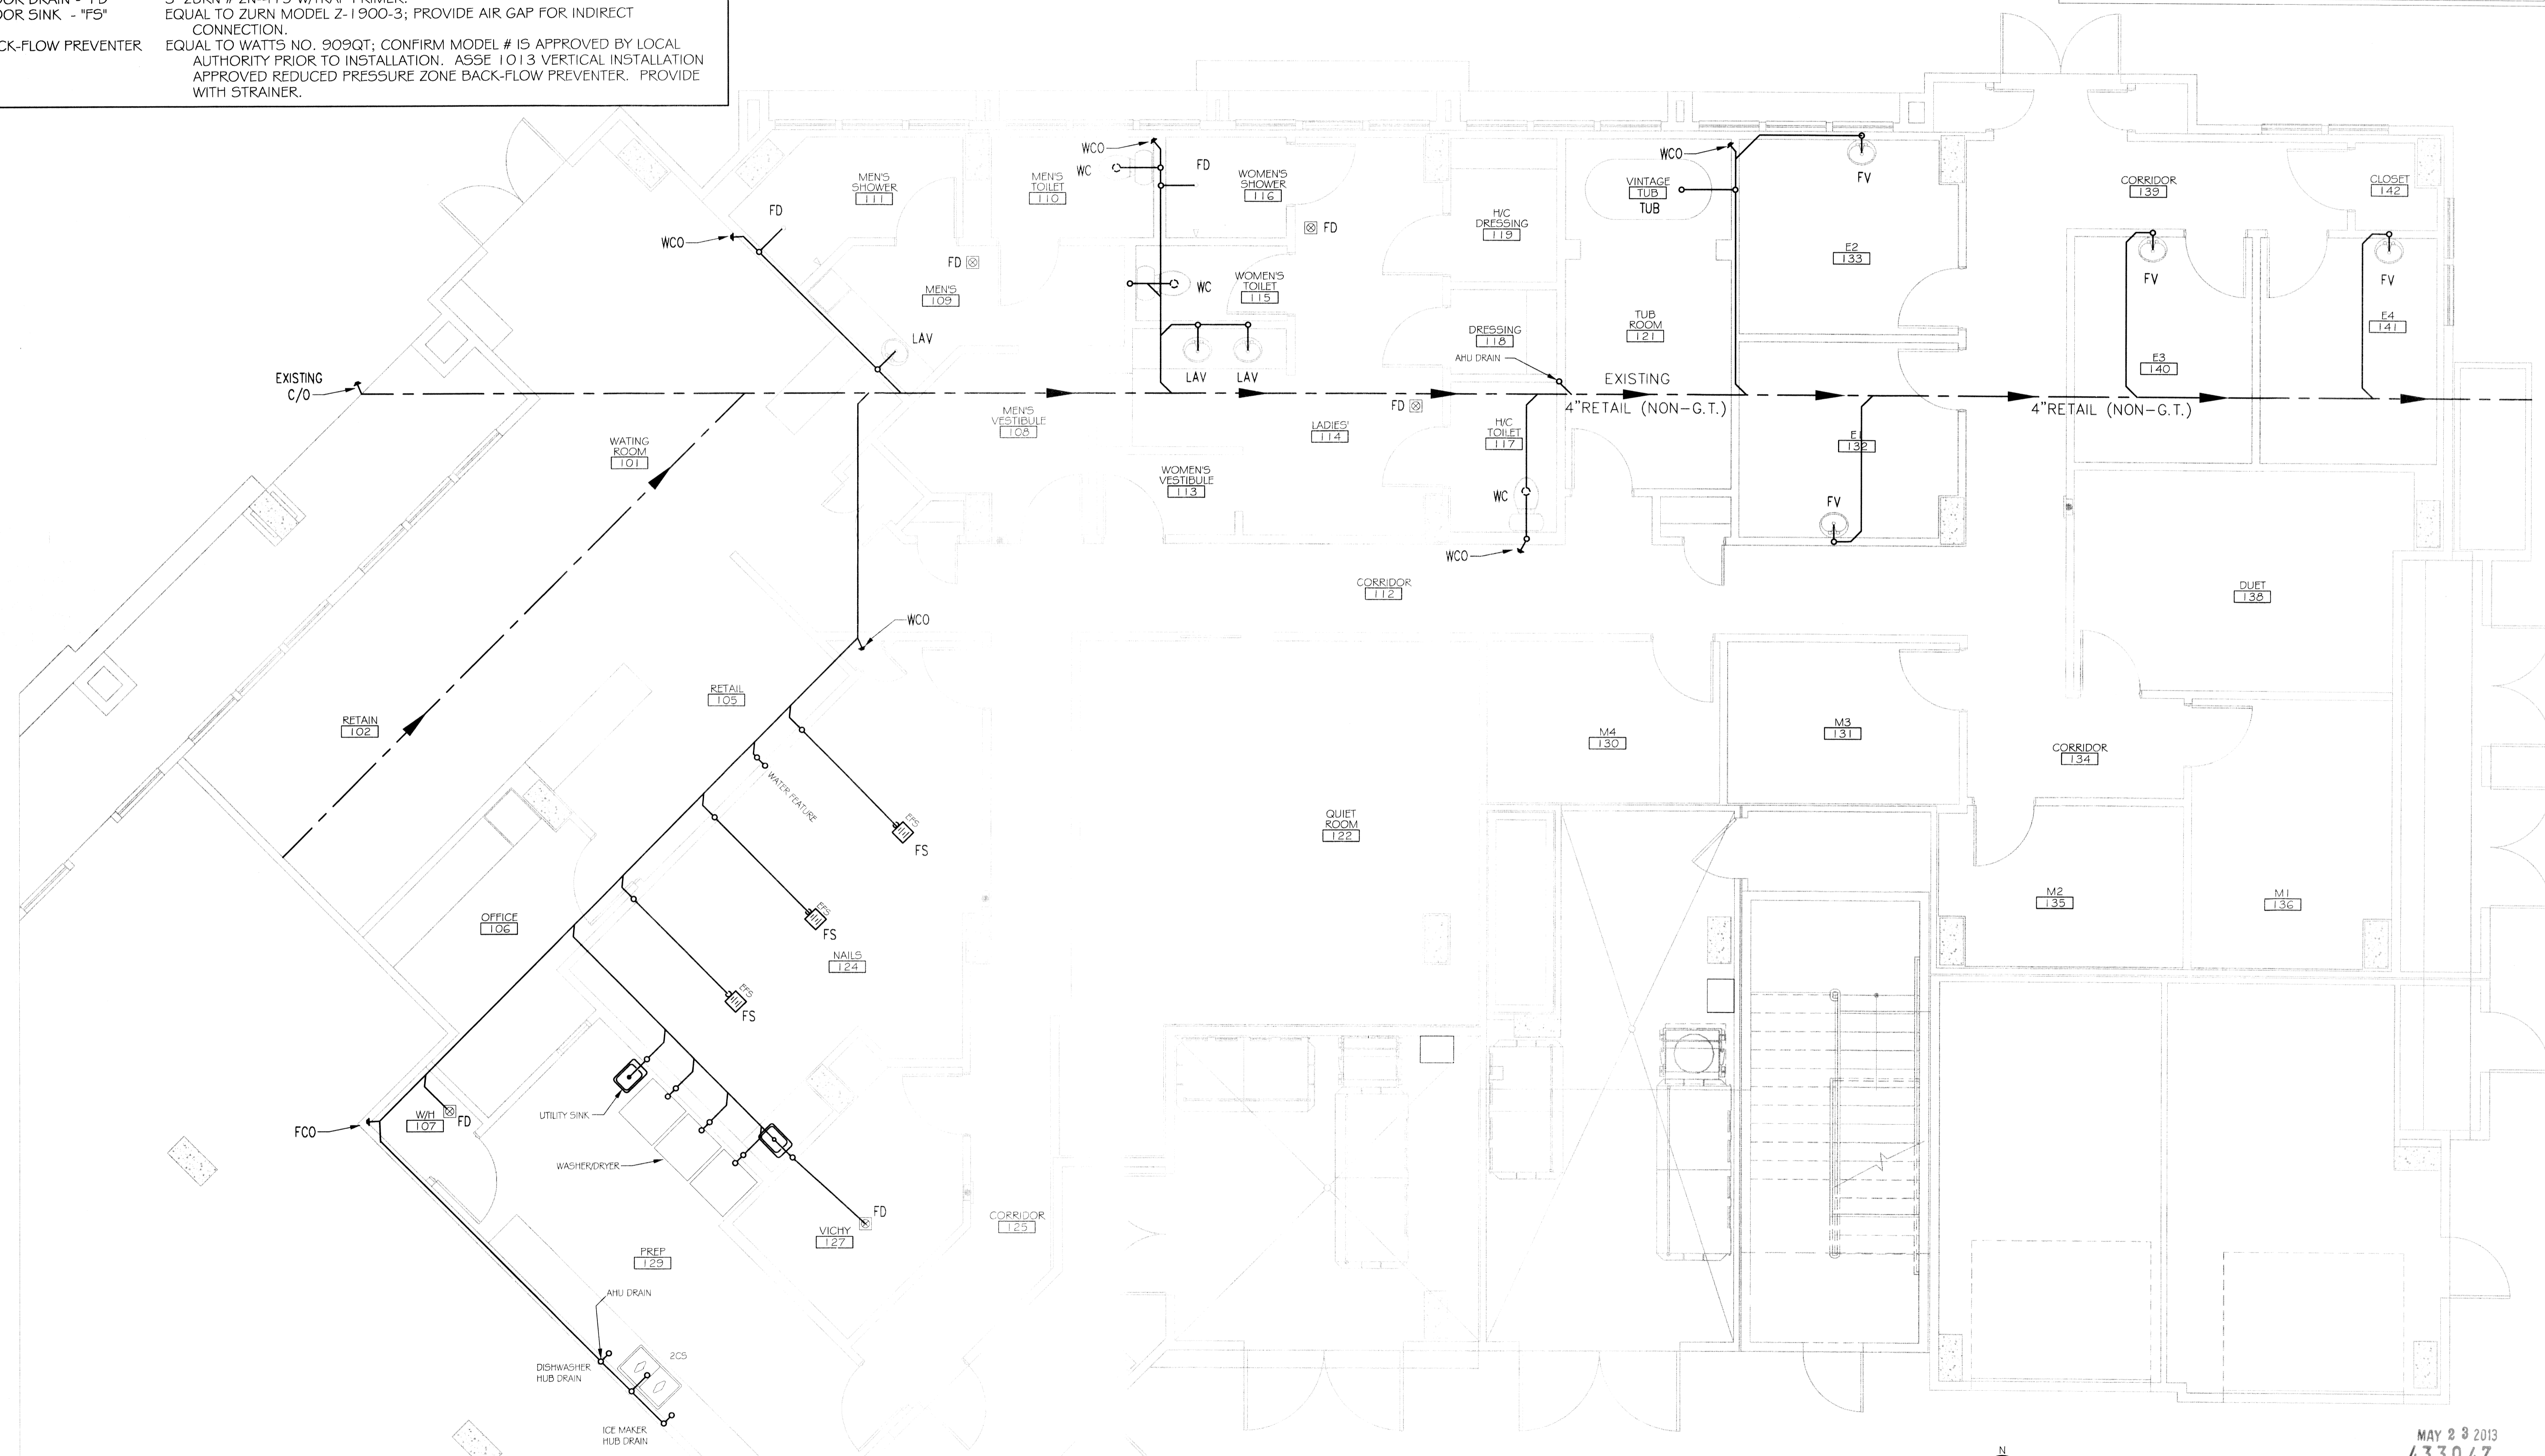

THIS PLAN IS DRAWN DIAGRAMMATICALLY
FIELD VERIFY PRIOR TO CONSTRUCTION


SANITARY SEWER PLAN
 SCALE: 1/4" = 1'-0"

MAY 23 2013
433047
 REVIEWED FOR
 STATE FIRE MARSHAL
 AS PER REVIEW LETTER
 BY JAMES T. BLOOMER

DAMMON
 ENGINEERS & ARCHITECTS
 ARCHITECTS & ENGINEERS
 CHIEF ENGINEER: EMMETT DAMMON, P.E.
 CHIEF ARCHITECT: KEVIN KINCHEN
 554 OLD SPANISH TRAIL
 SUITE LL, LA 70456
 PHONE: 985-649-5632
 FAX: 985-641-5950
 dammoneng.com
 dammoneng@bellsouth.net

WOODHOUSE SPA
 THE HIGH GROVES APARTMENTS
 BATON ROUGE, LA

JOB No:	2163	DATE:	5/14/2013	CHECKED BY:	KJK
DRAWN BY:	JCT				

#	DESCRIPTION	DATE

STATE OF LOUISIANA
 PROFESSIONAL ENGINEER
 IN
 MECHANICAL ENGINEERING
 5/15/2013

SANITARY SEWER PLAN
 SHEET No: 12 OF 15
P-1