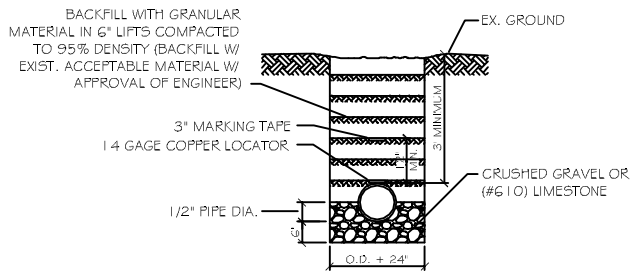

NOTE: A MINIMUM 10' HORZ. AND 18" VERT. SEPARATION (WITH WATER MAIN ON TOP)IS REQUIRED BETWEEN WATER AND SEWER LINES.

PIPE MAIN BEDDING DETAIL FOR SEWER AND WATER

SCALE: N.T.S.

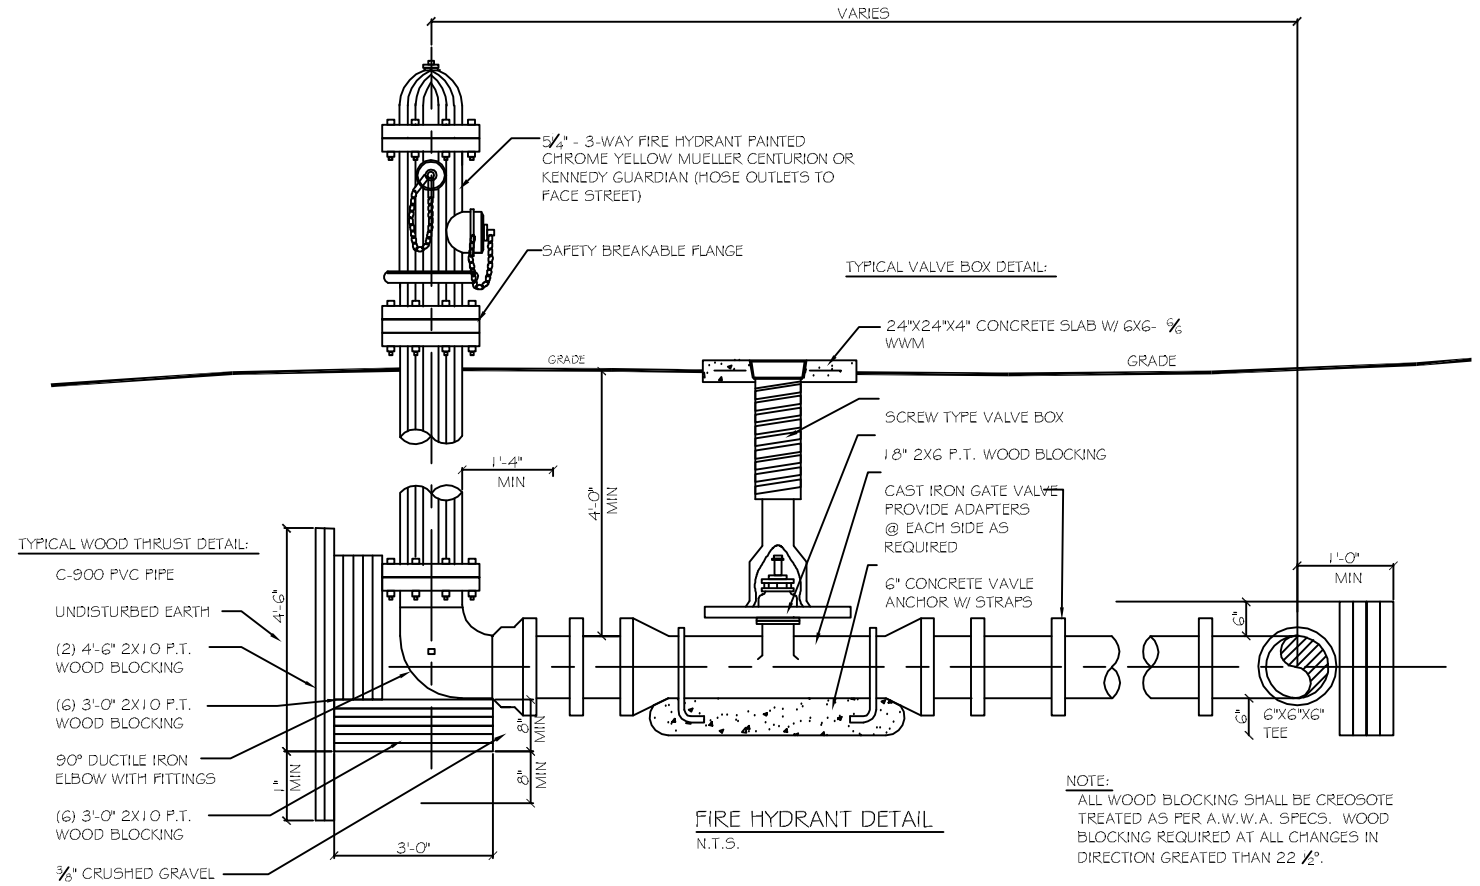

NOTE:
ALL WOOD BLOCKING SHALL BE CREOSOTE TREATED AS PER A.W.W.A. SPECS. WOOD BLOCKING REQUIRED AT ALL CHANGES IN DIRECTION GREATED THAN 22 ½°.

FIRE HYDRANT DETAIL

N.T.S.

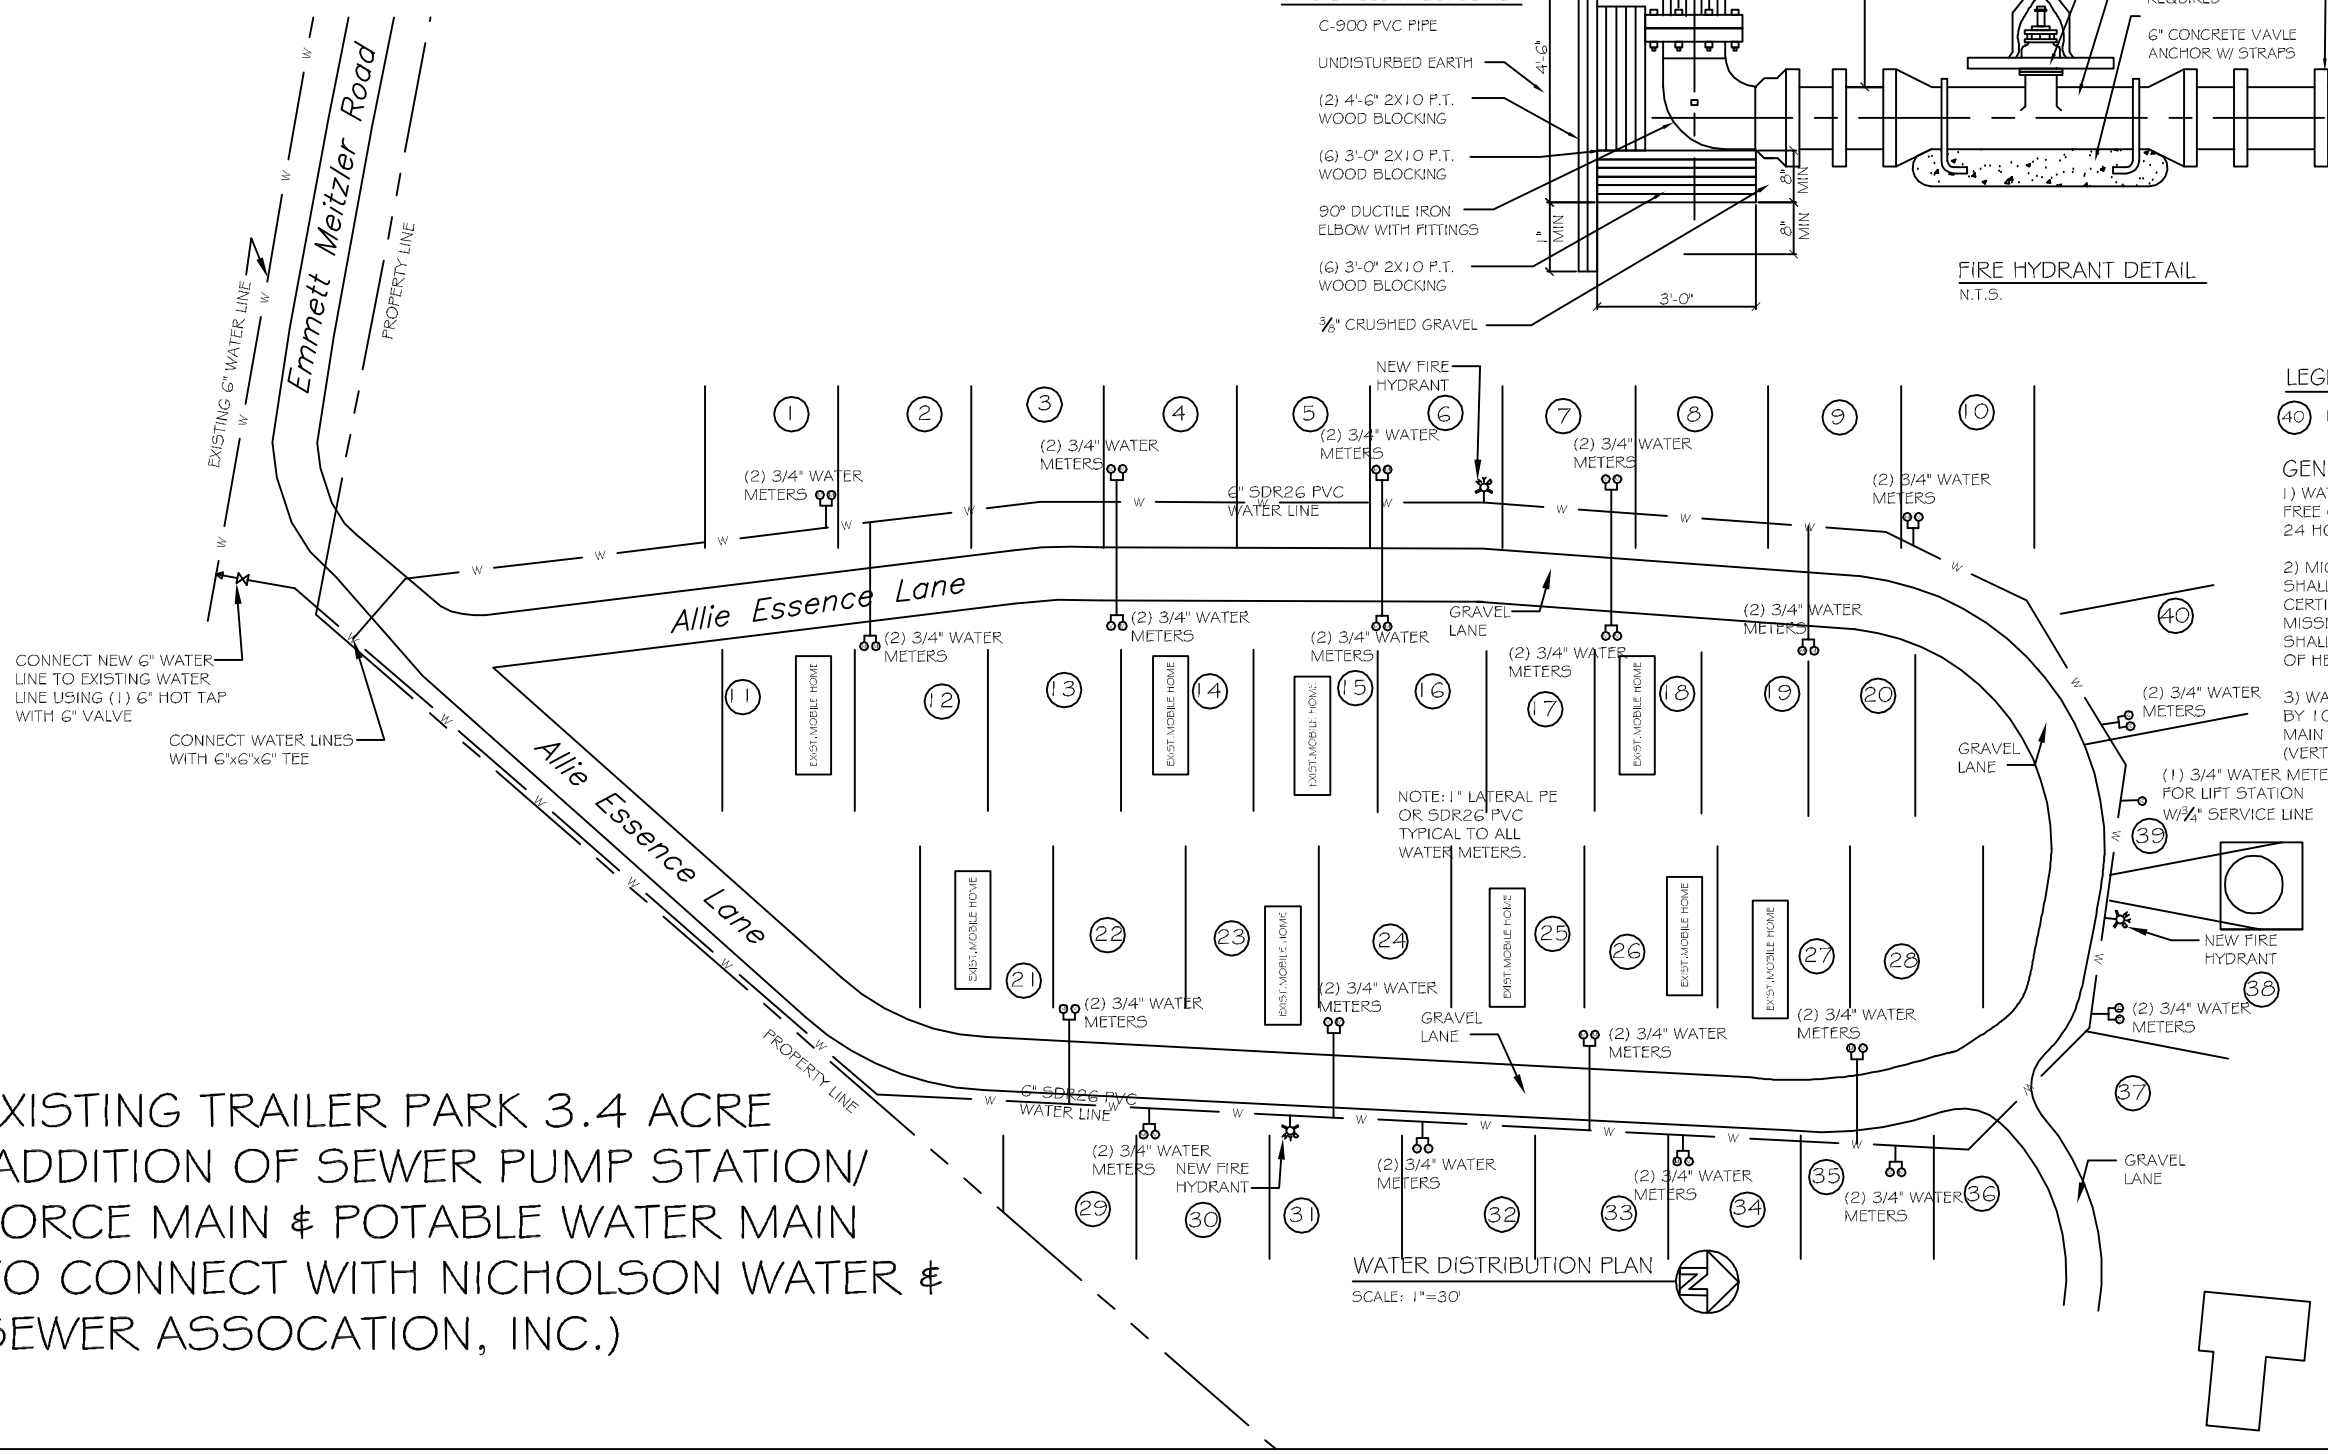

WATER DISTRIBUTION PLAN

SCALE: 1"=30'

LEGEND:

(40) DENOTES TRAILER COUNT

GENERAL NOTE:

1) WATER MAIN SHALL BE DISINFECTED USING A 50MG/L FREE CHLORINE RESIDUAL FOR A CONTACT TIME FOR 24 HOURS.

2) MICROBIOLOGICAL SAMPLES, FROM THE WATER MAINS SHALL BE COLLECTED BY THE REGISTERED ENGINEER, CERTIFIED OPERATOR OR A REPRESENTATIVE OF THE MISSISSIPPI STATE DEPARTMENT OF HEALTH. THE SAMPLES SHALL BE ANALYZED BY THE MISSISSIPPI STATE DEPARTMENT OF HEALTH OR A LABORATORY CERTIFIED BY THE STATE.

3) WATER MAIN SHALL BE SEPERATED FROM SEWER MAINS BY 10' WHEN RUNNING PARREL (HORIZONTALLY) AND WATER MAIN SHALL BE INSTALLED 18" ABOVE THE SEWER MAIN (VERTICALY).

EXISTING TRAILER PARK 3.4 ACRE (ADDITION OF SEWER PUMP STATION/ FORCE MAIN & POTABLE WATER MAIN TO CONNECT WITH NICHOLSON WATER & SEWER ASSOCATION, INC.)

DAMMON ENGINEERING, INC.
Architects & Engineers
dammonengineering.com
dammonengineering@bellsouth.net
PHONE: 985-641-5932
FAX: 985-641-9950
CHIEF ENGINEER: BRIAN MISTICH, P.E.
CHIEF ARCHITECT: KEVIN KINCHEN
5554 OLD SPANISH TRAIL
SLIDELL, LA 70458

THIS REPORT, MAPS, AND EXHIBITS ARE AN INSTRUMENT OF SERVICE AND ARE THE PROPERTY OF DAMMON ENGINEERING, INC. THEY ARE NOT TO BE USED FOR ANY OTHER PURPOSE OR PROJECT THAN THE ONE FOR WHICH THEY WERE PREPARED WITHOUT THE WRITTEN CONSENT OF DAMMON ENGINEERING, INC. THE DATA, FILES, REPORTS, DRAWINGS, MAPS, AND EXHIBITS ARE TO BE RETURNED TO DAMMON ENGINEERING, INC. UPON REQUEST.

DREAMLAND MOBILE HOME PARK
ALLIE ESSENCE LANE
NICHOLSON, MISSISSIPPI

JOB No: 2182	DATE: 05-19-2014
DRAWN BY: CKD	CHECKED BY: BM

#	DESCRIPTION	DATE

REVISIONS

WATER DISTRIBUTION PLAN

SHEET No: 04 OF 04

C3