


1 TENANT FLOOR PLAN  
SCALE: 1/8\"/>

**GENERAL NOTES**


1. INSULATION AND INSULATION ASSEMBLIES SHALL MEET THE REQUIREMENTS OF SECTION 714
- A. CONCEALED INSULATION SHALL HAVE A FLAME SPREAD OF 0-25 AND SMOKE DEVELOPED INDEX OF 0-450 EXCEPT THAT IN COMBUSTIBLE (WOOD FRAME) CONSTRUCTION.
- B. FACING SHALL COMPLY WITH IBC 2006.
2. CONTRACTOR TO VERIFY ALL SITE CONDITIONS AND DIMENSIONS PRIOR TO CONSTRUCTION.
3. MATERIALS SHALL BE NEW AND UL LISTED.
4. NO WORK SHALL BE CONCEALED UNTIL APPROVED BY LOCAL AUTHORITIES HAVING JURISDICTION.
5. CONSTRUCTION SHALL COMPLY WITH ALL PARISH, STATE, AND LOCAL CODES.
6. CONTRACTOR TO GUARANTEE ALL NEW WORK FOR A PERIOD OF ONE YEAR FROM THE DATE OF SUBSTANTIAL COMPLETION.
7. CONTRACTOR SHALL FINISH WATER AND POWER FROM EXISTING SOURCES.
8. ANY EXTERIOR CAULKING SHALL BE THICK CAULK.
9. PAINT GRADE TO SHALL BE SHERWIN-WILLIAMS OR EQUIVALENT. ALL WORK TO RECEIVE 3 COATS (ONE COAT PRIMER AND TWO FINISH COATS). COLORS TO BE SELECTED BY OWNER.
10. PERFORM SITE CLEANUP ON A WEEKLY BASIS. NO TRASH STORED IN BUILDING.
11. ALL BATT INSULATION SHALL HAVE A CLASS "A" (0-25) FLAME SPREAD IN COMPLIANCE WITH APPLICABLE CODE.
12. USE 6\"/>
- 13. PROVIDE GALVANIZED METAL SAFE PAN WITH DRAIN AT BELOW WATER HEATER.
- 14. ALL EXTERIOR BUILDING CORNERS SHALL BE PROPERLY BRACED FOR WIND LOADS. A 48\"/>
- 15. INTERIOR LOCKS ON DOORS IN MEANS OF EGRESS SHALL NOT REQUIRE THE USE OF A KEY, SPECIAL KNOWLEDGE, OR SPECIAL DEVICE TO OPEN IN THE DIRECTION OF EGRESS.
- 16. ALL DOORS SHALL HAVE LEVER TYPE HANDLES.
- 17. INTERIOR WALLS AND CEILING SHALL HAVE A FLAME SPREAD OF 0-200 AND A SMOKE DEVELOPMENT RATING OF 0-450.
- 18. ALL WORK SHALL COMPLY WITH THE LATEST EDITION OF ALL LOCAL, STATE, AND NATIONAL CODES COVERING THE TYPE OF WORK BEING PERFORMED.
- 19. PROVIDE PORTABLE FIRE EXTINGUISHERS IN ACCORDANCE WITH NFPA 101. SEE APPENDIX "E" OF NFPA 101 FOR DISTRIBUTION OF EXTINGUISHERS.
- 20. ALL EXTERIOR PARTITIONS SHALL EXTEND TIGHT TO ROOF PEAK AND EXTERIOR WALLS AND BE SEALED WITH AN APPROVED FIRE CAULK.
- 21. ALL ELECTRICAL, MECHANICAL, AND PLUMBING MATERIALS THROUGH RATED CONSTRUCTION SHALL BE SEALED WITH AN APPROVED CAPABLE OF PREVENTING THE PASSAGE OF FLAMES AND HOT GASES WHEN TESTED IN ACCORDANCE WITH ASTM-E814.

**NOTES**

**KEYNOTES**

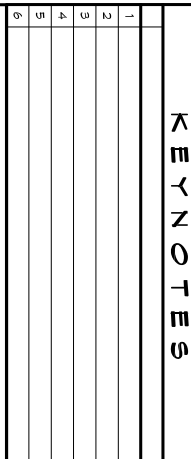

**DOOR AND FRAME TYPES**

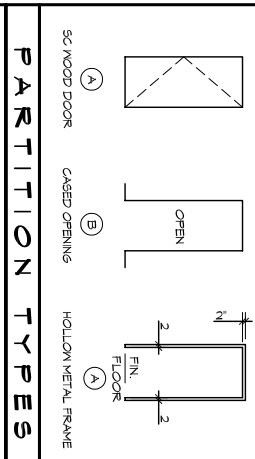

**PARTITION TYPES**

GA FILE NO. WP 1072  
 ONE LAYER 5/8\"/>

**DAMMON ENGINEERING, INC.**  
*Architects & Engineers*  
 Chief Architect: Kevin J. Kinchen, NCBAB  
 Chief Engineer: Brian Mistich, PE  
 554 Old Spanish Trail  
 Stidell, LA 70458  
 www.dammoneengineering.com  
 info@dammoneengineering.com  
 PH: 985.649.5832  
 F: 985.641.5950

#	DESCRIPTION	DATE

**PRELIMINARY NOT FOR CONSTRUCTION**

**RENOVATION FOR SPORTSMAN'S WAREHOUSE**  
 300 KENSINGTON BOULEVARD  
 SLIDELL, LOUISIANA 70458  
 JOB NO: 2232 DATE: 04-08-15  
 DRAWN BY: JTL CHECKED BY: CKD  
 SHEET TITLE: TENANT FLOOR PLAN  
 DRAWING NUMBER: A101  
 SHEET NO: 02 OF 18