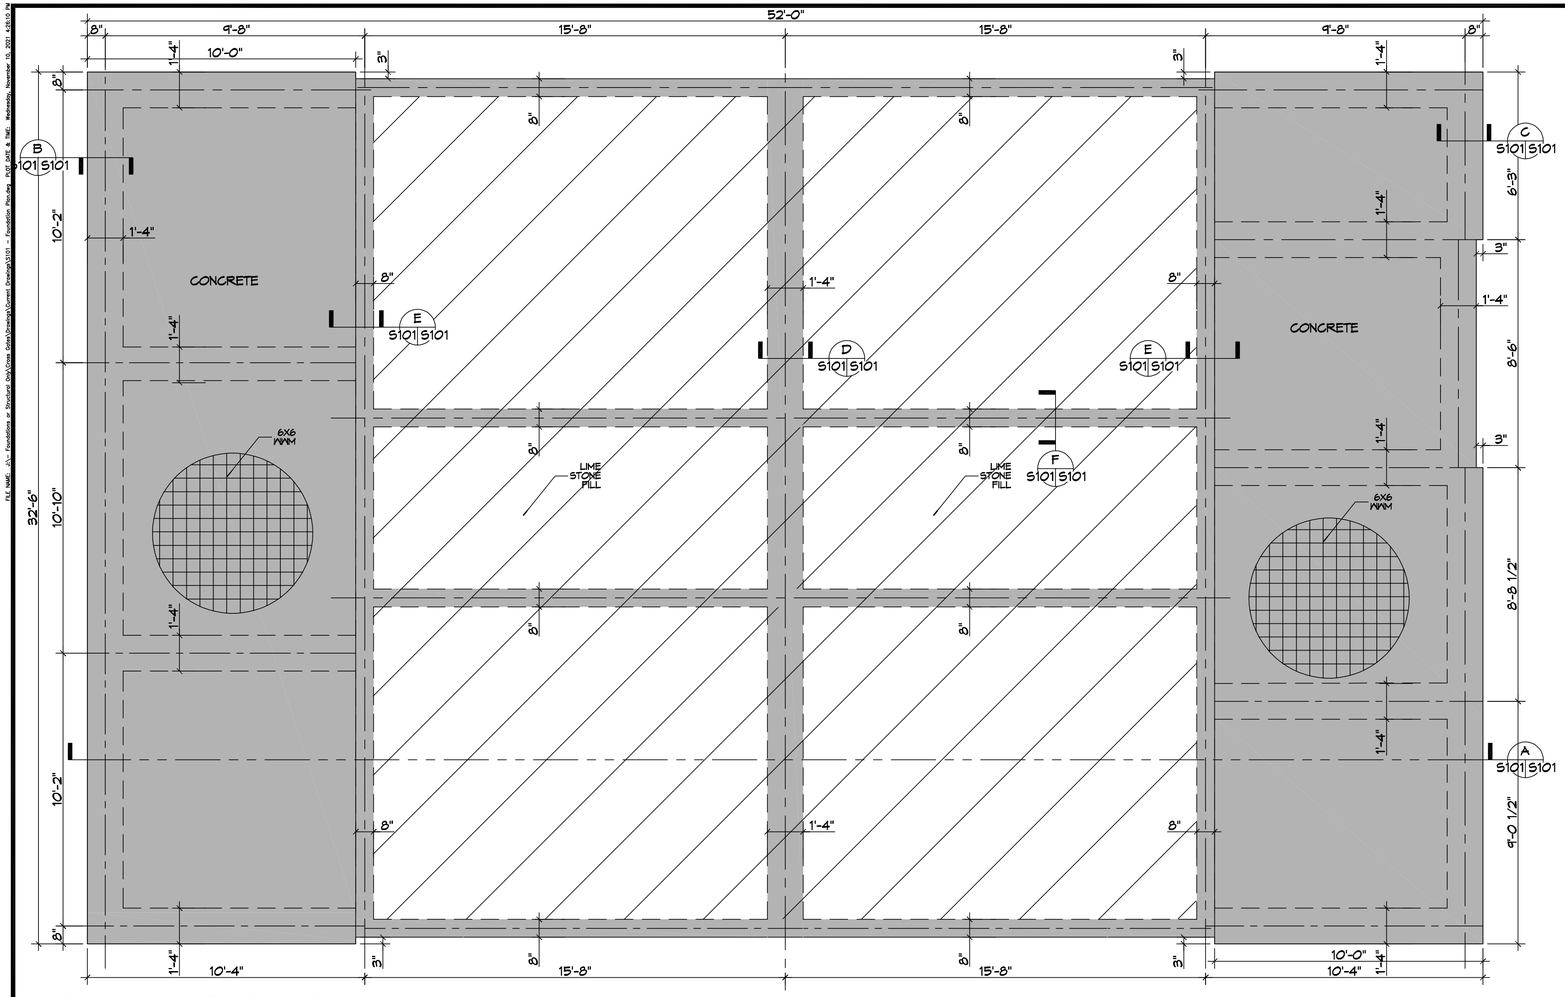

1 FOUNDATION PLAN
SCALE: 3/8" = 1'-0"

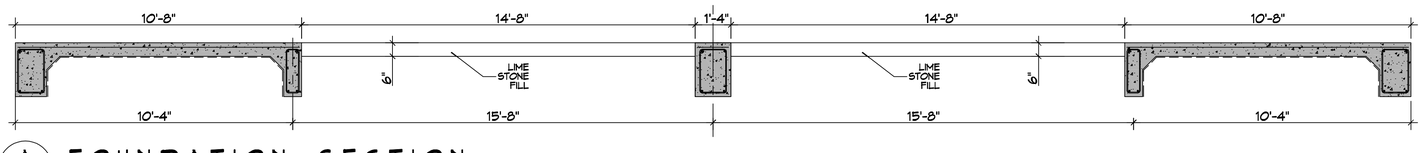

A S101|S101 FOUNDATION SECTION
SCALE: 3/8" = 1'-0"

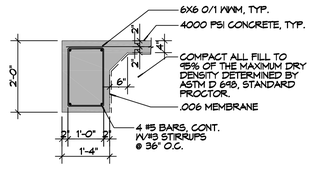

B S101|S101 SECTION
SCALE: 1/2" = 1'-0"

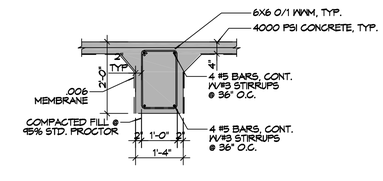

B S101|S101 SECTION
SCALE: 1/2" = 1'-0"

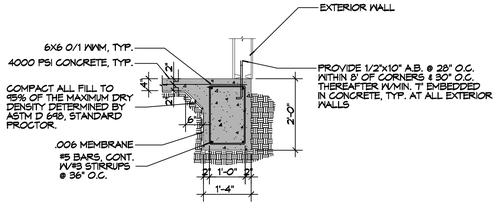

B S101|S101 SECTION
SCALE: 1/2" = 1'-0"

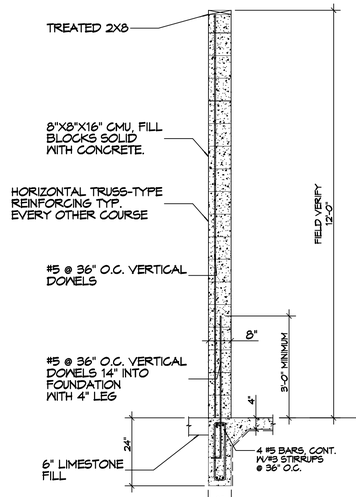

E S101|S101 SECTION
SCALE: 1/2" = 1'-0"

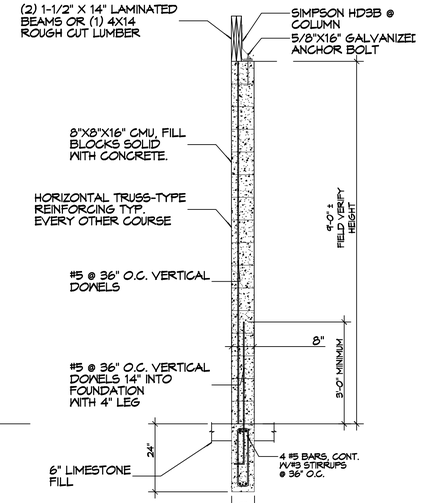

F S101|S101 SECTION
SCALE: 1/2" = 1'-0"

GENERAL FOUNDATION NOTES

1. ALL DIMENSIONS ARE EDGE OF CONCRETE (EOC) TO EDGE OF CONCRETE (EOC) UNLESS NOTED OTHERWISE.
2. VERIFY ALL PLUMBING ROUGH-IN LOCATIONS ON ARCHITECTURAL DWGS.
3. CONCRETE MIX SHALL HAVE A MINIMUM COMPRESSIVE STRENGTH OF 4000 PSI AT 28 DAYS. CONCRETE MIX SHALL BE IN ACCORDANCE WITH ACI-318.
4. ALL CONVENTIONAL REINFORCING STEEL SHALL MEET ASTM-A615 (GRADE 60).
5. ONE LAYER OF POLYETHYLENE VAPOR BARRIER SHALL BE PLACED UNDER ALL CONCRETE. VAPOR RETARDER TO BE MINIMUM 10 MIL, THICKNESS; ASTM E 1745 CLASS A, PERMEANCE LESS THAN 0.01 PERMS, EQUAL TO STEGO INDUSTRIES STEGO WRAP, EGOSHIELD-E 15 MIL BY EPRO, OR IRONBAR 15 BY FLATIRON FILMS. PROVIDE APPROPRIATE ACCESSORIES FOR A COMPLETE SYSTEM.
6. ALL REINFORCING STEEL AND MESH SHALL BE SECURELY SUPPORTED TO PREVENT BOTH VERTICAL AND HORIZONTAL MOVEMENT DURING CONCRETE PLACEMENT.
7. THE CONTRACTOR SHALL VERIFY ALL DROPS, OFFSETS, BRICK LEDGES, DIMENSIONS AND CONFIGURATIONS. CONTRACTOR MUST BE RESPONSIBLE FOR SAME. SEE ARCHITECTURAL DRAWINGS.
8. GRADE BEAM DIMENSIONS MAY VARY BY -5%, +20%.
9. FILL, AS A MINIMUM QUALITY, SHALL BE 40% CLAY AND 60% SANDY MIXTURE, PLACED IN 6" LIFTS AND COMPACTED TO A MINIMUM OF 95% STANDARD PROCTOR. FOOTINGS ARE DESIGNED TO USE SOIL WITH A BEARING PRESSURE OF 2000 LBS. PER SQUARE FOOT OR MORE. IT IS RECOMMENDED THAT THE OWNER VERIFY ALLOWABLE SOIL BEARING PRESSURE CAPACITY BY CONTRACTING THE SERVICES OF A SOILS ENGINEERING COMPANY.
9. ALL SOIL BELOW SLAB SHALL RECEIVE TERMITE TREATMENT.

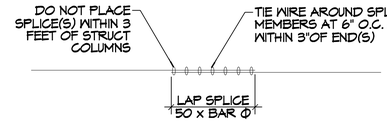

2 S102|S102 DETAIL
SCALE: 1/2" = 1'-0"

DAMMON ENGINEERING, INC.
LOUISIANA & MISSISSIPPI
www.dammonengineering.com
info@dammonengineering.com
PH: 985.649.3832
Chief Engineer: Brian Mistich, PE
1544 Gause Blvd. Slidell
Slidell, LA 70458

REVISIONS

#	DESCRIPTION	DATE

SEAL:

CROSS GATES

DATE: 10-21-2021
JOB No:
DRAWN BY: TNT CHECKED BY: JMS

SHEET TITLE: FOUNDATION PLAN

DRAWING NUMBER: S101

SHEET No: 1 of 8

These plans and specifications are the property of Dammon Engineering, Inc. and are copyrighted and shall not be reproduced or published without the permission of Dammon Engineering, Inc. and all common law rights are reserved. Unauthorized use of these plans and specifications on any project not designed by Dammon Engineering, Inc. for the specific project is prohibited. Visual contact with these plans and specifications shall constitute prima facie evidence of acceptance of these restrictions.

FILE NAME: J:\...\Foundations w/ Structural Slab\Cross Gates\Drawings\Current Drawings\S101 - Foundation Plan.dwg PLOT DATE & TIME: Wednesday, November 10, 2021 4:28:15 PM