GENERAL NOTES

1. ALL LUMBER SHALL BE PRESSURE TREATED WITH A RETENTION OF .4 PER C.F.
2. ALL FASTENERS SHALL BE HOT DIPPED GALVANIZED (HDG) PER ASTM A153.
3. ALL CONNECTORS SHALL BE HDG PER ASTM A653, CLASS G185 SHEET WITH 1.85 OZ/SF ZINC COATING.
4. TRIPLE UP FLOOR JOIST UNDER TUB AND INTERIOR LOAD BEARING WALLS.

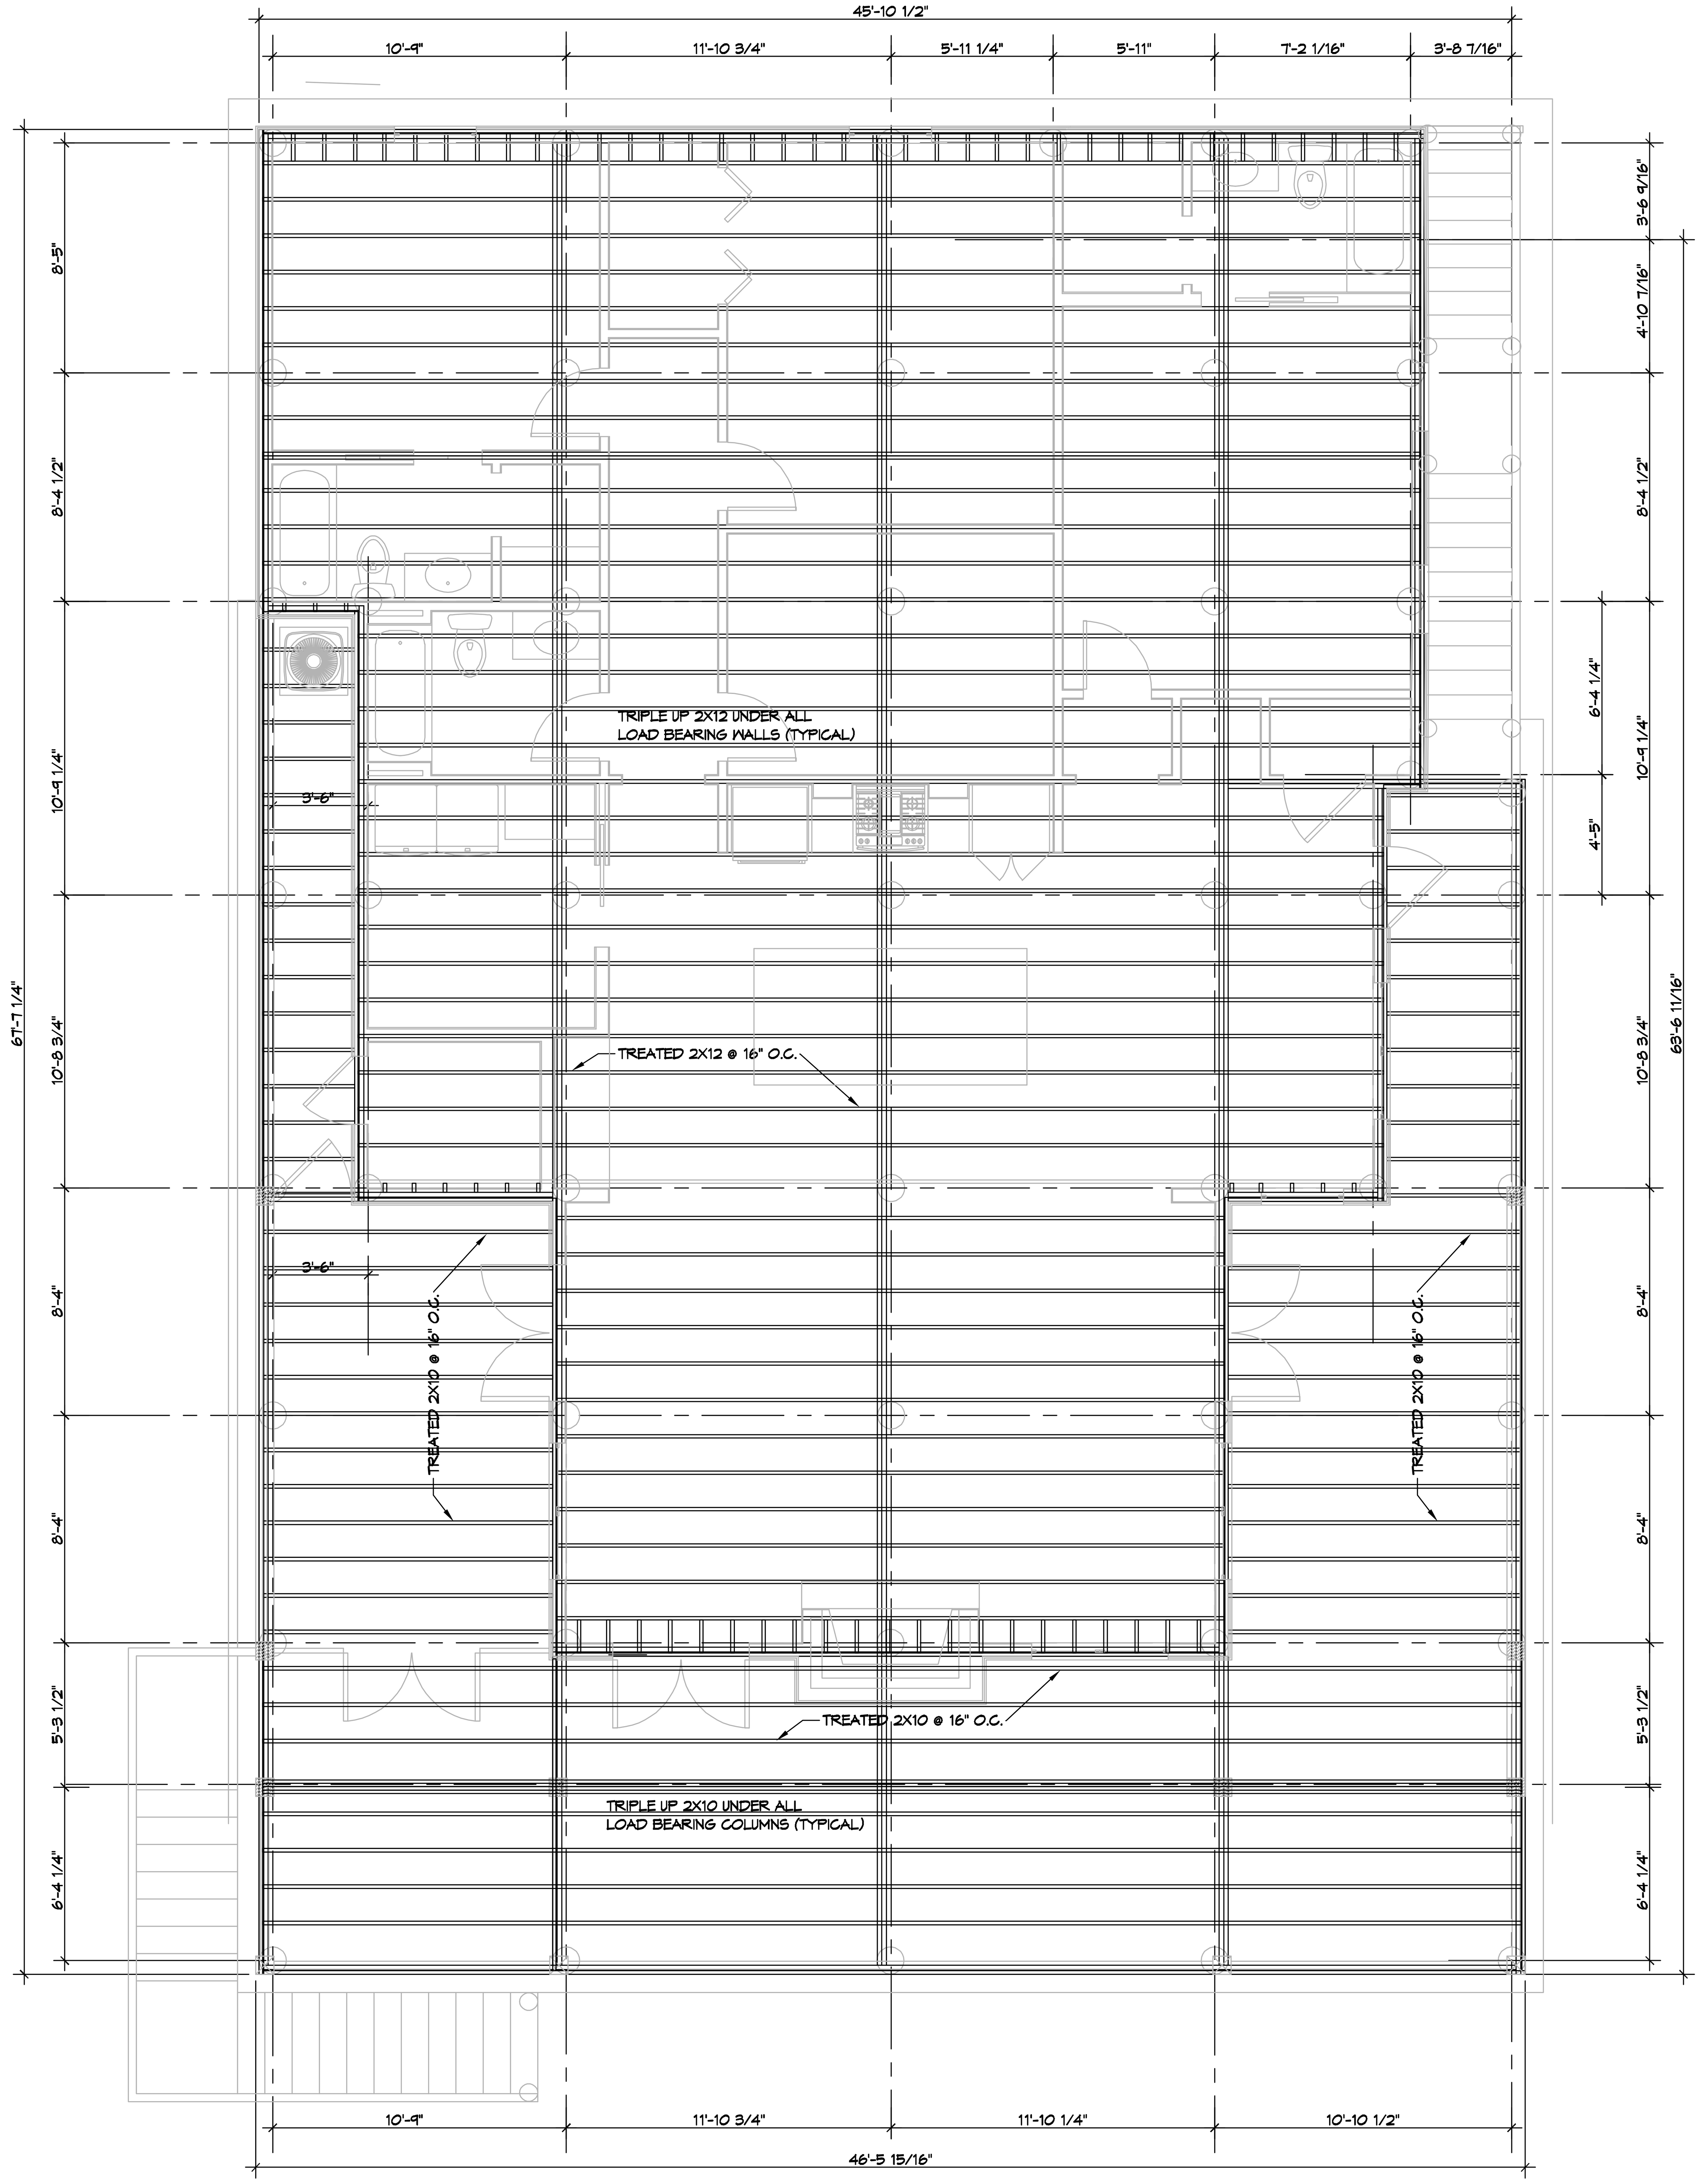

2 FLOOR FRAMING PLAN
SCALE: 1/4"= 1'-0"

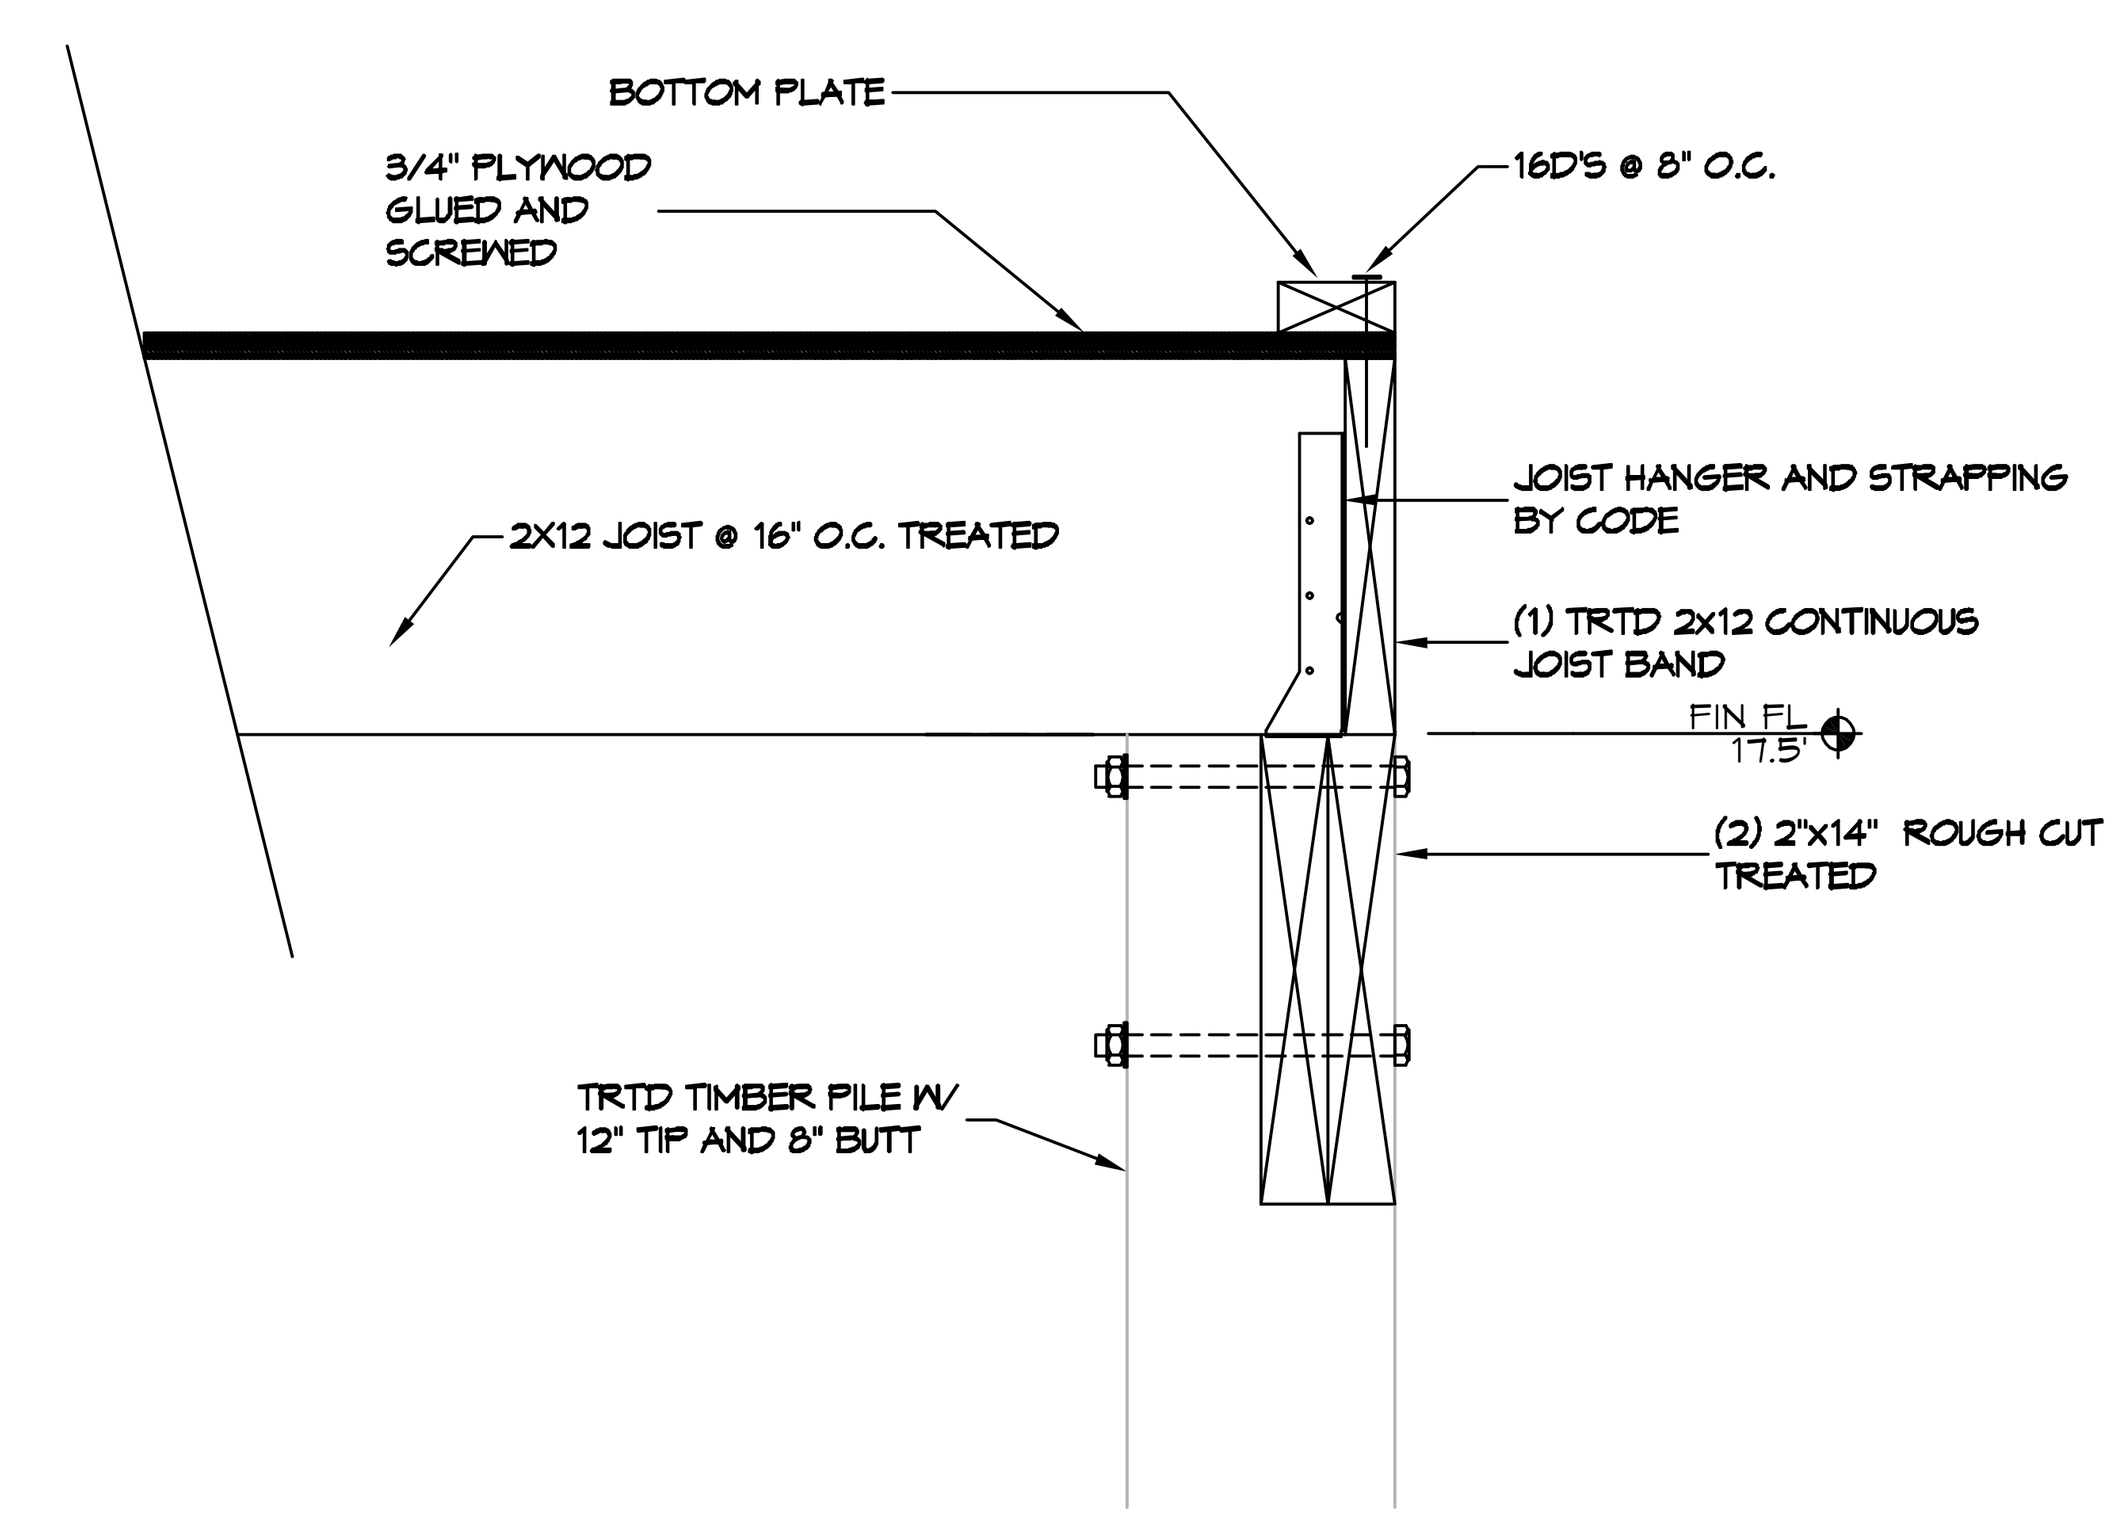

DETAIL
SCALE: 1-1/2" = 1'-0"
PERIMETER JOIST BAND

DAMMON ENGINEERING, INC.
LOUISIANA & MISSISSIPPI
Chief Engineer: Brian Mistich, PE
554 Old Spanish Trail
Slidell, LA 70458
www.dammonengineering.com
info@dammonengineering.com
PH: 985.649.5832

#	DESCRIPTION	REVISIONS	DATE

STRUCTURAL DWGS
JIMI SMITH
LOT 1 SQUARE 1
22190 CHEF MENTEUR HWY US 90
NEW ORLEANS LA. 70129

JOB No:	2022	DATE:	05-02-2022
DRAWN BY:	CKD	CHECKED BY:	CKD

SHEET TITLE:
FLOOR FRAMING PLAN

DRAWING NUMBER:
S102

SHEET No: 2 of 5