FILE NAME: J:\... Foundations w Structural Only\Alex Dividend House\Current House Piling Plan Drawings\S101 - Piling Plan.dwg, PLOT DATE & TIME: Tuesday, March 12, 2024 10:53:12 AM

## DESIGN CRITERIA

THE CONSTRUCTION FOR SAID RESIDENCE, WHERE BASIC WIND SPEED IS 150 MILES PER HOUR, WIND EXPOSURE ZONE D, IS DESIGNED IN ACCORDANCE WITH: AMERICAN FOREST AND PAPER ASSOCIATION (AF&PA) WOOD FRAME CONSTRUCTION MANUAL FOR ONE AND TWO FAMILY DWELLINGS (WFCM) 2001 EDITION AS WELL AS THE INTERNATIONAL RESIDENTIAL CODE (IRC) 2021 EDITION

## PILING COUNT

55 PILING COUNT

## PILING NOTES

1. PILES ARE TO BE 45 FT. IN LENGTH WITH A 8 INCH TIP AND 12" BUTT. DRIVEN TO REFUSAL.
2. ALL PILES SHALL BE PRESSURE-TREATED ROUND TIMBER PILES CONFORMING TO ASTM D25.
2. DESIGN LOAD = 5 TONS PER PILE.
3. NO FIELD SUPERVISION OR INSPECTION PROVIDED UNDER THIS SEAL UNLESS OTHERWISE NOTED.
4. FILE LAYOUT MAY BE MODIFIED DUE TO ACTUAL DRIVING CONDITIONS. ENGINEER TO BE NOTIFIED ON ANY MODIFICATION.
6. A PILE BLOW COUNT LOG OF ALL PILES IS TO BE SUBMITTED TO THE ENGINEER OF RECORD. FAILURE TO SUBMIT SAID LOG WILL RELEASE THE ENGINEER OF ALL RESPONSIBILITY.
7. CONTRACTOR IS RESPONSIBLE FOR THE COMPARISON & VERIFICATION OF PILE LAYOUT DIMENSIONS WITH MOST RECENT ARCHITECTURAL DRAWINGS, ASSURING THAT PILES DO FALL WITHIN LIMITS OF THE DESIGN
8. USE DROP HAMMER OR SINGLE ACTING AIR HAMMER DELIVERING 7,500 FT-LBS OF ENERGY PER BLOW. RAM WEIGHT OF DROP HAMMER SHALL NOT EXCEED 2,500 TO 3,000 LBS AND THE DROP SHOULD NOT EXCEED 3 FT. AT MINIMUM OF 25 BLOWS PER FOOT. IF THE DROP EXCEEDS 3 FT., CONTACT ENGINEER FOR INSTRUCTIONS.
9. BRACE ALL PILINGS AS NEEDED FOR SWAYING.
10. FIELD VERIFY DIMENSIONS AGAINST THE ARCHITECTURAL DRAWINGS.
11. WRAP ALL PILINGS AT BASE LINE.

## GENERAL NOTES

1. ALL LUMBER SHALL BE PRESSURE TREATED WITH A RETENTION OF .4 PER C.F.
2. ALL FASTENERS SHALL BE HOT DIPPED GALVANIZED (HDG) PER ASTM A153.
3. ALL CONNECTORS SHALL BE HDG PER ASTM A653, CLASS G185 SHEET WITH 1.85 OZ/SF ZINC COATING.
4. DOUBLE UP ON FLOOR JOISTS UNDER ALL WALLS AND BATHTUB.




1 PILING & BANDING PLAN
SCALE: 1/4" = 1'-0"




DETAIL
SCALE: 1-1/2" = 1'-0" CONNECTION BRACKET ON 2X14

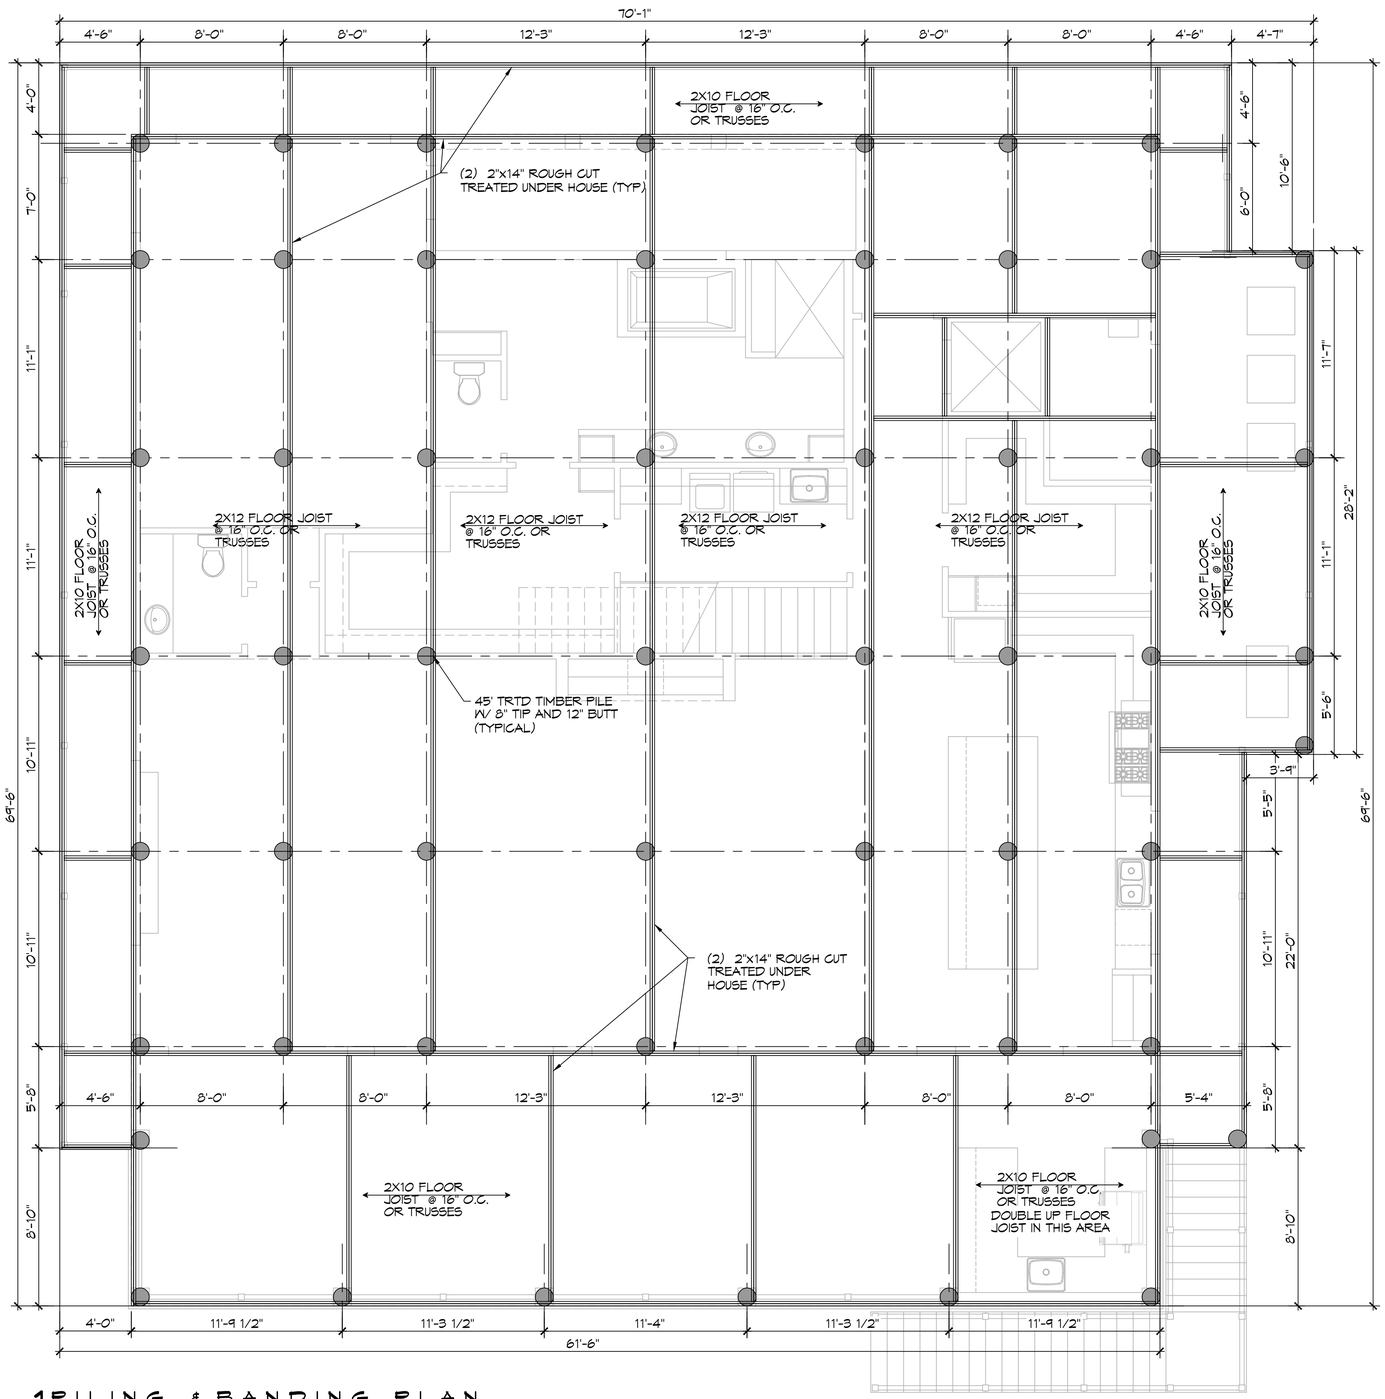


DETAIL
SCALE: 1-1/2" = 1'-0" PERIMETER BAND




DETAIL
SCALE: 1-1/2" = 1'-0" PERIMETER JOIST BAND

DAMMON ENGINEERING, INC.
LOUISIANA & MISSISSIPPI
www.dammonengineering.com
info@dammonengineering.com
PH: 985.649.5832
Chief Engineer: Brian Mistich, PE
1564 Gause Trail
Slidell, LA 70458

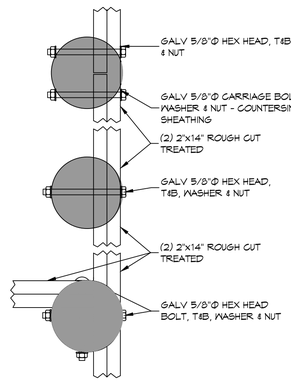REVISIONS

| # | DESCRIPTION | DATE |
|---|---|---|

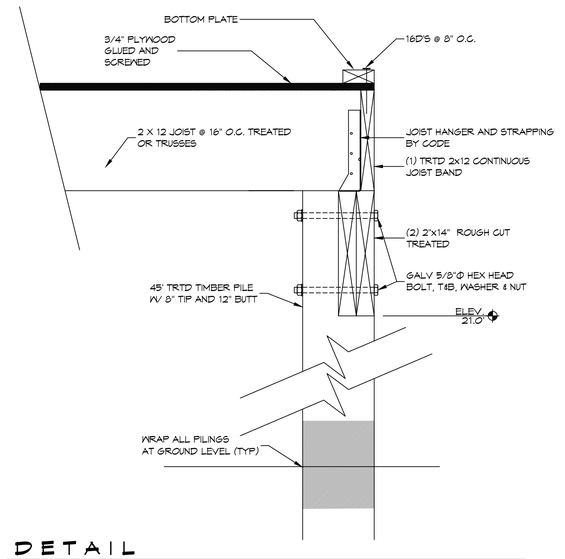SEAL:

PILING PLAN
THE DIDINGER RESIDENCE
55 TREASURE ISLES
SLIDELL, LA 70461

| | |
|---|---|
| JOB No: | 2024 |
| DRAWN BY: | C&D |
| DATE: | 03-12-2024 |
| CHECKED BY: | BAM |

THESE PLANS AND SPECIFICATIONS ARE COPYRIGHTED AND ONLY FOR USE ON THE SPECIFIED PROJECT. NONE OF THESE PLANS AND SPECIFICATIONS, OR COPIES THEREOF, SHALL BE USED BY ANY PERSON, FIRM OR CORPORATION FOR ANY PURPOSE WHATSOEVER, EXCEPT FOR THE SPECIFIED PROJECT FOR WHICH THEY HAVE BEEN PREPARED AND APPROVED BY DAMMON ENGINEERING, INC. AND THEIR USE AND PUBLICATION BY ANY OTHER PERSON IS STRICTLY PROHIBITED. ANY REVISION TO THESE PLANS AND SPECIFICATIONS OR PUBLICATION THEREOF WITHOUT WRITTEN CONSENT OF DAMMON ENGINEERING, INC. WILL BE AT OWNER'S AND USER'S SOLE RISK AND WITHOUT LIABILITY OR LEGAL EXPOSURE TO DAMMON ENGINEERING, INC.

SHEET TITLE:
PILING & BANDING PLAN

DRAWING NUMBER:
S101

SHEET No: 1 of 1