FILE NAME: J:\1 Foundation w Structural Grid\Plans Study\Current Drawings\S101 - Foundation Plan.dwg PLOT DATE & TIME: Wednesday, August 26, 2020 11:09:31 AM

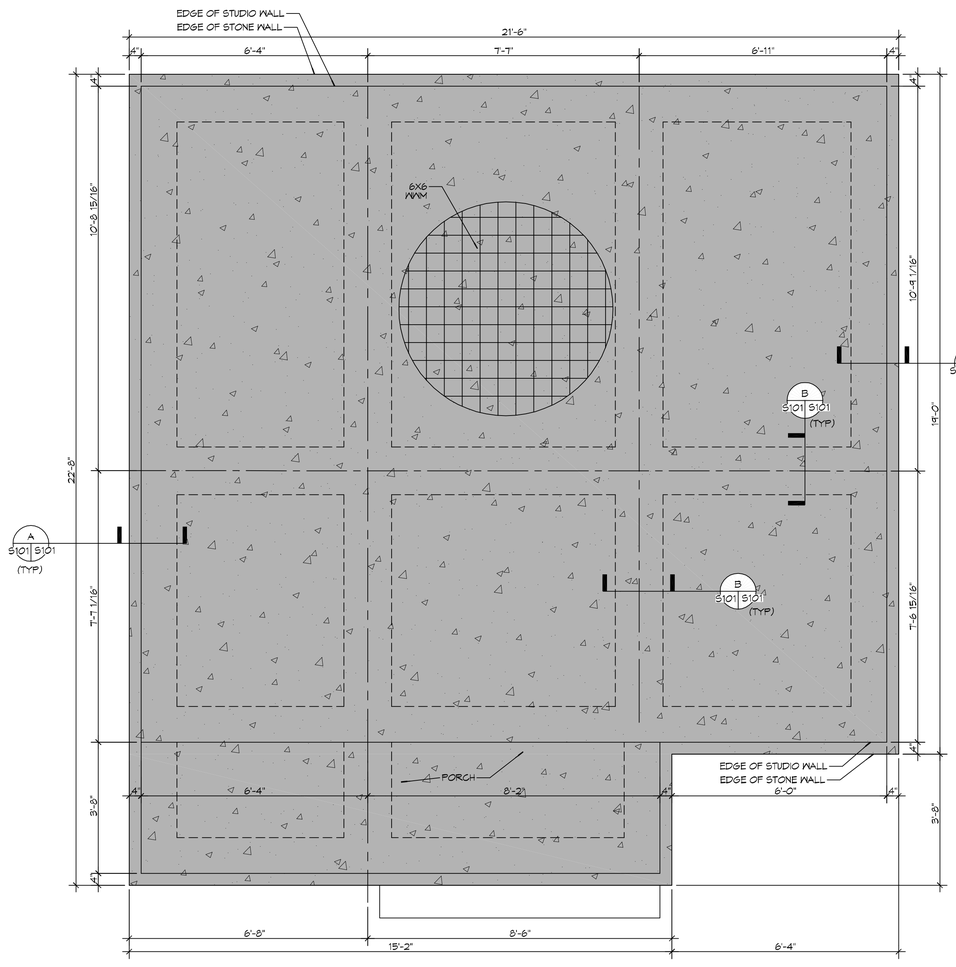

1 S101 S101 **FOUNDATION PLAN**
SCALE: 1/2" = 1'-0"

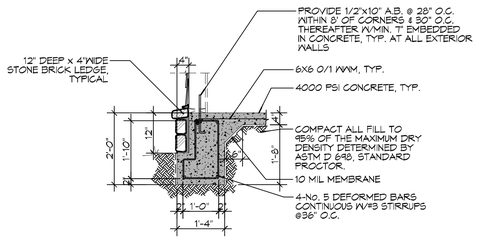

A S101 S101 **FOUNDATION DETAIL**
SCALE: 1/2" = 1'-0" EXTERIOR GRADE BEAM

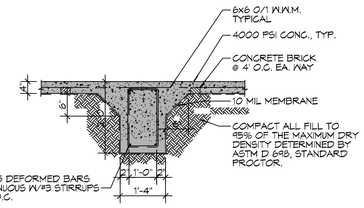

B S101 S101 **FOUNDATION DETAIL**
SCALE: 1/2" = 1'-0" INTERIOR GRADE BEAM

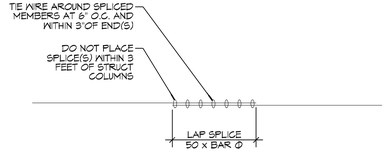

2 S101 S101 **FOUNDATION DETAIL**
SCALE: 1/2" = 1'-0" TYP SPLICE DETAIL

GENERAL FOUNDATION NOTES

1. ALL DIMENSIONS ARE EDGE OF CONCRETE (EOC) TO EDGE OF CONCRETE (EOC) UNLESS NOTED OTHERWISE.
2. VERIFY ALL PLUMBING ROUGH-IN LOCATIONS ON ARCHITECTURAL DWGS.
3. CONCRETE MIX SHALL HAVE A MINIMUM COMPRESSIVE STRENGTH OF 4000 PSI AT 28 DAYS. CONCRETE MIX SHALL BE IN ACCORDANCE WITH ACI-318.
4. ALL CONVENTIONAL REINFORCING STEEL SHALL MEET ASTM-A615 (GRADE 60).
5. ONE LAYER OF POLYETHYLENE VAPOR BARRIER SHALL BE PLACED UNDER ALL CONCRETE. VAPOR RETARDER TO BE MINIMUM 10 MIL THICKNESS, ASTM E 1745 CLASS A, PERMEANCE LESS THAN 0.01 PERMS, EQUAL TO STEGO INDUSTRIES STEGO WRAP, ECOSHIELD-E 15 MIL BY EPRO, OR IRONBAR 15 BY FLATIRON FILMS. PROVIDE APPROPRIATE ACCESSORIES FOR A COMPLETE SYSTEM.
6. ALL REINFORCING STEEL AND MESH SHALL BE SECURELY SUPPORTED TO PREVENT BOTH VERTICAL AND HORIZONTAL MOVEMENT DURING CONCRETE PLACEMENT.
7. THE CONTRACTOR SHALL VERIFY ALL DROPS, OFFSETS, BRICK LEDGES, DIMENSIONS AND CONFIGURATIONS. CONTRACTOR MUST BE RESPONSIBLE FOR SAME.
8. GRADE BEAM DIMENSIONS MAY VARY BY -5%, +20%.
9. NEW SPREAD CONCRETE FOOTINGS AND CONTINUOUS FOOTINGS, BEARING ON COMPACTED STRUCTURAL FILL AT LEAST 2 FEET BELOW FINISHED GRADE, SHOULD BE DESIGNED FOR MINIMUM NET ALLOWABLE BEARING PRESSURES OF 1200 PSF AND 2000 PSF, RESPECTIVELY, BASED ON DEAD LOADS AND DESIGN LIVE LOADS.
10. ALL SOIL BELOW SLAB SHALL RECEIVE TERMITE TREATMENT.

DAMMON ENGINEERING, INC.
LOUISIANA & MISSISSIPPI
Chief Architect: Kevin J. Klochen, NCARB
Chief Engineer: Brian Mistich, PE
554 Old Spanish Trail
Slidell, LA 70458
www.dammonengineering.com
info@dammonengineering.com
PH: 985.649.5832
F: 985.641.5950

#	DESCRIPTION	DATE

REVISIONS

SEAL:

STUDIO FOUNDATION PLAN

BRIAN REINE

6193 HWY 1091
SLIDELL, LA 70459

JOB No:	2020	DATE:	08-26-2020
DRAWN BY:	CKD	CHECKED BY:	CKD

The plans, drawings and specifications, designs and arrangements thereof as instruments of service are and shall remain the property of Dammon Engineering. Neither the plans, drawings and specifications nor any part thereof may be used for any other project without the written consent of Dammon Engineering. Visual contact with these plans and specifications shall constitute prima facie evidence of the acceptance of these restrictions.

SHEET TITLE:
FOUNDATION PLAN

DRAWING NUMBER:
S101

SHEET No: 1 of #1