FILE NAME: J:\1- Dammon\2013 - Camp Villere Commander's Pad\Drawings\Current Drawings\P2.dwg, PLOT DATE & TIME: Tuesday, October 21, 2014 8:53:38 AM

PLUMBING FIXTURE SCHEDULE

MARK	DESCRIPTION	TYPE	ROUGH-IN-SIZES				MODEL
			WASTE	VENT	CW	H.W.	
WC	WATER CLOSET	VALVE	4"	4"	1/2"	-	KOHLER K-3575
L1	LAVATORY	-	2"	2"	1/2"	1/2"	KOHLER R2699-4-0 & MOEN 8422295RN
S1	SINK	-	2"	2"	1/2"	1/2"	MOEN G202334 & KINGSTON KLGSS8878CTL
WM	WASHING MACHINE	-	2"	2"	1/2"	1/2"	OWNER SUPPLIED
BT1	BATHTUB	-	2"	2"	1/2"	1/2"	KOHLER K-715 & MOEN T2703EPBN W/ POSI-TEMP VALVE
DW	DISHWASHER	-	2"	2"	1/2"	1/2"	OWNER SUPPLIED

PLUMBING LEGEND

- ELBOW UP
- ELBOW DOWN
- DIRECTION OF FLOW
- TEE OFF TOP
- TEE OFF BOTTOM
- BALL VALVE
- CHECK VALVE (BACK FLOW PREVENTER)
- POINT BETWEEN NEW AND EXISTING
- FLEXIBLE CONNECTION
- SHOWER HEAD
- HB — HOSE BIB
- DW — NEW DOMESTIC WATER LINE
- CW — NEW COLD WATER LINE
- HW — NEW HOT WATER LINE

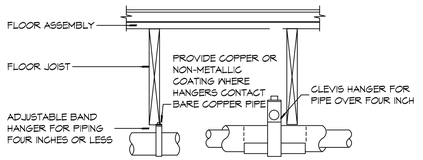

NOTES:
1. PROVIDE GALVANIZED STEEL SADDLE FOR ALL INSULATED PIPE LARGER THAN 3/4". VERIFY INSULATION THICKNESS WHEN SIZING HANGERS.
2. PROVIDE UPPER ATTACHMENT AS REQUIRED FOR CASES NOT SHOWN HERE. DO NOT INSTALL HANGER INSIDE INSULATION OR OTHERWISE PENETRATE VAPOR BARRIER. DO NOT HANG ONE PIPE FROM ANOTHER EXCEPT IN CHASES. TRAPEZE HANGERS MAY BE USED FOR MULTIPLE PARALLEL PIPES. HANGER SPACING FOR PIPE SIZE: COPPER: 4"=12' 3"=11' 2-1/2"=10' 2"=9' 1-1/2"=8' 1-1/4"=7' 1"=6' 3/4"=6' 1/2"=5'. CAST IRON: 10' AND ONE NEAR ALL JOINTS. STEEL: 4"=14' 3"=12' 2-1/2"=11' 2"=10' 1-1/2"=9' 1"=7' 3/4"=6' 1/2"=5'. LOCATE HANGERS AS CLOSE AS POSSIBLE TO TURNS AND TEES OF PIPE. PROVIDE SUPPLEMENTARY STEEL STRUTS BETWEEN JOISTS IF REQUIRED LOCATE HANGERS TO TAKE LOAD OFF OF EQUIPMENT CONNECTIONS. ANCHOR WATER PIPE AGAINST SWAYING DUE TO CHANGES IN WATER VELOCITY. PROVIDE SEISMIC BRACING IF/AS REQUIRED BY LOCAL AUTHORITIES. CHAINS OR PERFORATED STRAP IRON OR STEEL IS NOT ACCEPTABLE. REFER TO CODES FOR FURTHER INFORMATION.

3 P2 | P2 — PLUMBING DETAIL
SCALE: N.T.S. — TYPICAL PIPE HANGER

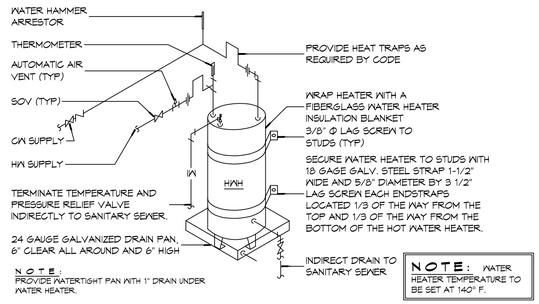

NOTE: PROVIDE WATERTIGHT PAN WITH 1" DRAIN UNDER WATER HEATER.

NOTE: WATER HEATER TEMPERATURE TO BE SET AT 140° F.

4 P2 | P2 — PLUMBING DETAIL
SCALE: N.T.S. — WATER HEATER DIAGRAM

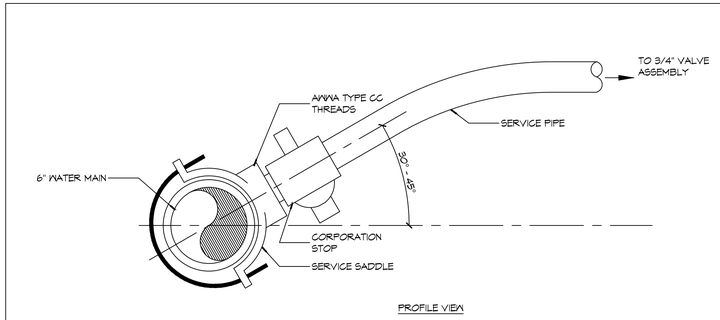

WATER SERVICE DETAIL

2 P2 | P2 — PLUMBING DETAIL
SCALE: N.T.S. — DOMESTIC WATER SERVICE

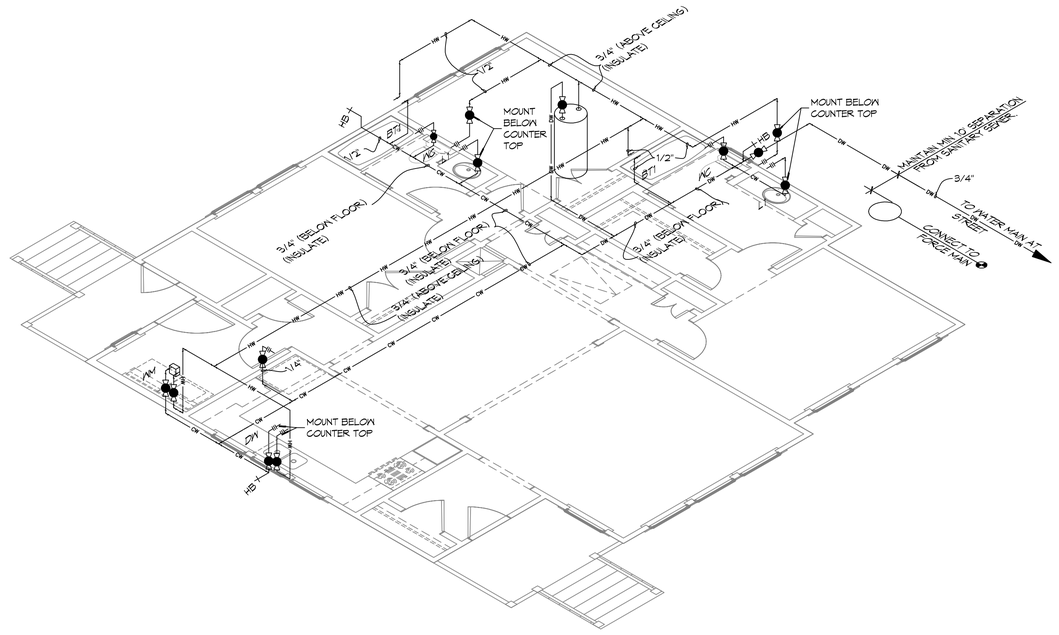

1 P2 | P2 — PLUMBING RISER DIAGRAM
SCALE: 1/4" : 1'-0" — DOMESTIC WATER

DAMMON ENGINEERING, INC.
LOUISIANA & MISSISSIPPI
www.dammonengineering.com
info@dammonengineering.com
PH: 985.649.5832
Chief Engineer: Brian Mistich, PE
554 Old Spanish Trail
Slidell, LA 70458

#	DESCRIPTION	REVISIONS	DATE

SEAL:

LOUISIANA ARMY NATIONAL GUARD

CAMP VILLERE
NEW HOME CONSTRUCTION
LA 14-A-057

CAMP VILLERE, LOUISIANA

JOB No:	2210	DATE:	OCTOBER 8, 2014
DRAWN BY:	K-K	CHECKED BY:	CKD

ALL IDEAS, DESIGNS, ARRANGEMENTS AND PLANS INDICATED OR REPRESENTED BY THIS DRAWING ARE AND SHALL REMAIN THE PROPERTY OF DAMMON ENGINEERING, INC. AND WERE CREATED AND DEVELOPED FOR USE ON THE PROJECT DESCRIBED HEREIN. THEY ARE NOT TO BE USED IN WHOLE OR IN PART FOR ANY OTHER PROJECT WITHOUT THE WRITTEN AGREEMENT OF DAMMON ENGINEERING, INC. AND A FEE HAS BEEN PAID. THIS DRAWING IS COPYRIGHTED AND ANY UNAUTHORIZED USE WITHOUT WRITTEN CONSENT OF DAMMON ENGINEERING, INC. IS PROHIBITED. © 2014 DAMMON ENGINEERING, INC.

SHEET TITLE:
PLUMBING DOMESTIC WATER PLANS, RISER DIAGRAMS AND NOTES

DRAWING NUMBER:
P2

SHEET No: 12 of 12