1. ELECTRICIAN SHALL INSTALL & LEAVE PULL STRING IN ALL CONDUITS.
2. ALL CONDUITS SHALL BE SCH 40 BELOW GRADE AND SCH 80 ABOVE GRAE.

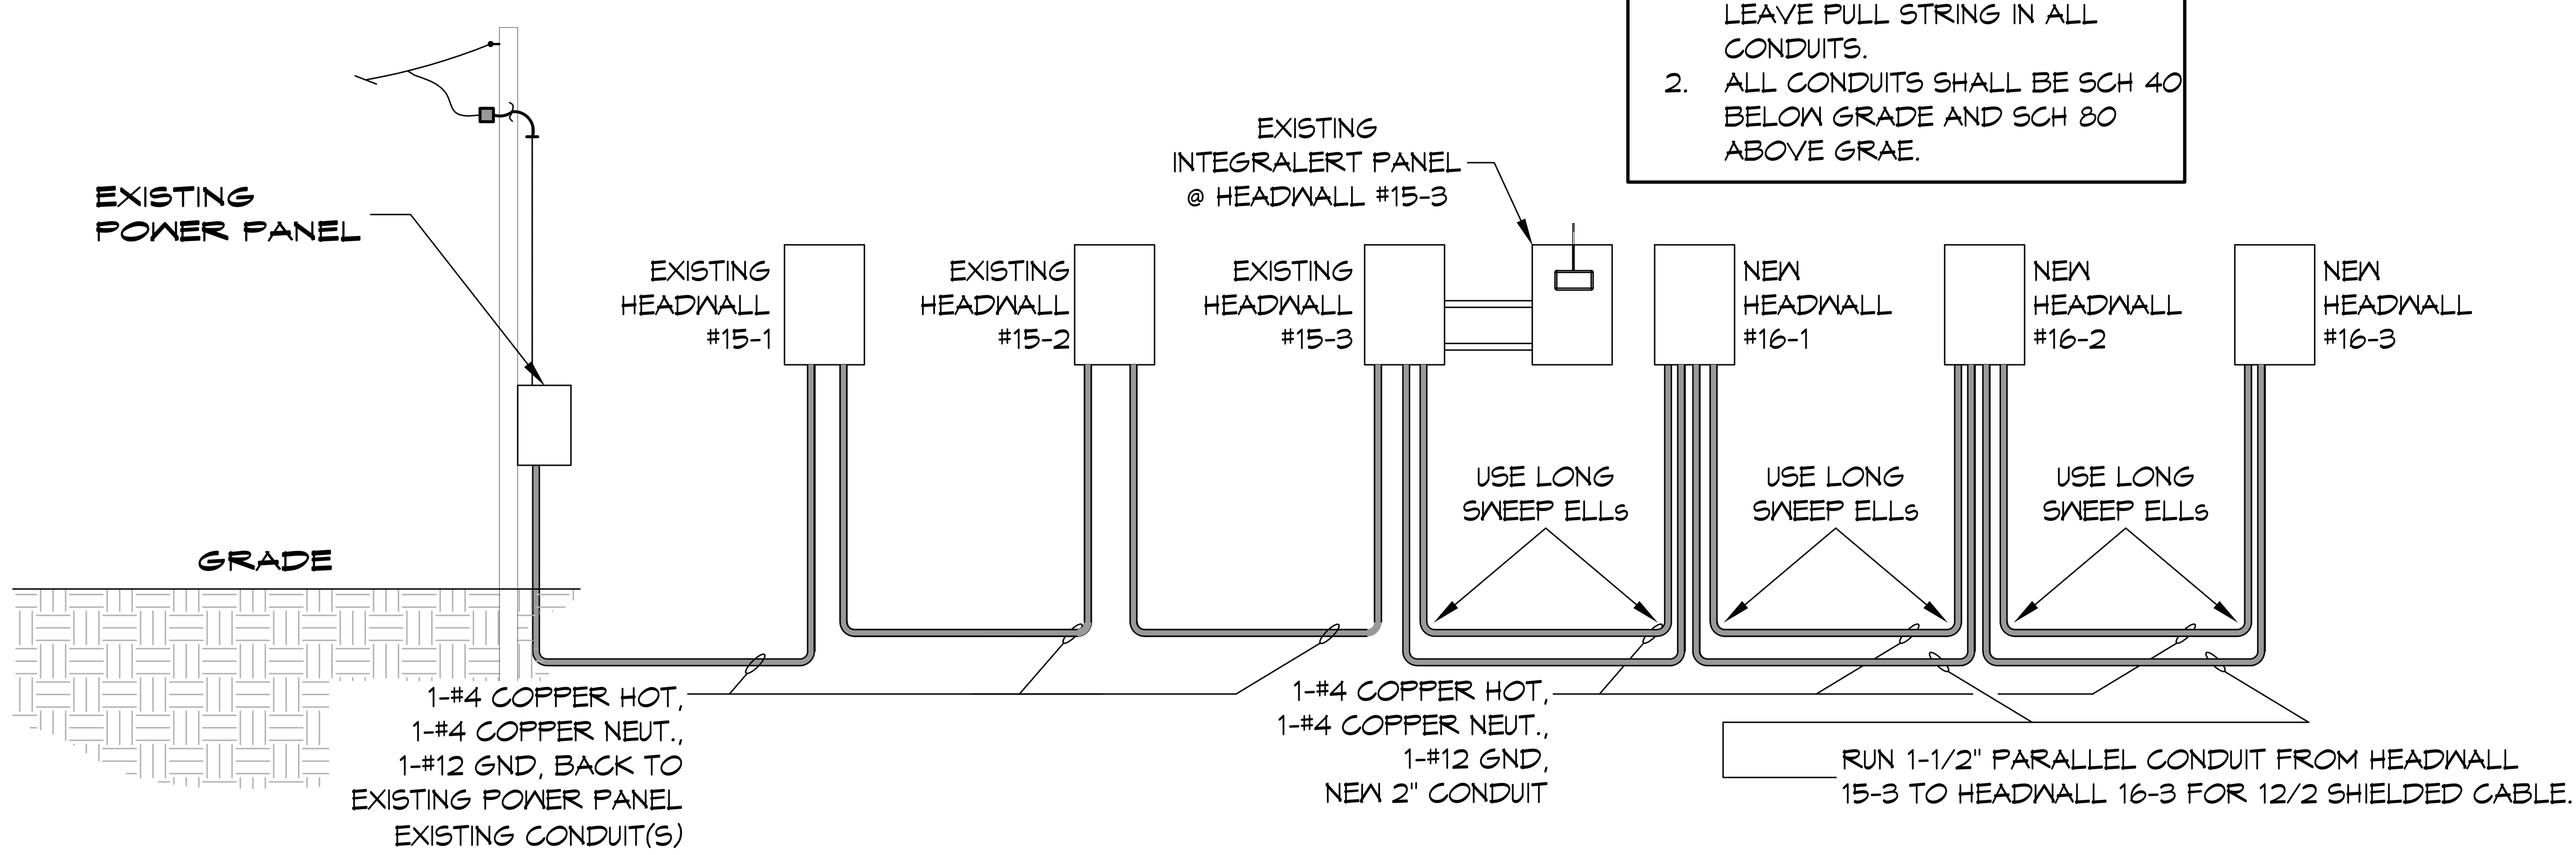


| EQUIPMENT LIST | |
|---|---|
| QUANTITY | ITEM |
| 3 | LEACHATE PUMP CONTROL PANEL AND TRANSDUCER, MANUFACTURER COX, MDL CP-5676 |
| 9 | POLARIS BLACK INSULATED TAP CONNECTOR; 4-14 AWG |

NOTE : SEE SHEET M103 FOR LEACHATE PUMP CONTROL PANEL CONNECTIONS.

| COX RESEARCH & TECHNOLOGY LEACHATE PUMP CONTROL PANEL AND TRANSDUCER EQUIPMENT LIST, MODEL CP-5676 | |
|---|---|
| QUANTITY | ITEM |
| 1 | HOFFMAN NEMA 4X ENCLOSURE, PART # CSD24201SS |
| 1 | COX RESEARCH BACKPLATE/SWING PANEL, PART # CAMO242010CSD |
| 1 | SQUARE D CIRCUIT 40 AMP BREAKER, PART # QOU140 |
| 1 | SQUARE D CIRCUIT 15 AMP BREAKER, PART # QOU115 |
| 1 | SQUARE D CIRCUIT 10 AMP BREAKER, PART # QOU110 |
| 1 | HUBBELL GFI RECEPTACLE |
| 1 | TPS SURGE SUPPRESSOR, PART # TK-LT120-15A-DIN2 |
| 1 | PRECISION DIGITAL SETPOINT CONTROLLER, PART # PD6000-6R7 |
| 1 | MJK SUBMERSIBLE TRANSDUCER, PART # 3400 |
| 1 | ABB H.O.A. SWITCH, PART # C3SS110B-20 |
| 1 | ABB BLUE PILOT LIGHT, PART # CL513L |
| 1 | CONERY ALARM LIGHT, PART # R40-XLS |
| 1 | ASCO AIR SOLENOID VALVE, PART # 8210G002 |
| 2 | IDEC ELECTROMECHANICAL RELAY, PART # RY4SULCAC120 |
| 1 | HOFFMAN PAD LOCK HANDLE, PART # GPDLOCKHDL |
| 1 | MASTER PNEUMATIC FILTER, PART # CF5AR350 |
| 2 | 1/2" x 1/2" BULKHEAD COPPER ADAPTER |
| 2 | 1/2" COPPER UNION |
| 2 | 1/2" x 6" COPPER PIPE |
| 2 | 1/2" 90° COPPER ELBOW |
| 1 | 1/2" MALE TO MALE FITTING |

| EXISTING INTEGRALERT SYSTEM LOCATED AT HEADWALL 15-3, CONTROL PANEL CONNECTIONS. | | | | | | | | |
|---|---|---|---|---|---|---|---|---|
| | IN1 | IN2 | IN3 | IN4 | IN5 | IN6 | IN7 | IN8 |
| HEADWALL | 15-1 | 15-2 | 15-3 | 16-1 | 16-2 | 16-3 | SPARE | SPARE |

1. ELECTRICIAN SHALL MAKE CONNECTIONS FROM THE NEW CONTROL PANEL'S ALARM CONTACT TO THE EXISTING INTEGRALERT SYSTEM LOCATED AT HEADWALL 15-3 USING THE TABLE ABOVE.
2. ELECTRICIAN SHALL TEST THE NEW CONTROL PANEL TO ENSURE THAT WHEN A HIGH WATER LEVEL HAS BEEN DETECTED THAT IT:
   A. TURNS ON THE STROBE LIGHT AT THAT CONTROL PANEL.
   B. SENDS AN ALERT VIA INTEGRALERT SYSTEM.

| PUMP CONTROLLER SETTINGS: | | | | |
|---|---|---|---|---|
| | PUMP ON | PUMP OFF | HIGH LEVEL ON | HIGH LEVEL OFF |
| LEACHATE DEPTH | 1.5 | 0.75 | 2.0 | 1.6 |

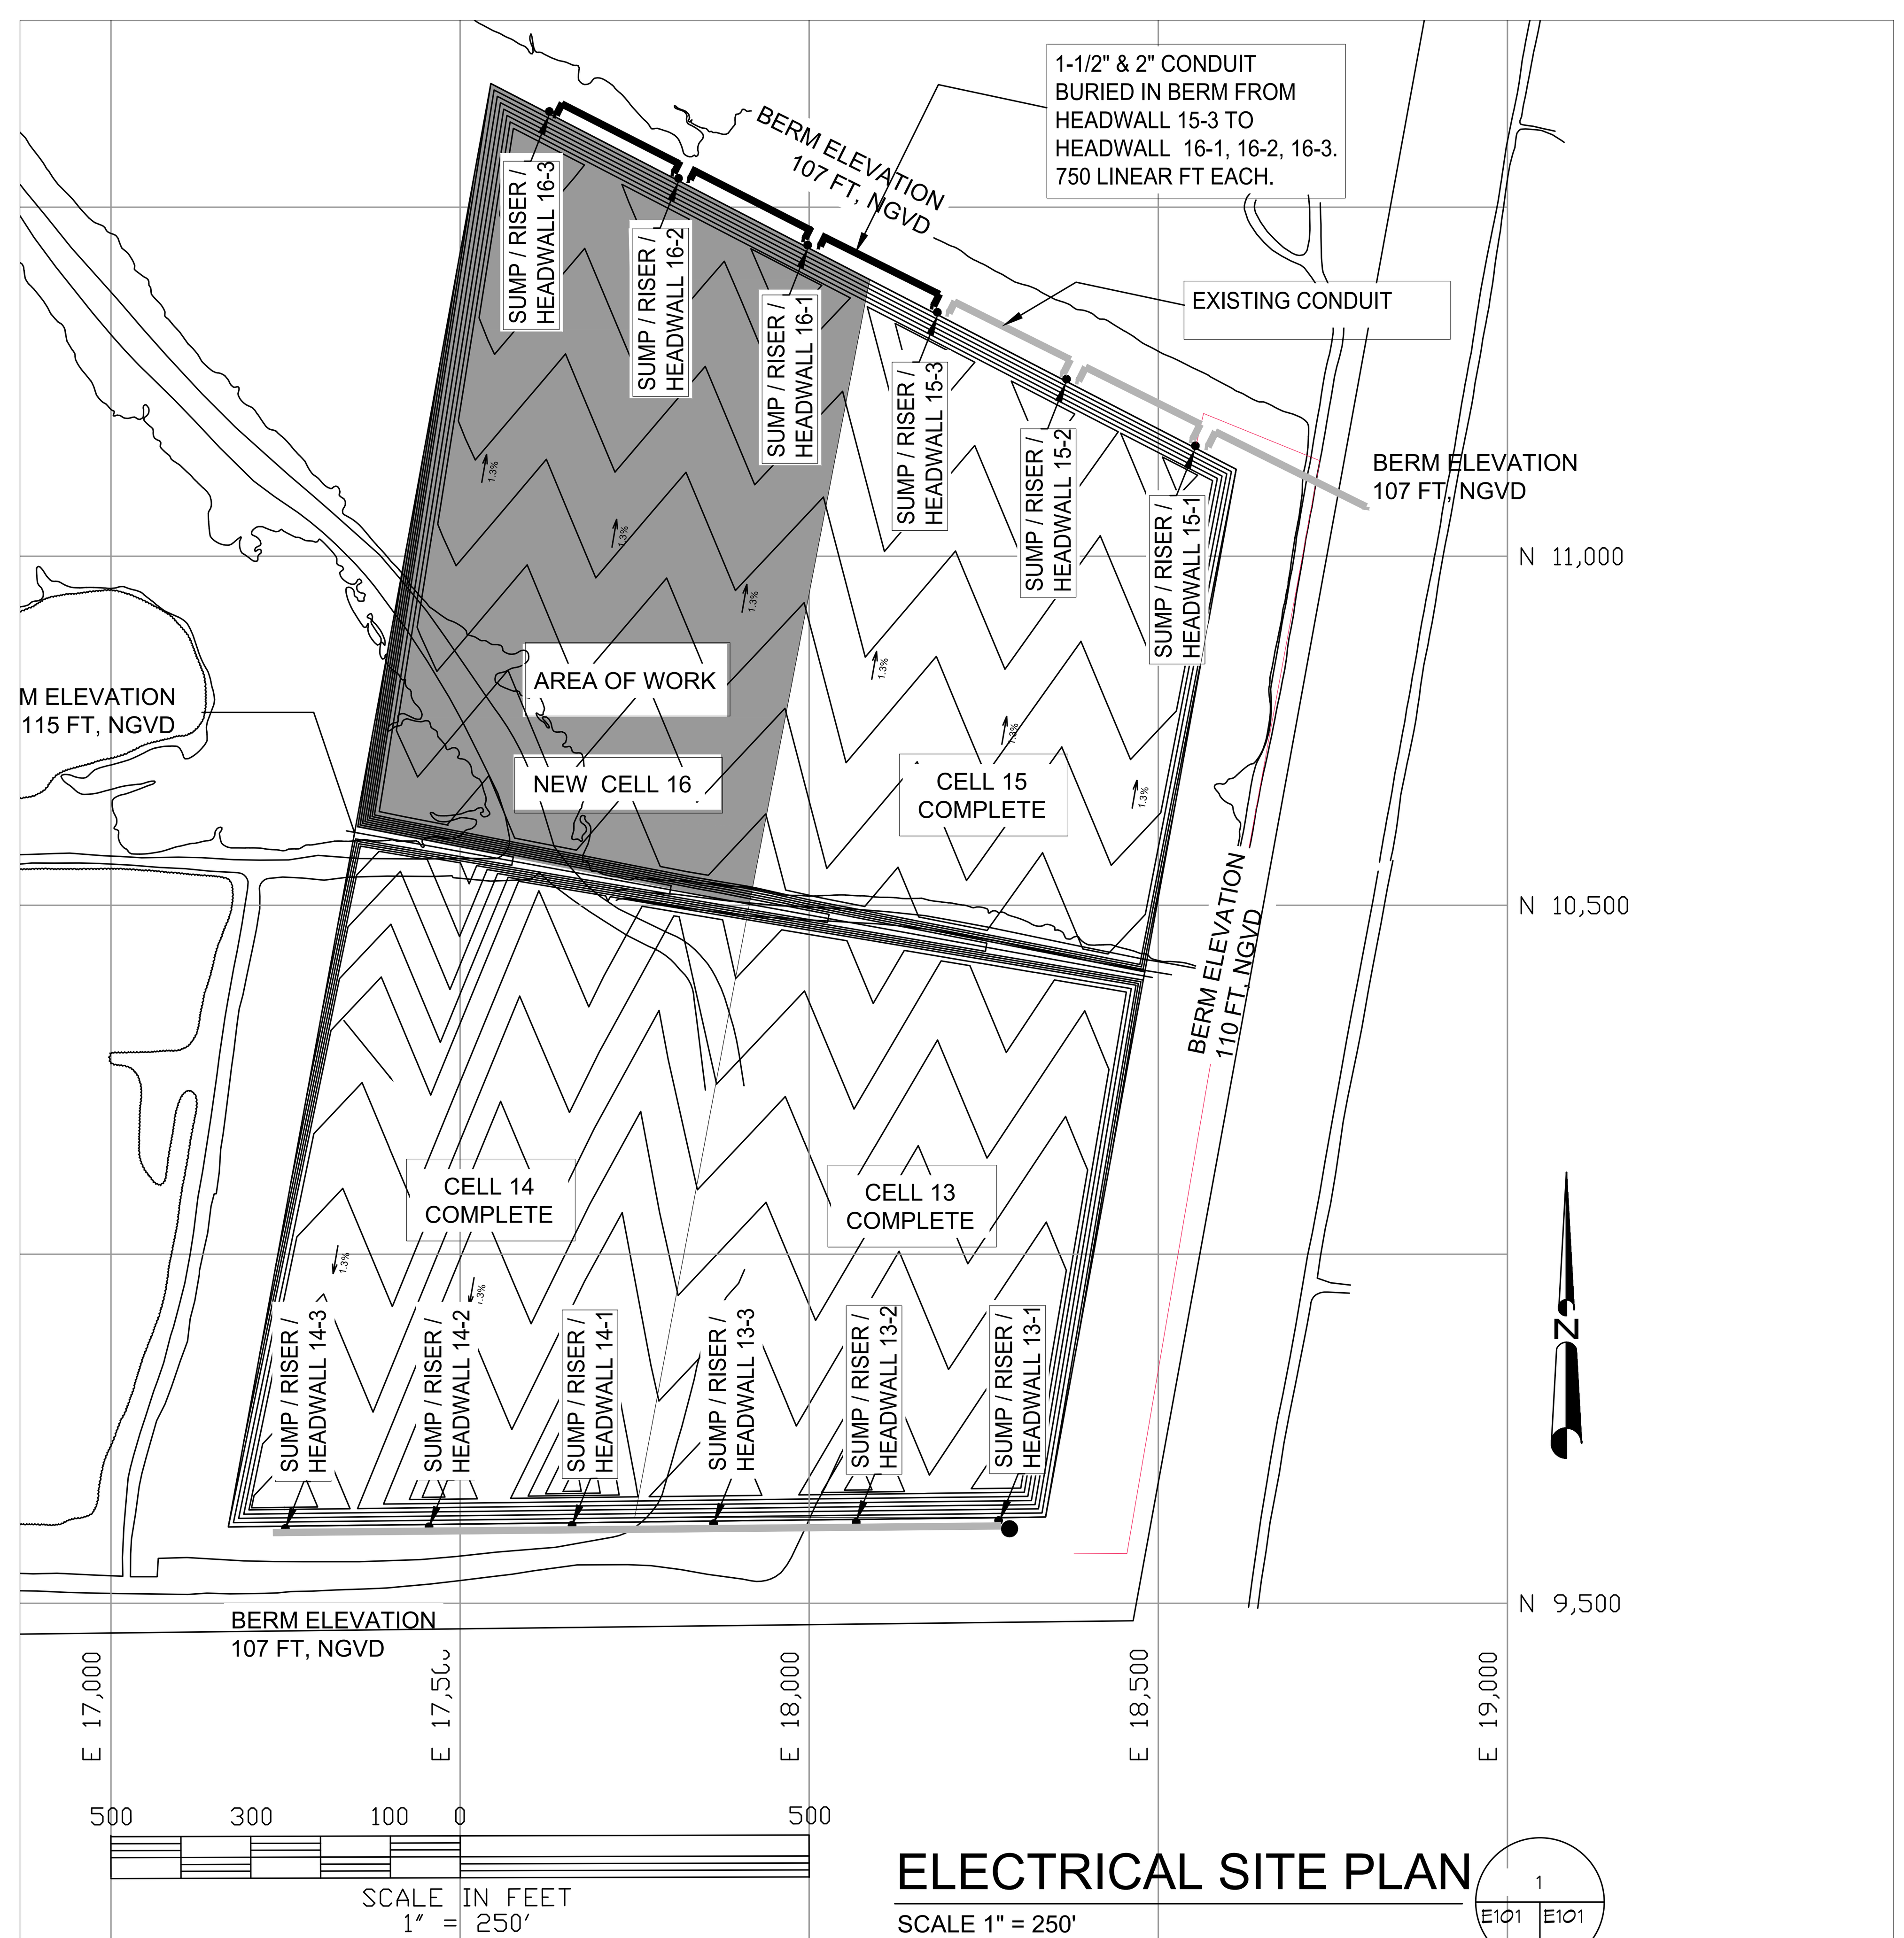


ELECTRICAL SITE PLAN 1 E101 E101

SCALE 1" = 250'

NOTE: NAMING A CERTAIN BRAND, MAKE OR MANUFACTURER IS TO DESIGNATE THE GENERAL STYLE, TYPE, CHARACTER AND QUALITY STANDARD OF THE PRODUCT DESIRED. SUBSTITUTION REQUESTS MUST BE SUBMITTED PRIOR TO BIDDING.

## ELECTRICAL NOTES

1. ALL WORK SHALL CONFORM TO THE LATEST EDITION OF THE NATIONAL ELECTRICAL CODE, THE GOVERNING ELECTRICAL CODE AND ALL OTHER INSPECTION DEPARTMENTS HAVING JURISDICTION. OBTAIN CERTIFICATES OR APPROVAL WHERE REQUIRED.
2. ALL MATERIALS FURNISHED SHALL BE NEW AND SHALL BE U.L. LISTED.
3. THE DRAWINGS INDICATE SIZE AND GENERAL LOCATION OF WORK. SCALE DIMENSIONS SHALL NOT BE USED. THE EXACT LOCATION AND LOCATION OF ALL POWER POLES AND ALL RISERS SHALL BE DETERMINED BY ACTUAL CONDITIONS IN THE FIELD.
4. PRIOR TO BIDDING, CONTRACTOR SHALL VISIT THE JOB SITE AND FAMILIARIZE THEMSELVES WITH THE EXISTING CONDITIONS.
5. ELECTRICAL CONTRACTOR SHALL COORDINATE HIS WORK WITH OTHER TRADES AND WITH OTHER CONTRACTORS WHOSE WORK MAY AFFECT THIS INSTALLATION.
6. PERFORM TEST REQUIRED BY THE OWNER OR THE ENGINEER IN CONNECTION WITH THE OPERATION OF THE ELECTRICAL SYSTEM IN THE BUILDING.
7. ALL TESTS SHALL BE MADE IN ACCORDANCE WITH THE LATEST STANDARD OF THE IEEE AND THE NATIONAL ELECTRICAL CODE.
8. MINIMUM CONDUCTOR SIZE SHALL BE #12, 600V INSULATION.
9. CONTRACTOR SHALL INSTALL WIRING AND OTHER CIRCUIT COMPONENTS TO MATCH EQUIPMENT ACTUALLY INSTALLED.
10. INSTALL GROUND FAULT RECEPTACLES AT RECEPTACLE LOCATIONS AT EXTERIOR LOCATIONS. EXTERIOR RECEPTACLES SHALL ALSO BE WATERPROOF.
11. BONDING AND GROUNDING SHALL BE IN ACCORDANCE WITH NFPA 70:230-63, NFPR 250-23, 250-71 & 250-72.
12. GROUND NEUTRAL IN ACCORDANCE WITH NFPA 70:250-23b.
13. FUSES SHALL BE ITT CLASS K5, 250 VOLT, 200,000 AMP INTERRUPTING CAP.
14. MINIMUM SIZE ELECTRICAL CONDUIT SHALL BE 1" FOR EXTERIOR USE, UNLESS OTHERWISE SHOWN. ALL ELECTRICAL CONDUIT SHALL BE SCHEDULE 40 PIPE BELOW GRADE AND SCHEDULE 80 PIPE ABOVE GRADE.
15. 1-1/2" & 2" UNDERGROUND CONDUITS SHALL BE INSTALLED BETWEEN HEADWALLS. EACH 20 AMP CIRCUIT BREAKER AT EXISTING POWER PANEL SHALL SUPPORT 1 CELL OR 3 HEADWALLS.
16. TERMINATE ALL EQUIPMENT ACCORDING TO MANUFACTURER'S RECOMMENDATION.
17. CONTRACTOR SHALL PROVIDE AS-BUILT DRAWINGS FOR ALL WORK PERFORMED.

WORK AREA : ONLY CELL 16 IS BEING CONSTRUCTED UNDER THIS PROJECT.


DAMMON ENGINEERING, INC.
LOUISIANA & MISSISSIPPI
Chief Engineer: Brian Mistich, PE
554 Old Spanish Trail
Slidell, LA 70458
www.dammonengineering.com
info@dammonengineering.com
PH: 985.649.5832


| # | DESCRIPTION | REVISIONS | DATE |
|---|---|---|---|

STATE OF LOUISIANA BRIAN A. MISTICH License No. 30187 PROFESSIONAL ENGINEER 1/3/2024

TANGIPAHOA CELL 16
LEACHATE &
STORMWATER
FORCEMAIN AND
SUPPORTING EQUIPMENT

TANGIPAHOA REGIONAL SOLID WASTE FACILITY
57510 HANO ROAD
INDEPENDENCE, LOUISIANA

| JOB No: | 2460 | DATE: | 9/30/2022 |
|---|---|---|---|
| DRAWN BY: | DPD | CHECKED BY: | BM |


The above drawings and specifications, designs and arrangements represented thereby are and shall remain the property of Dammon Engineering, and no part thereof shall be copied, disclosed to others, or used in connection with any work or project other than the specific project for which the have been prepared and developed without written consent of Dammon Engineering. Visual contact with these drawings or specifications shall constitute conclusive evidence of acceptance of these restrictions.


SHEET TITLE:
ELECTRICAL PLAN

DRAWING NUMBER:
E101