



NOTES
 REMOVE ALL ELECTRICAL EQUIPMENT, PUMP MOTORS, CONDUITS, WIREWAYS AND WIRING UNLESS NOTED OTHERWISE.
 RETAIN ELECTRICAL CONDUIT FROM THE FIRST FLOOR TO EACH FLOOR ABOVE.
 REMOVE ALL ELECTRICAL WIRE FROM 480 VOLT RISERS. RETAIN CONDUIT.

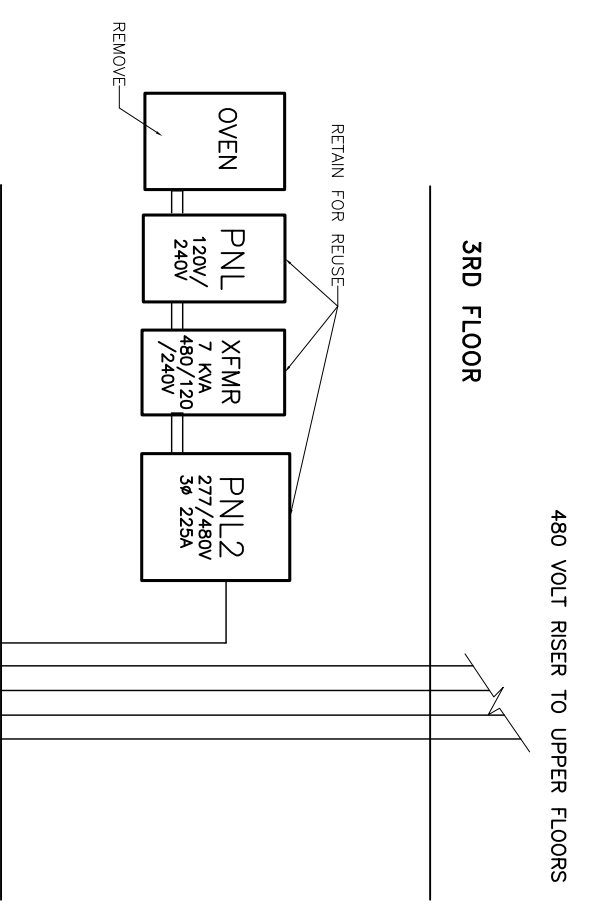

TYPICAL EXISTING ELECTRICAL DISTRIBUTION 2nd THRU 6th FLR. MECHANICAL ROOMS N.T.S.

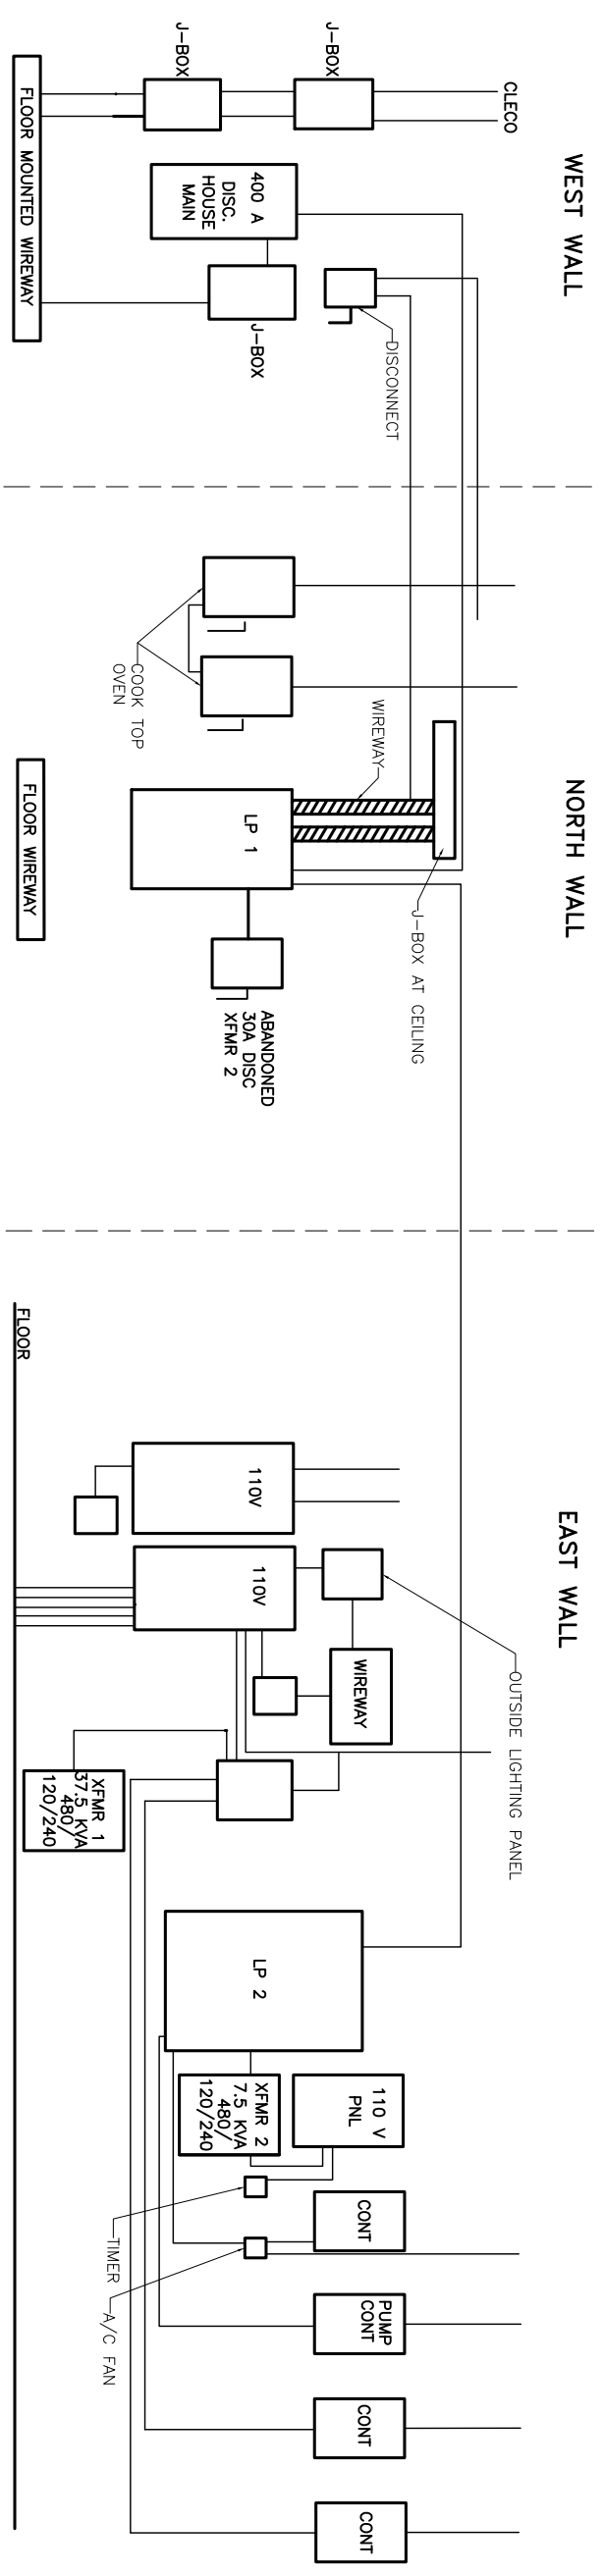

EXISTING ELECTRICAL DISTRIBUTION SYSTEM 1st FLOOR BOILER ROOM N.T.S.