



SITE PLAN - INFRASTRUCTURE
 SCALE: 1" = 100'-0"
 0 50' 100' 200'




- SPECIFIC NOTES THIS SHEET:**
- 1 PROVIDE CONCRETE MANHOLE, 6'X12', WITH H20 CAST IRON COVER MARKED COMMUNICATIONS.
 - 2 PROVIDE 6-4" SCH40 PVC CONDUITS, STACKED 2 HIGH, 3 WIDE. PROVIDE CHAIR RAILS AND STRAPPING AS NECESSARY TO AVOID SHIFTING DURING CONCRETE POUR. ENCASE IN 3000 PSI CONCRETE. TOP ELEVATION OF CONCRETE SHALL BE 36" BELOW GRADE. ADJUST DUCTBANK ELEVATION AS NECESSARY TO ROUTE THROUGH DRAINAGE SWALES, AND CROSSINGS OF OTHER EXISTING AND NEW UNDERGROUND UTILITIES.
 - 3 1-4"C: 48 STRAND SINGLE MODE OUTSIDE PLANT FIBER OPTIC CABLE, 24 STRAND SINGLE MODE OUTSIDE PLANT FIBER OPTIC CABLE, 25 PAIR, CAT3, UTP, OUTSIDE PLANT COPPER CABLE. 5-4"C: EMPTTY.
 - 4 TERMINATE NEW CONDUITS INTO END OF EXISTING MANHOLE. COORDINATE ALL WORK WITHIN MANHOLE WITH CONTRACTING OFFICER. NO ACCESS TO MANHOLE IS ALLOWED WITHOUT BASE PERSONNEL PRESENT AT ALL TIMES.
 - 5 UTILIZE EXISTING CONDUIT TO INSTALL 48 STRAND SINGLE MODE OUTSIDE PLANT FIBER OPTIC CABLE, 24 STRAND SINGLE MODE OUTSIDE PLANT FIBER OPTIC CABLE, 25 PAIR, CAT3, UTP, OUTSIDE PLANT COPPER CABLE. COORDINATE ALL WORK WITHIN MANHOLE AND EXISTING DUCTBANK WITH CONTRACTING OFFICER. NO ACCESS TO MANHOLES OR DUCTBANKS IS ALLOWED WITHOUT BASE PERSONNEL PRESENT AT ALL TIMES.
 - 6 EXISTING MANHOLE. COORDINATE ALL WORK WITHIN MANHOLE WITH CONTRACTING OFFICER. NO ACCESS TO MANHOLE IS ALLOWED WITHOUT BASE PERSONNEL PRESENT AT ALL TIMES.
 - 7 TERMINATE ALL CABLES AND INSTALL ALL HARDWARE AS SHOWN ON SHOP DRAWINGS WITHIN EXISTING MAIN TELECOMMUNICATIONS ROOM. COORDINATE ALL WORK WITHIN ROOM WITH CONTRACTING OFFICER. NO ACCESS TO ROOM IS ALLOWED WITHOUT BASE PERSONNEL PRESENT AT ALL TIMES.

PRE-FINAL SUBMISSION
 MAY 15, 2009
NOT FOR CONSTRUCTION

SYM	DESCRIPTION	DATE	APPR

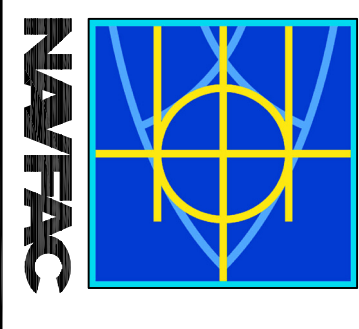

SCHLAFLY ENGINEERING LLC
 121 SOUTH GENOIS STREET
 NEW ORLEANS, LA 70119
 TEL: 504-885-1947
 FAX: 504-885-1930
M. KIMBALL SCHLAFLY, P.E.
 LA REG 27699

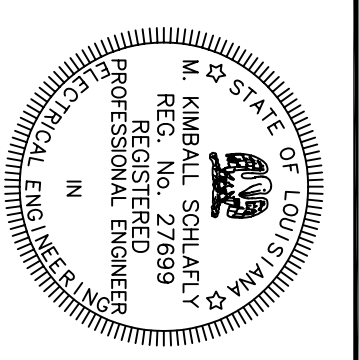

DES: K. SCHLAFLY/DWG: K. SCHLAFLY
 REVIEWED BY: R. WILSON
 PWD/CHK: T. ARMBR
 CHIEF ENGINEER: P. DAMON

DEPARTMENT OF THE NAVY
 NAVAL FACILITIES ENGINEERING COMMAND SOUTHEAST
 NAVAL AIR STATION JACKSONVILLE
 MISSISSIPPI
 JOHN C. STENNIS SPACE CENTER
SOF RIVERINE AND COMBATANT CRAFT OPERATIONS FACILITY
SITE PLAN - INFRASTRUCTURE

CODE ID: NO. N4412 SIZE: 0
 SCALE: 1" = 100'-0"
 DRAWING NO. #####
 STA. PROJ. NO. #####
 WORK ORDER NO. #####
 CONSTR. CONTR. NO. N62467-05-D-0096
 NAVFAC DRAWING NO. #####
 SHEET: XXX OF XXX