


OPERATIONS BLDG 2440
2ND FLOOR PLAN - TELECOMMUNICATIONS

SCALE: 1/8"=1'-0"
0 4' 8' 16'



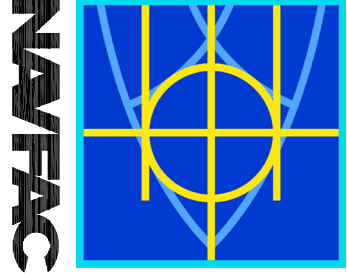
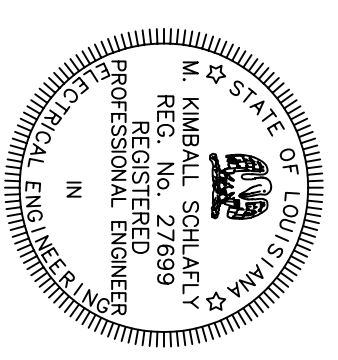
GENERAL NOTES. THIS SHEET:

1. REFERENCE INTERIOR DESIGN CID DRAWINGS FOR DIMENSIONED LOCATIONS OF ALL CABLE TV JACKS.
2. COORDINATE EXACT LOCATION OF ALL TELECOMMUNICATIONS JACKS WITH FURNITURE LOCATIONS. ADJUST ROUGH-IN TO AVOID CONFLICT WITH PARTITIONS MOUNTED TO WALLS.
3. TELECOMMUNICATIONS JACKS WITH SUBSCRIPT "F" INDICATE INSTALLATION IN FURNITURE PARTITIONS. PROVIDE FLEXIBLE CONDUIT CONNECTION AND EXTEND WIRING FROM WALL BOX THROUGH RACEWAY IN FURNITURE. PROVIDE JACKS AND BEZELS AS NEEDED TO COMPLETE INSTALLATION IN FURNITURE PARTITION.
4. ALL DEVICES SHALL BE FLUSH MOUNTED IN STUD WALLS OR WITHIN FURRING OVER CMU WALLS. 3/4" CONDUIT SHALL BE ROUTED IN SPACE ABOVE CEILING TO CABLE TRAY LOCATED OVER CORRIDOR.

SPECIFIC NOTES. THIS SHEET:

1. REFERENCE SHEET E4.2 FOR DESCRIPTION OF FLOOR BOX. PROVIDE SECURE JACKS (QUANTITY AS SHOWN) WITHIN ONE SIDE OF BOX, AND NON SECURE JACKS IN OPPOSITE SIDE. PROVIDE 3/4" RIGID STEEL ELBOW TO EXIT BOX INTO THE CEILING SPACE BELOW. ROUTE CONDUIT TO NEAREST WALL AS SHOWN AND ROUTE THROUGH FLOOR SLAB, INSIDE WALL, TO CABLE TRAY LOCATED ABOVE THE SECOND FLOOR CEILING.
2. 18" WIDE CENTER HUNG CABLE TRAY, ALUMINUM WITH 3" DEEP RUNGS SPACED 12" APART. NEMA LOAD RATING 12A. MONO-SYSTEMS LB 1133-0324-B. SUPPORT TO STRUCTURE ABOVE OR BRACE TO WALL STUDS AS REQUIRED TO MEET MANUFACTURER REQUIREMENTS FOR LOAD RATING. CABLE TRAY SHALL BE INSTALLED WITH BOTTOM OF TRAY AT 10'-6" AFF. ALL SECURE CAT5E CABLING SHALL BE ROUTED ON ONE SIDE, AND ALL NON-SECURE CAT5E CABLING SHALL BE ROUTED ON THE OTHER SIDE. 3/4" CONDUITS SHALL STUB TO APPROPRIATE SIDE OF TRAY 3" ABOVE TOP OF RUNG.
3. CONTINUE 2-2" C FROM FIRST FLOOR ELEC ROOM 113. ROUTE ABOVE CEILING TO RADIO ROOM #202. PENETRATE THROUGH WALL AND TERMINATE WITH BUSHED END.
4. LOCATION OF OUTSIDE PLANT CONDUITS. SEE SHEET E5.1 FOR CONTINUATION TO MANHOLE. 4" CONDUITS ARE FOR INCOMING INFRASTRUCTURE CABLING. 4-2" CONDUITS ARE FOR OUTGOING CABLING FOR SITE REQUIREMENTS. SEE SHEET E2.3 FOR FURTHER INFORMATION.

PRE-FINAL SUBMISSION
MAY 15, 2009
NOT FOR CONSTRUCTION

 <p>SCHLARTLY ENGINEERING, LLC 121 SOUTH GENOIS STREET NEW ORLEANS, LA 70119 PH: 504-885-1347 FAX: 504-885-1983 M. KIMBALL SCHLARTLY, P.E. LA REG 27699</p>	 <p>RES: K. SCHLARTLY / DRW: K. SCHLARTLY REVIEWED BY: R. WILISE P.N./CHK: T. ARMBR CHIEF ENGR/ARCH: P. DAMON</p>	<p>DEPARTMENT OF THE NAVY NAVAL FACILITIES ENGINEERING COMMAND NAVAL AIR STATION JACKSONVILLE MISSISSIPPI</p> <p>JOHN C. STENNIS SPACE CENTER SOF RIVERINE AND COMBATANT CRAFT OPERATIONS FACILITY</p> <p>BLDG 2440 2ND FLOOR PLAN - TELCO</p>	<p>NAVFAC DRAWING NO. N62467-05-D-0096 CONSTR. CONTR. NO. N62467-05-D-0096 WORK ORDER NO. ##### SHEET XXX OF XXX</p>
<p>DATE: _____</p>	<p>DESCRIPTION: _____</p>	<p>DATE: _____</p>	<p>APPR: _____</p>