



FIELD REBAR COLUMN LOCATION WITH METAL BUILDING MANUFACTURERS COLUMN LAYOUT PRIOR TO CONSTRUCTION. (TYP)


BLDG. 2441 FOUNDATION PLAN
SCALE: 1/8" = 1'-0"

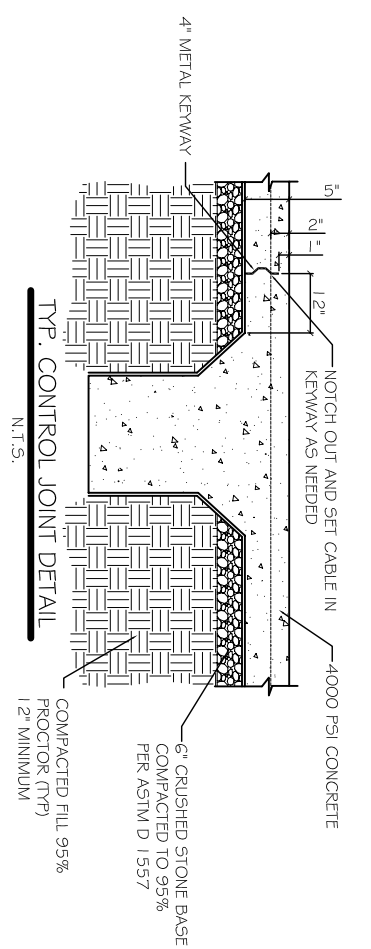


TYP. CONTROL JOINT DETAIL
N.T.S.

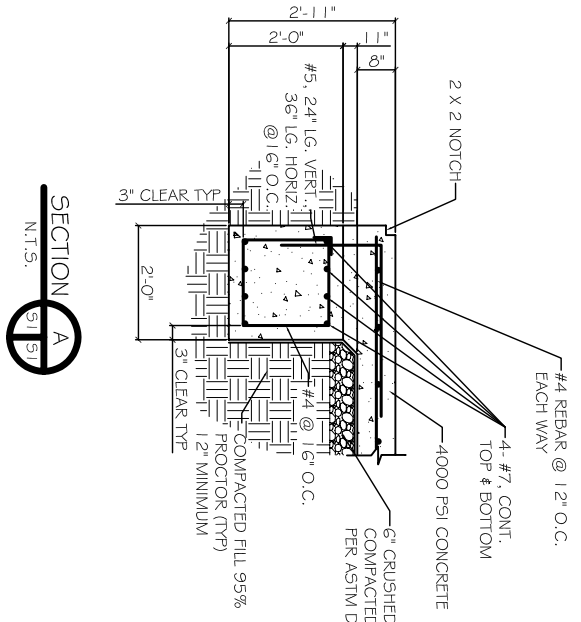


SECTION A-A
N.T.S.

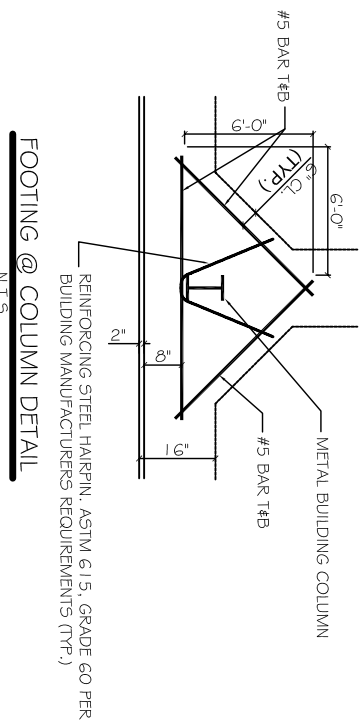


FOOTING @ COLUMN DETAIL
N.T.S.

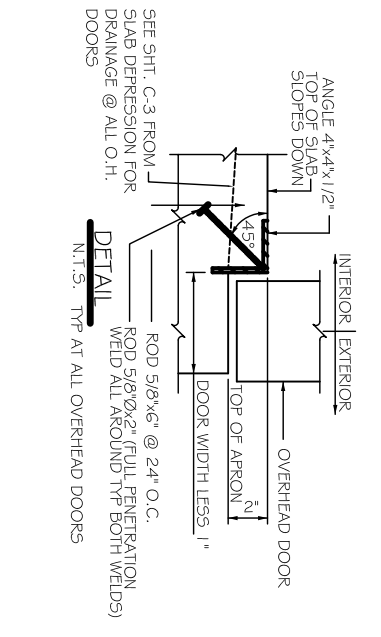

DETAIL
N.T.S. TYP AT ALL OVERHEAD DOORS

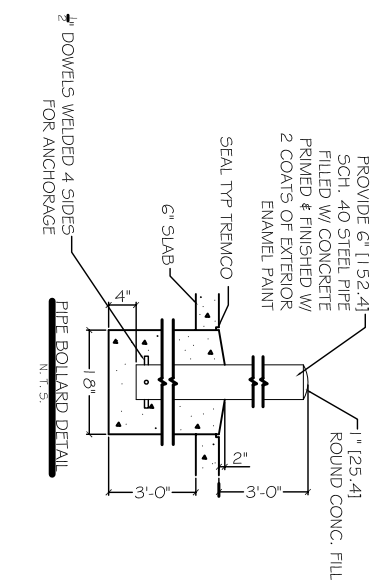


PIPE BOLLARD DETAIL
N.T.S.

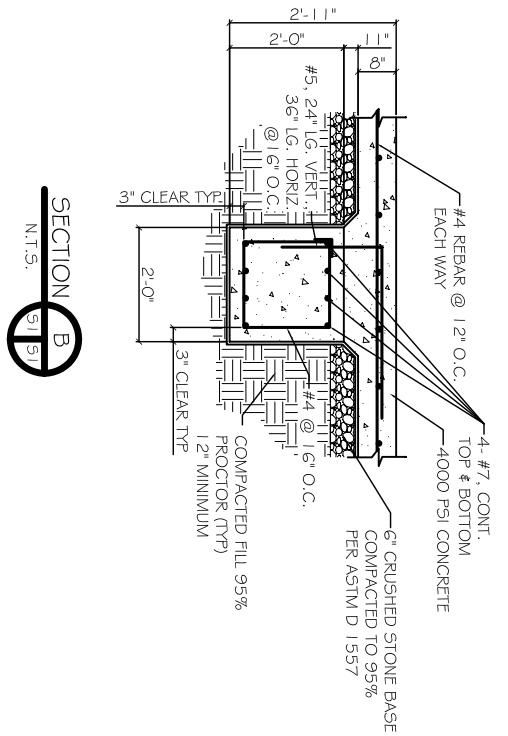

SECTION B-B
N.T.S.

- NOTES:**
1. THE CONCRETE MIX SHALL HAVE A MINIMUM COMPRESSIVE STRENGTH OF 3000 PSI AT 28 DAYS. CONCRETE MIX SHALL BE IN ACCORDANCE WITH ACI-8.
 2. ALL CONVENTIONAL REINFORCING STEEL SHALL MEET ASTM A615 (GRADE 60).
 3. ONE LAYER OF POLYETHYLENE VAPOR BARRIER SHALL BE PLACED UNDER ALL CONCRETE.
 4. ALL REINFORCING STEEL AND MESH SHALL BE SECURELY SUPPORTED TO PREVENT BOTH VERTICAL AND HORIZONTAL MOVEMENT DURING CONCRETE PLACEMENT.
 5. THE CONTRACTOR SHALL VERIFY ALL DROPS, OFFSETS, BRICK LEDGES, DIMENSIONS AND CONFIGURATIONS. CONTRACTOR MUST BE RESPONSIBLE FOR SAME.
 6. GRADE BEAM SIZES MAY VARY BY -.5%, +20%.
 7. ALL SUB GRADE FILL SHALL BE SELECT GRANULAR MATERIAL COMPACTED TO 95% STANDARD PROCTOR DENSITY IN A MAXIMUM OF 6" LIFTS.
 8. ALL RUNOFF WATER MUST BE CARRIED AWAY FROM THE SLAB TO PREVENT SATURATION OF THE SUB-BASE.
 9. ALL TREES WITHIN CLOSE PROXIMITY SHALL BE REMOVED TO PREVENT THE ROOTS FROM EXTENDING UNDER THE SLAB.
 10. PRIOR TO CONSTRUCTION, THE ARE OF THE STRUCTURE FOUNDATIONS SHOULD BE STRIPPED OF ALL VEGETATION, EXISTING FILL MATERIAL, SOFT OR LOOSE SURFACE SOILS, DELETERIOUS MATERIAL, ETC. ALL EXCAVATED MATERIAL SHOULD BE REPLACED WITH CONTROL COMPACTED STRUCTURAL FILL.
 11. PROVIDE AND MAINTAIN IMMEDIATE SITE DRAINAGE BEFORE, DURING, AND AFTER CONSTRUCTION. DRAIN ALL RAINWATER FROM THE CONSTRUCTION AREA. FOOTING EXCAVATIONS SHOULD BE OBSERVED AND CONCRETE PLACED AS QUICKLY AS POSSIBLE TO AVOID EXPOSURE OF THE FOOTING BOTTOMS TO WETTING AND DRYING. SURFACE RUNOFF WATER SHOULD BE DRAINED AWAY FROM THE EXCAVATIONS AND NOT BE ALLOWED TO POND PRIOR OR AFTER CONCRETE PLACEMENT. IF IT IS REQUIRED THAT A FOOTING EXCAVATIONS BE LEFT OPEN FOR MORE THAN ONE DAY, THEY SHOULD BE PROTECTED TO REDUCE EVAPORATION OR ENTRY OF MOISTURE. THE STRUCTURAL FILL COULD CONSIST OF RED CLAYS AND TYPE MATERIAL HAVING LESS THAN 30 PERCENT FINES PASSING THE NO. 200 SIEVE. IT SHOULD BE COMPACTED TO AT LEAST 95 PERCENT OF MAXIMUM DRY DENSITY AT OPTIMUM MOISTURE CONTENT ACCORDING TO ASTM D-698 (STANDARD PROCTER). IN PLACE DENSITY MEASUREMENTS SHOULD BE TAKEN TO ASSURE THAT THIS DEGREE OF COMPACTION IS ACHIEVED. FOR THIS CASE, THE FOOTINGS COULD BE SEATED IN THIS STRUCTURAL FILL USING THE ALLOWABLE SOIL BEARING CAPACITIES GIVEN BELOW.
 - 12.
 13. TREAT SOIL BELOW SLAB FOR TERMITES AS PER SPECIFICATION.



DAMMON ENGINEERING, INC.

CHIEF ENGINEER
EMMETT DAMMON, P.E.
CHIEF ARCHITECT
ROBERT WILTSE

1095 FLORIDA AVENUE
SUDELL, LA, 70458
OFFICE: 985-649-5832
FAX: 985-641-5950

WEBSITE:
WWW.DAMMONENGINEERING.COM
EMAIL:
DAMMONER@BELL SOUTH.NET

ARCHITECTURE
ENGINEERING
STUDIES
PLANNING
INVESTIGATION
EXPERT WITNESS

NEW RIVERINE
AND COMBATANT
CRAFT OPERATIONS
FACILITY

JOHN C. STENNIS
SPACE CENTER
MISSISSIPPI

BLDG 2441
FOUNDATION
PLAN

REV:	
SCALE:	AS NOTED
JOB#:	1986
DATE:	8-14-08
SHEET	51.2