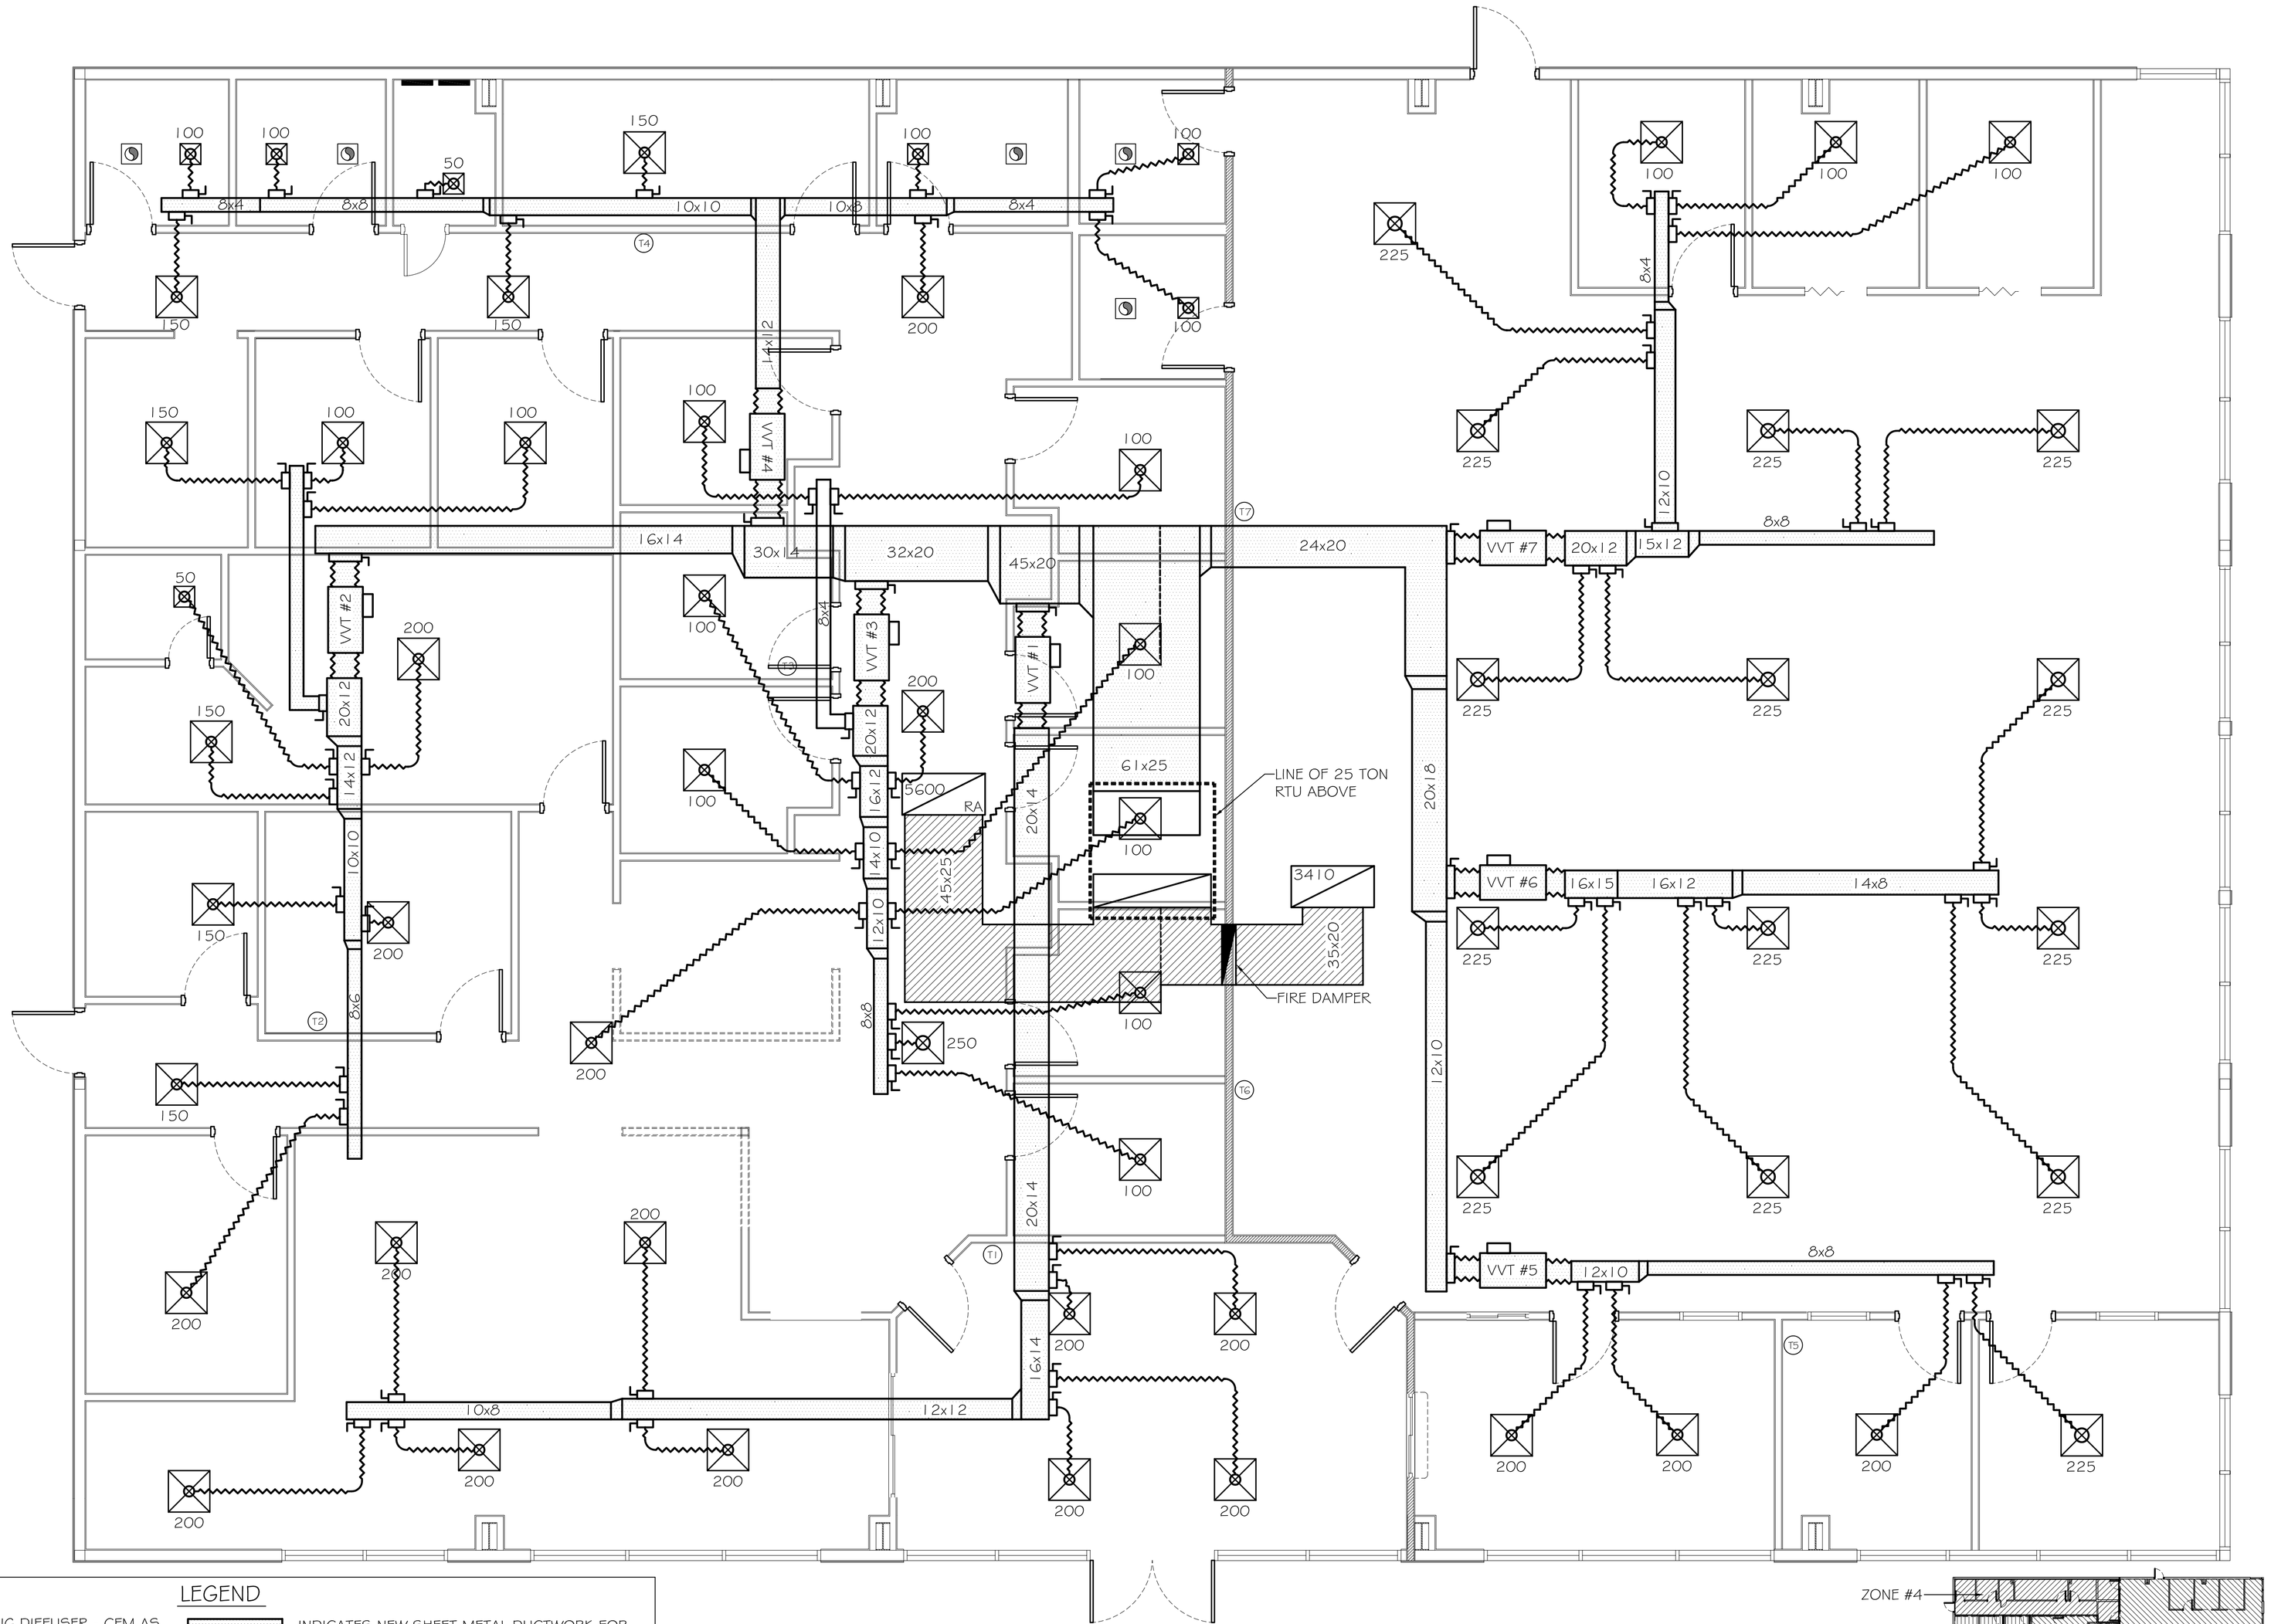

LEGEND

- ☒ - INDICATES NEW CEILING DIFFUSER - CFM AS NOTED - 24x24 UNLESS OTHERWISE NOTED.
- ▨ - INDICATES NEW RETURN AIR CEILING GRILLE OF SIZE INDICATED. TRANSFER DUCT TO BE RECTANGULAR AS INDICATED.
- ◙ - MECHANICAL VENT
- (T#) - THERMOSTAT
- VVT# - SINGLE DUCT VVT TERMINAL
- ▭ - INDICATES NEW SHEET METAL DUCTWORK FOR SUPPLY AIR, SIZES INDICATED ARE SHEET METAL DIMENSIONS
- ▨ - INDICATES NEW SHEET METAL DUCTWORK FOR RETURN AIR, SIZES INDICATED ARE SHEET METAL DIMENSIONS
- ~~~ - ROUND FLEX DUCT, MAX. LENGTH 12'-0", MIN. R-6 PROVIDE MAN. DAMPER AT DIFFUSER CONNECTIONS, SIZE AS INDICATED OR:
  0-200 CFM, USE 6"Ø
  201-300 CFM, USE 8"Ø
  301-400 CFM, USE 9"Ø

MECHANICAL PLAN

SCALE: 1/4"=1'-0"

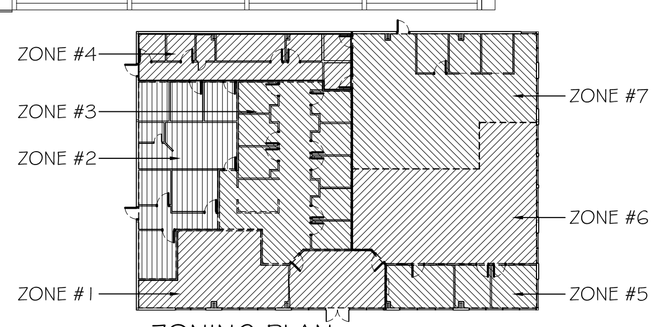

ZONING PLAN

N.T.S.

DAMMON
ENGINEERING, INC.

CHIEF ENGINEER
EMMETT
DAMMON, P.E.

CHIEF ARCHITECT
ROBERT
WILTSE

554 OLD SPANISH TRAIL
SLIDELL, LA. 70458
OFFICE: 985-649-5832
FAX: 985-641-5950

WEBSITE:
WWW.DAMMONENGINEERING.COM

EMAIL:
DAMMONENG@BELLSOUTH.NET

ARCHITECTURE

ENGINEERING

STUDIES

PLANNING

INVESTIGATION

EXPERT WITNESS

BRIAN FONG, M.D. Inc.
GAUSE BLVD.
SLIDELL, LA

MECHANICAL PLAN

REV:

SCALE: AS NOTED

JOB#: 2132

DATE: 04-17-12

SHEET

M-1

OF