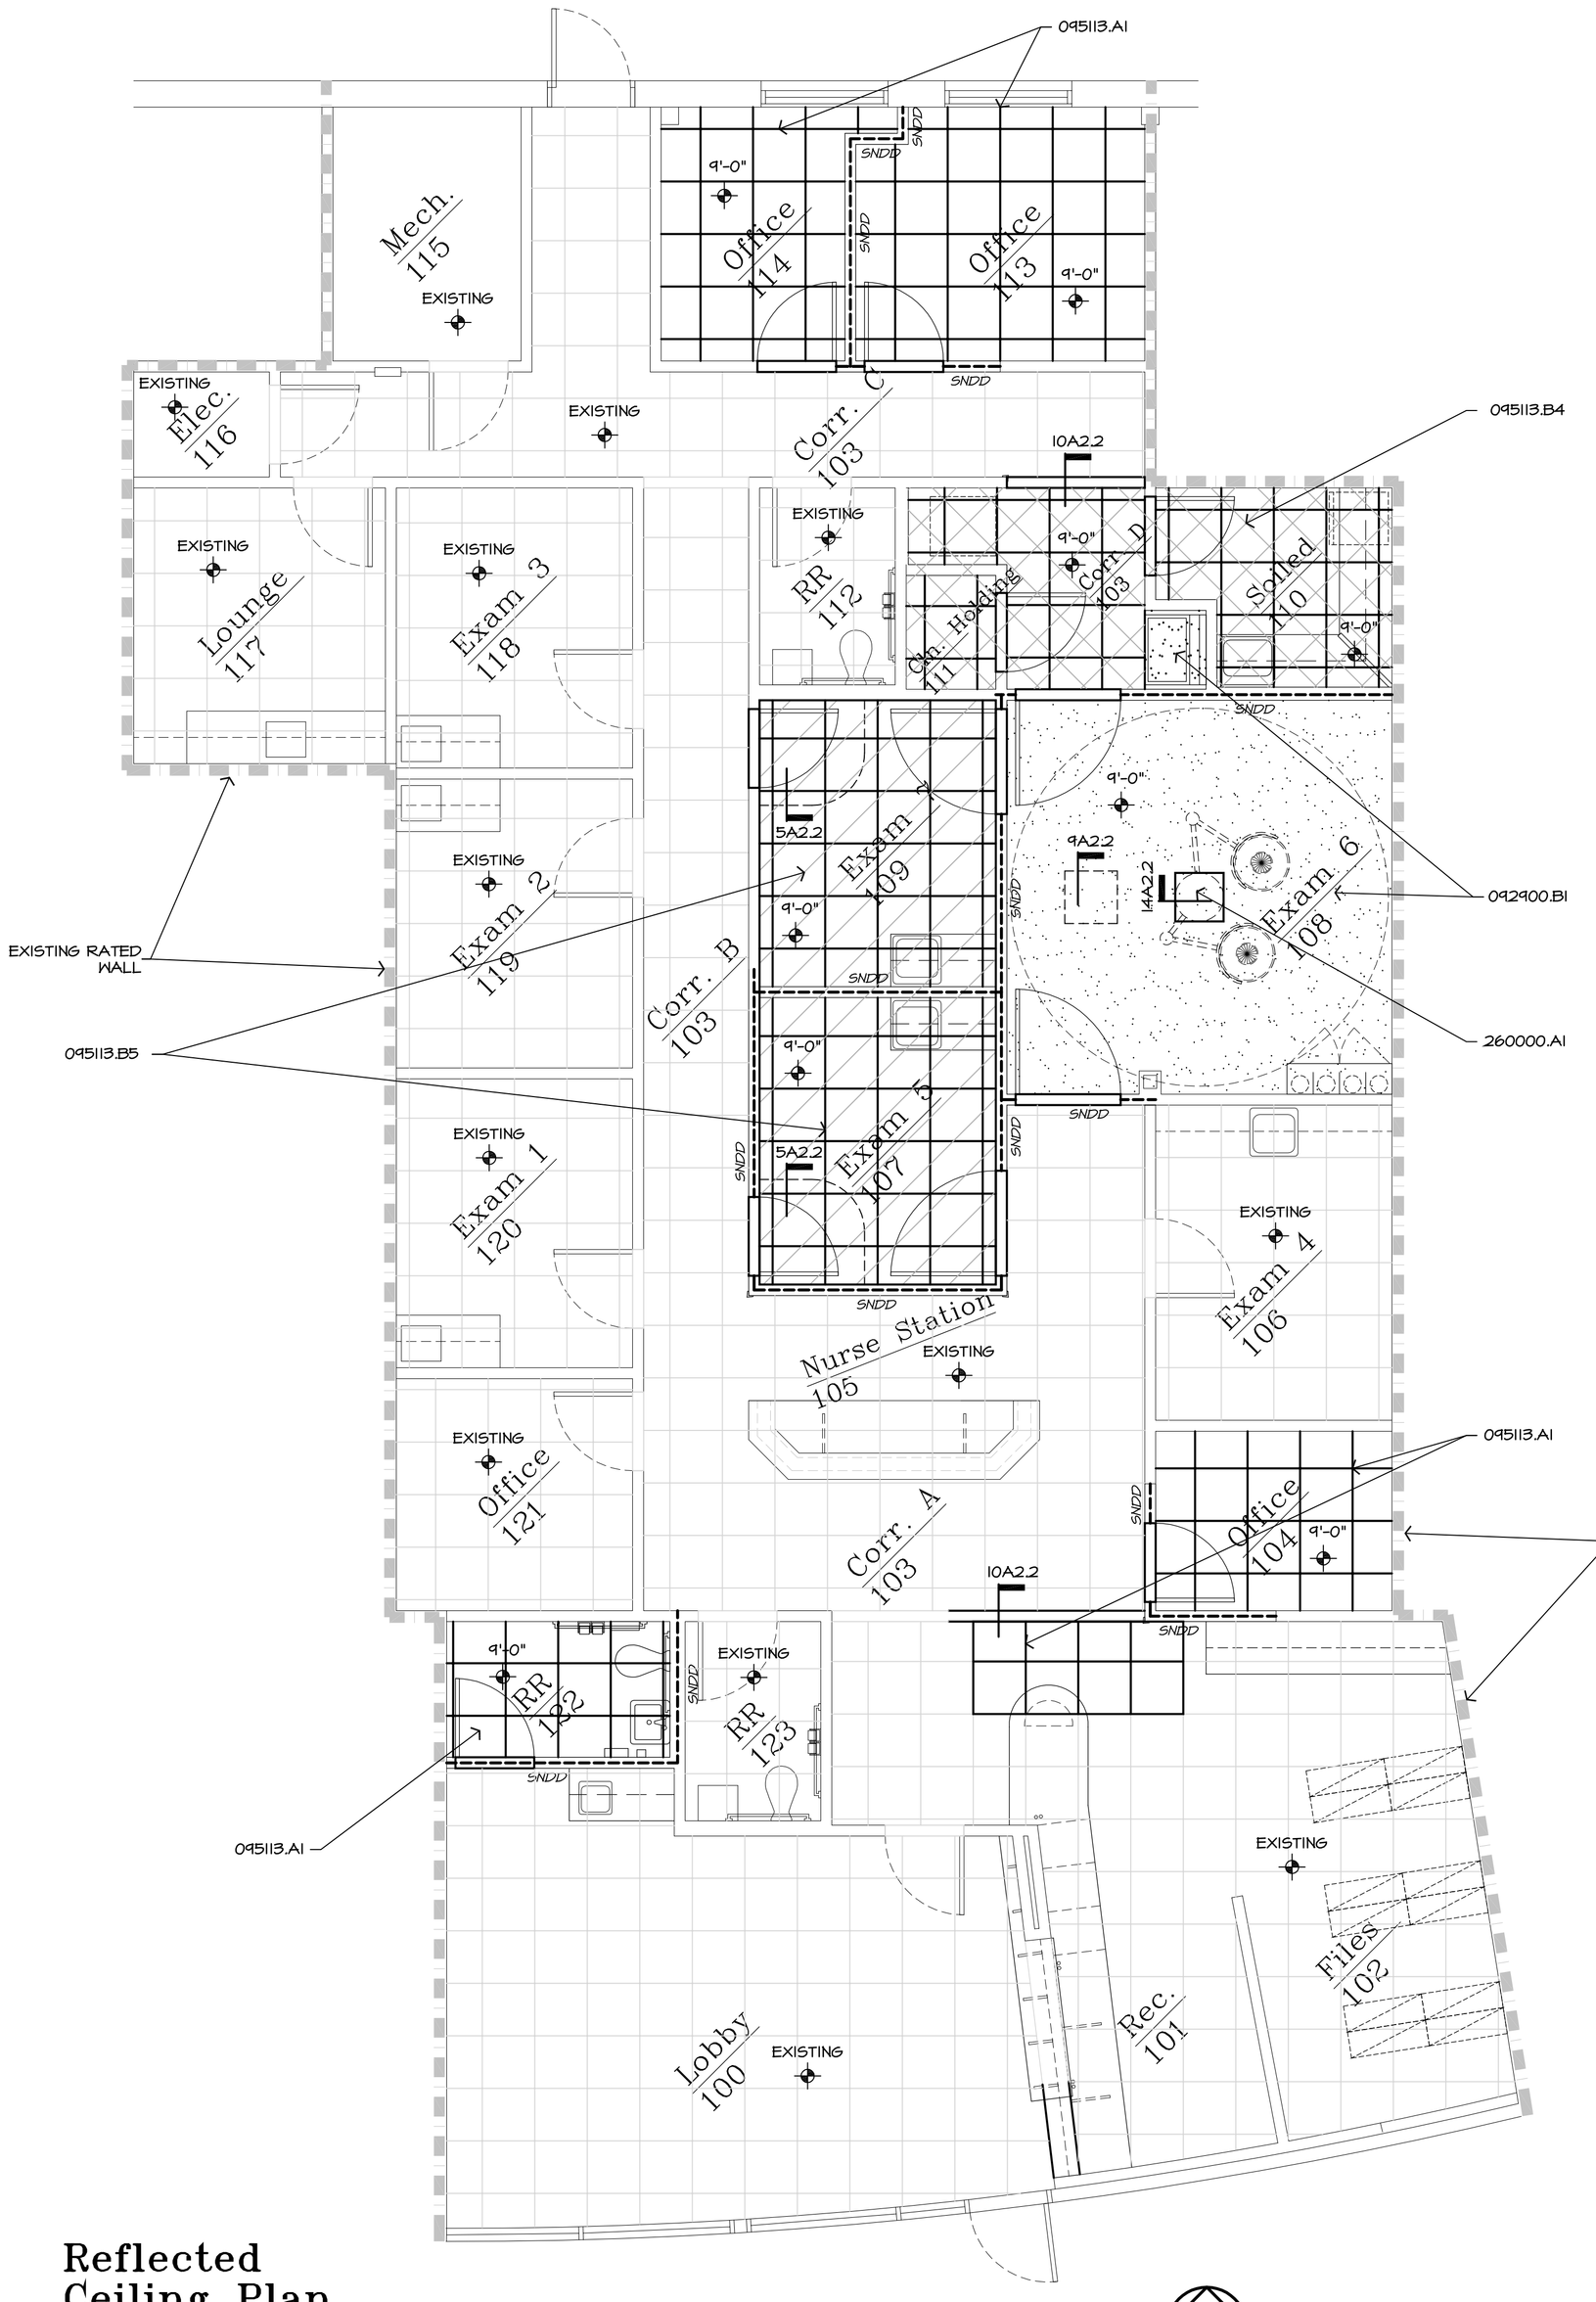

1 Reflected Ceiling Plan

0 4'

General Notes

1. LOCATE SUSPENDED CEILING HANGERS AND CHANNELS TO AVOID DUCTWORK AND PROVIDE SPACES FOR RECESSED LIGHT FIXTURES, DIFFUSERS AND CONVECTORS, ETC. SEE REFLECTED CEILING PLANS, ELECTRICAL AND MECHANICAL PLANS FOR LOCATIONS.
2. ALL PENETRATIONS IN DRYWALL CONSTRUCTION ABOVE FINISHED CEILINGS SHALL BE EFFECTIVELY SEALED TO PREVENT SOUND LEAKAGE.

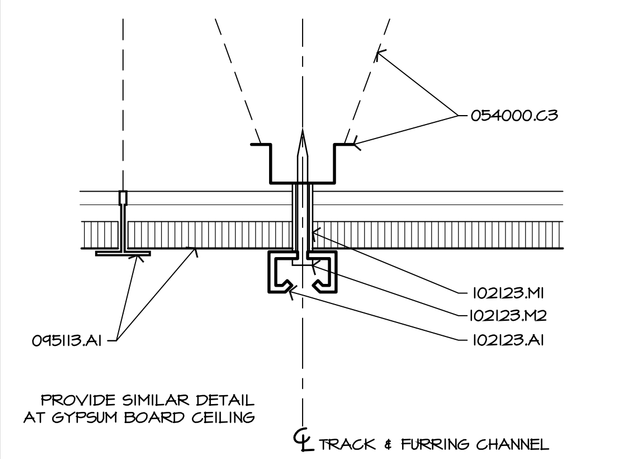

5 Ceiling Track Mounting Detail

0 3"

CEILING SHOWN
WALL SIMILAR

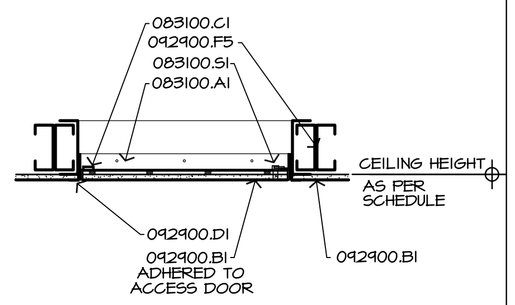

9 Gypsum Access Panel

0 1'

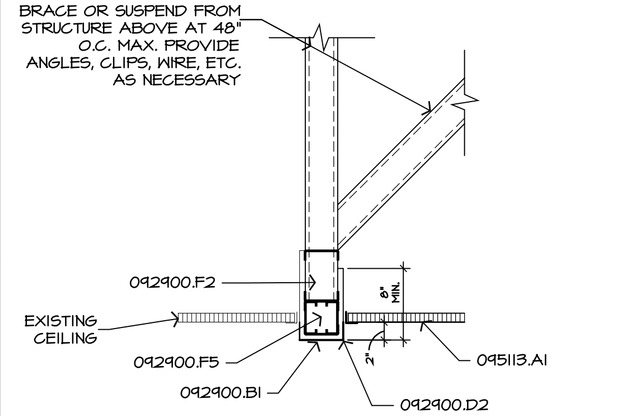

Typical 4" Bulkhead @ Existing Ceiling 10

0 1'

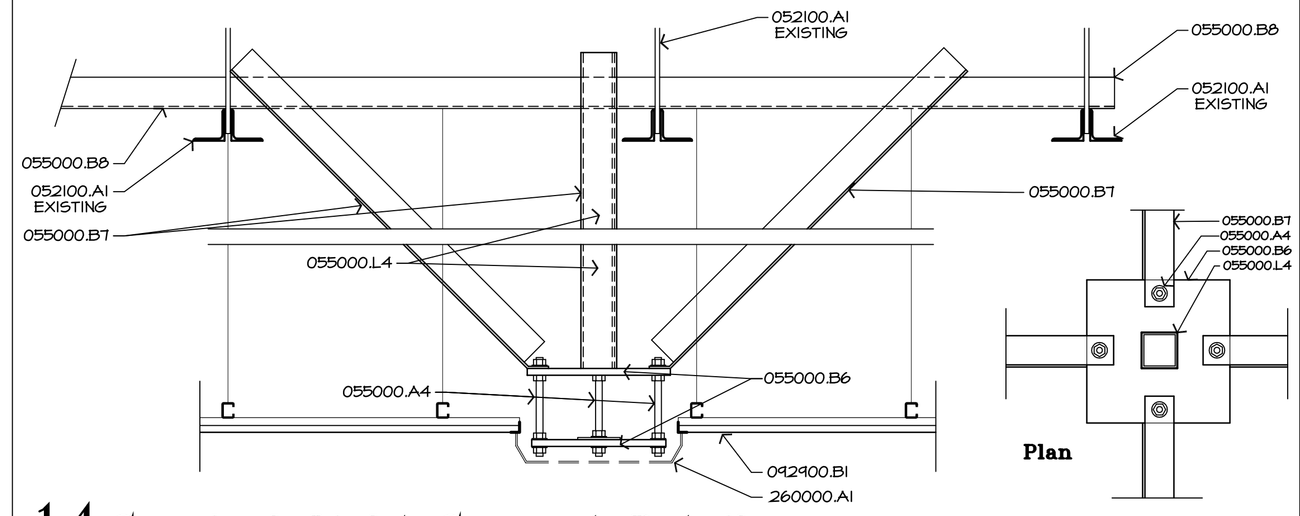

14 Surgical Light Support Detail

0 1'

Legend

APPLIES TO ALL PLANS THIS PAGE

- GYPSUM BOARD CEILING (092900.B1)
- 2X2 ACOUSTICAL CEILING TILE SYSTEM. (095113.A1)
- 2X2 VINYL COATED CEILING TILE 095113.B4
- 2X2 NON TEXTURE CEILING TILE 095113.B5
- 0'-0" — DENOTES BOTTOM OF ACOUSTICAL CEILING TILE OR BOTTOM OF FRAMING ON A GYPSUM BOARD OR STUCCO CEILING. WHERE CEILINGS VARY, SEE DRAWINGS.

KEYNOTE EXPLANATION

052100.A1	OPEN WEB BAR JOISTS; SEE STRUCTURAL.
054000.C3	1-1/2" FURRING CHANNELS SUSPENDED FROM STRUCTURE WITH NO. 12 WIRE AT 24" O.C.; PROVIDE OVER EACH SECTION OF CEILING TRACK.
055000.A4	3/4" DIAMETER X 11" BOLTS, TYPICAL.
055000.B6	3/4" SUPPORT PLATE, SIZE & HOLE LOCATION TO BE VERIFIED AND COORDINATED WITH FIXTURE SUPPLIER.
055000.B7	ANGLE 3 1/2 X 3 1/2 X 1/4 BRACE, FIELD WELDED TO STRUCTURE ABOVE AND BOLTED TO SUPPORT PLATE.
055000.B8	ANGLE 3 1/2 X 3 1/2 X 1/4 BRACE BOLTED TO A MINIMUM OF FOUR JOISTS.
055000.L4	T.S. 4X4X1/4 WELDED TO STRUCTURE AND TO SUPPORT PLATE.
083100.A1	ACCESS DOOR UNIT (24" X 24").
083100.C1	CONCEALED HINGE.
083100.S1	CAM AND STUD.
092900.B1	5/8" GYPSUM BOARD.
092900.D1	CONTINUOUS 'J' BEAD.
092900.D2	CONTINUOUS CORNER BEAD.
092900.F2	3-5/8" METAL STUD FRAMING AT 16" O. C.
092900.F5	BUILT-UP HEADER OR BUILT-UP JAMB SECTION.
095113.A1	SUSPENDED ACOUSTICAL CEILING SYSTEM.
095113.B4	2 X 2 VINYL COATED CEILING TILE.
095113.B5	2 X 2 NON TEXTURE CEILING TILE.
102123.A1	CUBICLE CURTAIN TRACK; (WHEN TRACK RUNS PERPENDICULAR TO BAR JOISTS, ATTACH AT 16" O.C. TO CONTINUOUS 1-1/2"COLD ROLLED BLOCKING, WHEN TRACK RUNS PARALLEL TO BAR JOISTS, ATTACH TO 1-1/2" GOLD ROLLED CHANNELS.)
102123.M1	METAL TUBE SPACER, LENGTH AS REQUIRED TO PROVIDE SOLID SHIM.
102123.M2	SCREW, SIZE AND SPACING AS RECOMMENDED BY TRACK MANUFACTURER.
260000.A1	LIGHT FIXTURE.

KEY PLAN

ARCHITECTS SOUTHWEST
A Professional Corporation
LAFAYETTE, LA.
(337) 237-2211

Medical Office Suite

Tenant Improvement for Dr. Hertzak, Suite D

Slidell La.

DATE	REVISED	NOTES
09/16/10		

© 2010 · Architects Southwest

ASW PROJECT NO. 10030

SHEET A2.2

___OF ___SHEETS