


ELECTRICAL LEGEND

SYMBOLS	DESCRIPTION
	RACEWAY AND WIRING, CONCEALED IN WALL OR ABOVE CEILING EXCEPT IN UNFINISHED AREA.
	JUNCTION, PULL OR TAP BOX, CEILING OR WALL MOUNTED
	FIRE ALARM SYSTEM MINI HORN AND STROBE LIGHT IN ALL ACES. HEARING IMPAIRED GUEST ROOMS CONNECTED TO MAIN BUILDING FIRE ALARM SYSTEM.
	DISTRIBUTION PANELBOARD SURFACE MOUNTED.
	SAFETY SWITCH, SIZE AND NUMBER OF POLES AS NOTED.
	MOTOR SWITCH, MANUAL.
	MOTOR CONNECTION
	LIGHTING FIXTURE AND OUTLET, WALL MOUNTED SEE NOTE 3.
	LIGHTING FIXTURE AND OUTLET, CEILING MOUNTED SEE NOTE 3.
	FLUORESCENT LIGHTING FIXTURE WITH OUTLET, WALL MOUNTED SEE NOTE 3.
	FLUORESCENT LIGHTING FIXTURE AND OUTLET, CEILING MOUNTED SEE NOTE 3.
	FLUORESCENT STRIP INDUSTRIAL LIGHTING FIXTURE AND OUTLET, CEILING MOUNTED, SEE NOTE 3.
	EXIT SIGN FIXTURE AND OUTLET, CEILING MOUNTED, DIRECTIONAL ARROWS AS INDICATED, SEE NOTE 3.
	EXIT SIGN FIXTURE AND OUTLET, WALL MOUNTED, DIRECTIONAL ARROWS AS INDICATED, SEE NOTE 3.
	EMERGENCY LIGHTING FIXTURE WITH BATTERY PACK
	LOCAL LIGHTING SWITCH, +48" A.F.F.
	LOCAL LIGHTING SWITCH, 3-WAY, +48" A.F.F.
	KEY OPERATED SWITCH +48" AFF (SINGLE POLE OR 3-WAY)
	DIMMER SWITCH
	TIMER SWITCH.
	TELEPHONE OUTLET, FLUSH WALL MOUNTED. +6" A.F.F., U.O.N.
	MATV OUTLET, FLUSH WALL MOUNTED. +12" A.F.F., U.O.N.
	GROUND FAULT INTERRUPTER, DUPLEX RECEPTACLE, 20A, 125V, 3W., WALL MTD NEMA 5-20R, MTD. +48" A.F.F. UON (15A IN GUEST ROOMS ONLY)
	DUPLEX RECEPTACLE, 20A 125V, 3W., WALL MOUNTED NEMA 5-20R, MTD. 15" A.F.F. UON (15A IN GUEST ROOMS ONLY)
	DOUBLE DUPLEX RECEPTACLE, 20A. 125V. 3W., WALL MOUNTED NEMA 5-20R, MTD. 15" A.F.F. UON (15A IN GUEST ROOMS ONLY)
	SPECIAL SINGLE RECEPTACLE
	FIRE ALARM SYSTEM PULL STATION, FLUSH MOUNTED. +48" A.F.F.
	FIRE ALARM SYSTEM HORN AND STROBE LIGHT +7'-6" A.F.F.
	FIRE ALARM STROBE LIGHT +6'-8" A.F.F. OR 6" DOWN FROM CEILING WHICHEVER IS LOWER PER A.D.A.
	GUEST ROOM 120V. SINGLE STATION MINI HORN & STROBE LIGHT & SMOKE DETECTOR ON WALL IN ALL GUEST ROOMS ACCESSIBLE OR HEARING IMPAIRED.
	GUEST ROOM 120V. SINGLE STATION MINI HORN & SMOKE DETECTOR 12" BELOW CEILING ON WALL IN ALL GUEST ROOMS NOT ACCESSIBLE OR HEARING IMPAIRED.
	FIRE ALARM SYSTEM SMOKE DETECTOR
	FIRE ALARM SYSTEM SPRINKLER RISER FLOW SWITCH.
	FLUSH FLOOR RECEPTACLE 20A, 125V, 3W - PROVIDE CARPET FLANGE
	HORN/STROBE FOR HEARING IMPAIRED DOOR SIGNAL PER A.D.A.
	2-GANG BOX WITH TRANSFORMER FOR DOOR SIGNAL PER A.D.A.
	PUSH BUTTON FOR DOOR SIGNAL PER A.D.A.
	RECEPTACLES W/ OUTLET BOX FOR THRU-WALL A/C UNIT.
	FIRE ALARM HOLD OPEN DOOR DEVICE
	TELEPHONE OUTLET, FLUSH FLOOR MOUNTED. WITH BRASS COVER
	LIGHTING FIXTURE AND OUTLET ON NIGHT LIGHT.

ELECTRICAL ORDINANCE
 ALL ELECTRICAL WORK SHALL BE INSTALLED IN ACCORDANCE WITH ALL REQUIREMENTS OF THE LATEST EDITION OF THE NATIONAL ELECTRICAL CODE, AS STATE, FEDERAL, COUNTY, OR LOCAL SUPPLEMENTS OR ADDITIONS, IN INSTANCES WHERE THE DRAWINGS AND THE NATIONAL ELECTRIC CODE ARE IN CONFLICT, THE WORK SHALL BE INSTALLED AS PER REQUIREMENTS OF THE NATIONAL CODE.

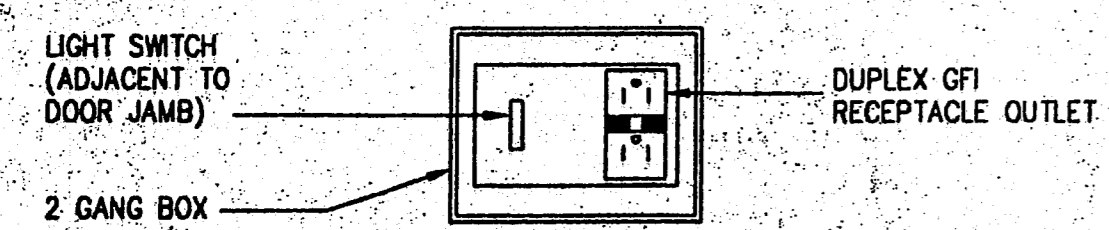

GUEST ROOM BATH WALL SWITCH
 NO SCALE

ELECTRICAL ABBREVIATIONS

A	AMPERES
AFF	ABOVE FINISHED FLOOR
AIC	AMPERES INTERRUPTING CAPACITY (MIN)
APPROX	APPROXIMATE
AWG	AMERICAN WIRE GAUGE
ANN	ANNUNCIATOR
BLDG	BUILDING
C	CONDUIT
CATV	CABLE TELEVISION
CKT	CIRCUIT
CONT	CONTINUATION
DIA	DIAMETER
DIM	DIMENSION
DP	DISTRIBUTION PANEL
DWG	DRAWING
EA	EACH
EC	EMPTY CONDUIT
ELEC	ELECTRICAL
EMT	ELECTRICAL METALLIC TUBING
EOL	END OF LINE RESISTOR
EQUIP	EQUIPMENT
EUH	ELECTRIC UNIT HEATER
EWI	ELECTRIC WALL HEATER
F	FUSED
FA	FIRE ALARM
FIN	FINISH
FIX	FIXTURE
FLUOR	FLUORESCENT
GFI	GROUND FAULT INTERRUPTER
GRND	GROUND
HP	HORSEPOWER
IG	ISOLATED GROUND
INCAN	INCANDESCENT
J	JUNCTION
KVA	KILO-VOLT-AMPERE
KW	KILOWATT
LGT	LIGHT
MATV	MASTER ANTENNA TELEVISION
MAX	MAXIMUM
MCM	THOUSAND CIRCULAR MILS
MDP	MAIN DISTRIBUTION PANEL
MIN	MINIMUM
MLO	MAIN LUGS ONLY
MPC	MINI POWER CENTER
MTG	MOUNT (ED),(ING)
N	NORTH
NEC	NATIONAL ELECTRICAL CODE
NIC	NOT IN CONTRACT
NO	NUMBER
NTS	NOT TO SCALE
OC	ON CENTER
OSHA	OCCUPATIONAL SAFETY AND HEALTH ADMINISTRATION
P	POLE
PMS	PROPERTY MANAGEMENT SYSTEM
PNL	PANEL
PVC	POLYVINYL CHLORIDE
RSC	RIGID STEEL CONDUIT
SD	SMOKE DETECTOR
SIM	SIMILAR
S/S	STAINLESS STEEL
TEL, T	TELEPHONE
XFMR	TRANSFORMER
TYP	TYPICAL
UL	UNDERWRITER LABORATORIES
UON	UNLESS OTHERWISE NOTED
V	VOLT
WP	WEATHERPROOF

LIGHTING FIXTURE SCHEDULE

ID.	MANUFACTURER	CATALOG NO.	LAMPS	VOLTAGE	MOUNTING	CONE FINISH	EXTERIOR FINISH	LOCATION & REMARKS
A	LITHONIA	C240SS-SEE NOTE 1	(2) F40/CW FLUOR.	120	SURFACE	---	WHITE	
B	LITHONIA	C230SS-SEE NOTE 1	(2) F30/CW FLUOR.	120	SURFACE	---	WHITE	
C		BY DIV 15	(1) 100W A19	120				FAN/LIGHT COMBO
D	THOMAS	RU-315	60W A19	120	RECESSED			SHOWER LIGHT
E	LITHONIA	R6C	150W PAR 38 COOL BEAM	120	RECESSED			
F	LITHONIA	A5AR	1-100 A19	120	RECESSED			
F 1	LITHONIA	A5AR	1-100 A19	120	RECESSED			
H	LITHONIA	LCP-CB2	1-75W R20/FL	120				CORR/STAIR LIGHT
K	LITHONIA	A5AR/SC	1-100 A19	120	RECESSED			
L	LITHONIA	ELN-E	2	120				6 VOLT DC 90 MIN BATTERY TEST
M	STONCO	VWXL11GC	100A19		WALL			ELEVATOR FIT (INCANDESCENT WALL BRACKET)
N	LAVRIN	CL-8600	1-100W A19	120				INCANDESCENT WALL BRACKET O.F.C.C.
P	LITHONIA	LB-240 A	2-F40/CW	120				WRAPAROUND
R	LITHONIA	SP-F-240-ALE-ES	2-F40/CW	120				
S	HADCO	WA3HV-N175-MHE12	1-175MH	120				EXTERIOR LIGHT
S1	LITHONIA	KSFJ-1000M-R3-SP04	1000W MH	208	POLE ON BASE	---	DARK BRONZE	SHOE BOX FIXTURE ON 30' POLE SSS-305C-DM19-DDB
S2	LITHONIA	KRSB-100M	100W METAL HALIDE BOLLARD	208	BOLLARD	---	DARK BRONZE	PROVIDE 24"x24"x12"D CONCRETE BASE WITH ANCHOR BOLTS
S3	LITHONIA	KFL2-250M-SP-208-YK	250W METAL HALIDE	208	FLOOD	---	DARK BRONZE	PROVIDE 24"x24"x12"D CONCRETE BASE WITH ANCHOR BOLTS

1 COVE CTD. FIXTURES TO BE SURFACE MTD. VIA 1/2" HIGH 1/2" DIAMETER PVC SPACER-2 PER FIXTURE. SOLID STATE BALLAST SHALL BE BY ADVANCE MARK V. OVERLAP MARK 'A' FIXTURE IN GUEST ROOM ENTRY COVES TO FIT AVAILABLE SPACE.

ELECTRICAL GENERAL NOTES

- ALL RECEPTACLES AND SWITCHES SHALL BE FLUSH MOUNTED FOR ALL AREAS. U.O.N.
- THE ELECTRICAL DRAWINGS ARE GENERALLY DIAGRAMATIC. THE ELECTRICAL INSTALLATION SHALL BE COORDINATED WITH ALL OTHER TRADES SO THAT INTERFERENCES BETWEEN THE ELECTRICAL INSTALLATION AND ARCHITECTURAL, STRUCTURAL, MECHANICAL, PLUMBING, FIRE PROTECTION AND EQUIPMENT INSTALLATION WILL BE AVOIDED. REFER TO ARCHITECTURAL DRAWINGS FOR DIMENSIONS, ROOM AND AREA FINISHES, CEILING PLANS, DOOR SWINGS, FIRE-RELATED PARTITIONS, CABINET AND CASE WORK AND BUILT-IN DETAILS
- LIGHTING FIXTURES IDENTIFICATION IS AS FOLLOWS: UPPER CASE LETTER (A)-DENOTES FIXTURE TYPE.
- CONTRACTOR SHALL PROVIDE ALL DISCONNECTS TO MEET LOCAL CODES.
- CONTRACTOR SHALL VERIFY ALL DOOR SWINGS BEFORE INSTALLING LIGHT SWITCHES. ALL LIGHT SWITCHES TO BE INSTALLED ON STRIKE SIDE OF DOOR UNLESS SPECIFICALLY NOTED OTHERWISE.
- ALL FINAL CONNECTIONS SHOWN ON THE DRAWINGS ARE ACTUAL REQUIREMENTS OF THE EQUIPMENT AND ARE SHOWN IN THEIR APPROXIMATE LOCATION.
- ALL MOTOR STARTERS SHALL BE PROVIDED BY THE MECHANICAL CONTRACTOR FURNISHING THE EQUIPMENT AND INSTALLED, WIRED AND CONNECTED BY ELECTRICAL CONTRACTOR
- NOT USED.
- ALL RECEPTACLES, HORNS, VISUAL INDICATORS, EMERGENCY LIGHTS, PULL STATIONS AND EXIT LIGHTS MOUNTED ON THE EXTERIOR OF THE BUILDING AND AT THE INDOOR POOL SHALL BE THE WEATHERPROOF TYPE.
- FOR ALL GUESTROOM SMOKE DETECTORS AND MINI-HORNS, CONTRACTOR SHALL INSTALL TWO ADJACENT ONE GANG BOXES, SMOKE DETECTORS SHALL BE CONNECTED TO POWER CIRCUIT, AND HORNS SHALL BE CONNECTED TO FIRE ALARM SYSTEM.
- ALL BATHROOM RECEPTACLES SHALL BE G.F.I. (TYP.)
- FOR GUESTROOM BATH WALL SWITCH, SEE DRAWING THIS SHEET.
- AUDIO/VISUAL INDICATOR SHALL BE INSTALLED ABOVE THE FIRE ALARM PULL STATION WHERE APPLICABLE AT APPROXIMATELY 6" BELOW CEILING.
- ALL EMERGENCY BATTERY PACKS SERVING STAIR, CORE, AND CORRIDOR LIGHTING SHALL BE CONNECTED TO THE SAME CIRCUIT SERVING THAT AREA PRIOR TO TIME SWITCH AND PHOTOCELL.
- ALL EXTERIOR EQUIPMENT AND DEVICES SHALL BE WEATHERPROOF AND RAIN TIGHT.
- COORDINATE LOCATION OF CATV CABLE STUB UP WITH THE RISER LOCATION FOR SATELLITE AND CABLE TV.
- COORDINATE ALL LIGHTING WITH MECHANICAL AND PLUMBING EQUIPMENT.
- THE ELECTRICAL CONTRACTOR SHALL WIRE THE EMERGENCY SYSTEM PER N.E.C. ARTICLE 700. PROVIDE LOW VOLTAGE WIRING AS REQUIRED.
- EMT IN FIXTURE SPEC INDICATES ELECTRONIC BALLAST FOR FLORESENT FIXTURES (ELECTRONIC MATTIOTT TRANSFORMER)

LLW, Inc.
 803 SOUTH MT. MORIAH, STE. 100B
 MEMPHIS, TENNESSEE 38117-5343
 901-683-7175/FAX 901-683-2885
 LEONARD MESSINA, ARCHITECT

revisions:
 FINAL REVIEW 8-28-97
 10-14-97

seal:

Steep Inn
 Jackson, Mississippi

title:
 LEGEND, NOTES
 FIXTURE
 SCHEDULE

date: 8-22-97
 job: 1697
 file: 1697-A47
 scale: 1/8"=1'-0"

sheet
15.1
 of 10