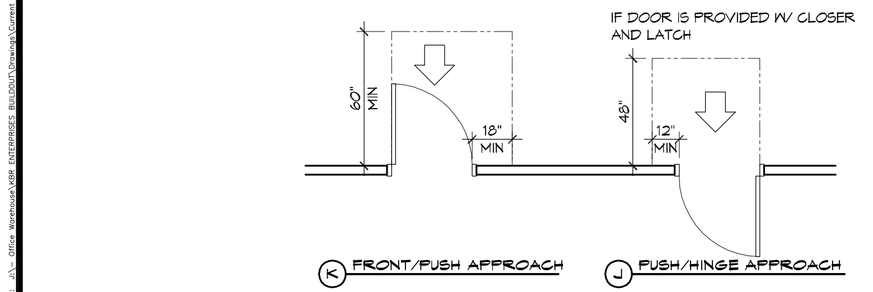

K FRONT/PUSH APPROACH J PUSH/HINGE APPROACH

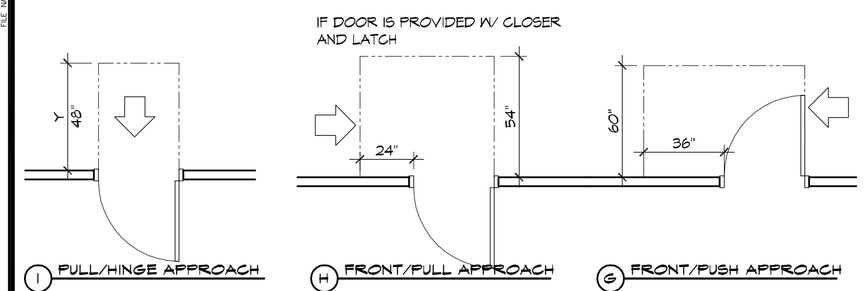

I FULL/HINGE APPROACH H FRONT/PULL APPROACH G FRONT/PUSH APPROACH

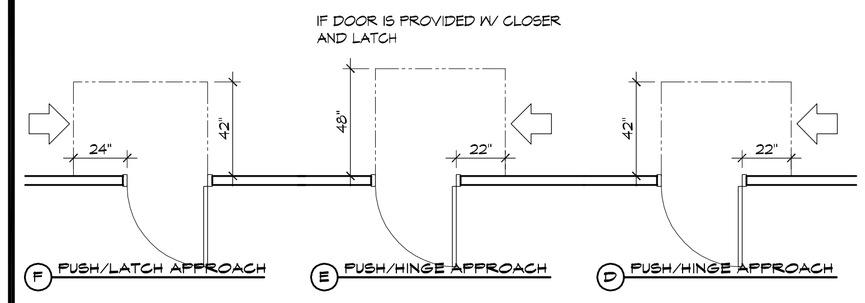

F PUSH/LATCH APPROACH E PUSH/HINGE APPROACH D PUSH/HINGE APPROACH

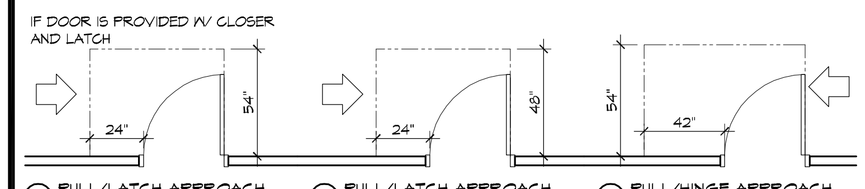

C PULL/LATCH APPROACH B PULL/LATCH APPROACH A PULL/HINGE APPROACH

3 ADA DOOR CLEARANCES
SCALE: 1/4" = 1'-0"

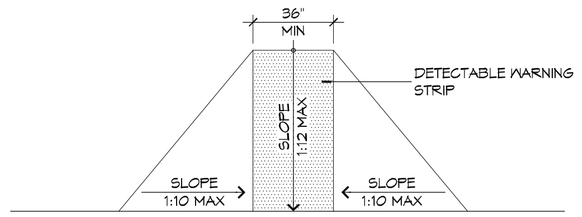

F FLARED RAMPS

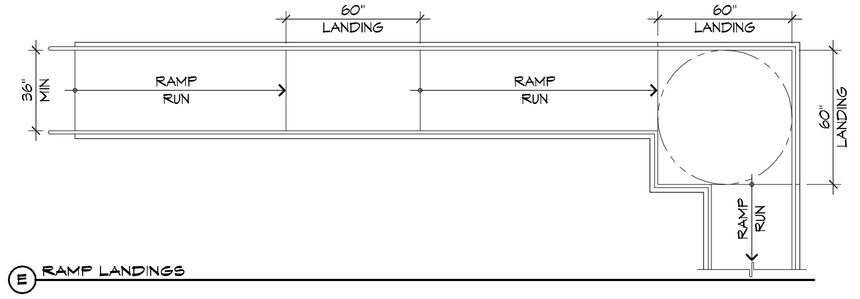

E RAMP LANDINGS

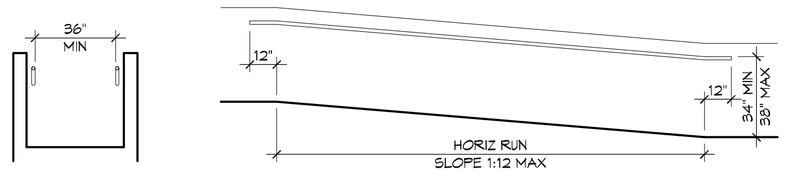

D WALL EDGE PROTECTION

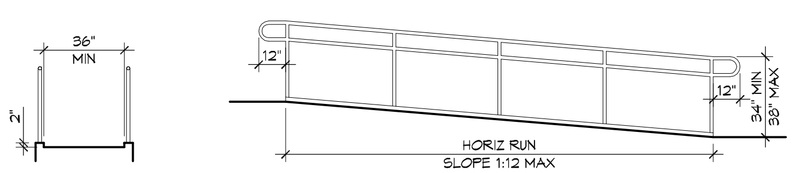

C CURB EDGE PROTECTION

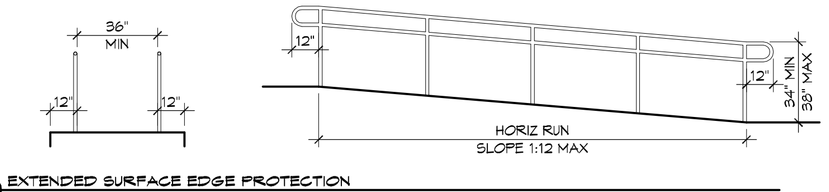

B EXTENDED SURFACE EDGE PROTECTION

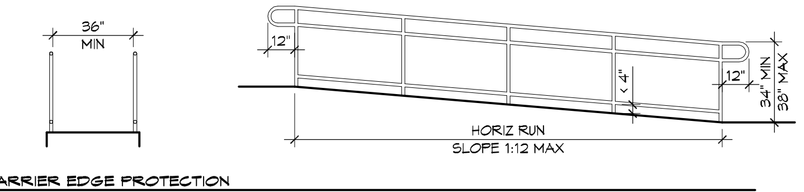

A BARRIER EDGE PROTECTION

4 ACCESSABLE RAMPS
SCALE: 1/4" = 1'-0"

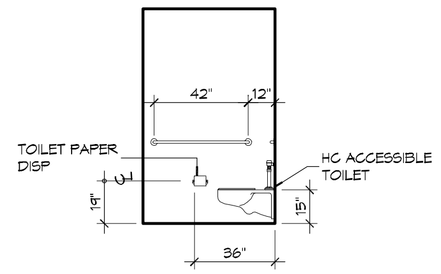

P INTERIOR ELEVATION

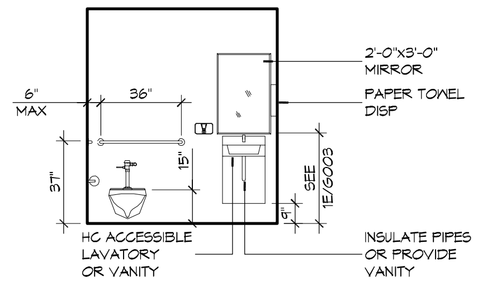

C INTERIOR ELEVATION

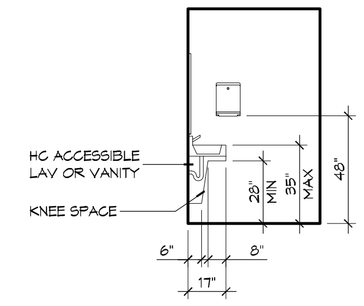

E INTERIOR ELEVATION

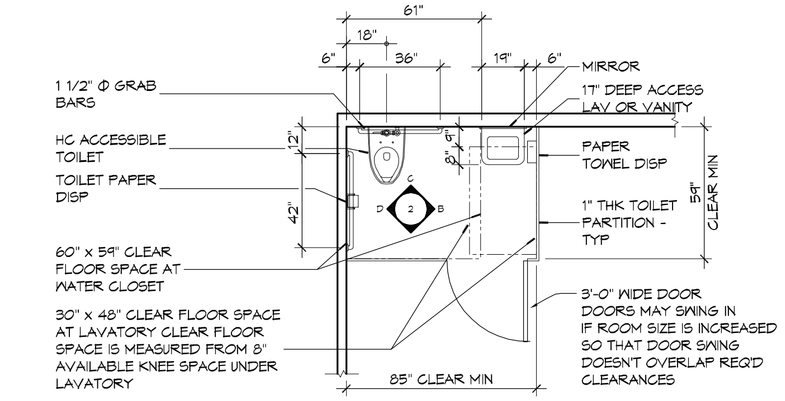

A FLOOR PLAN

2 RESTROOM CLEARANCES
SCALE: 1/4" = 1'-0"

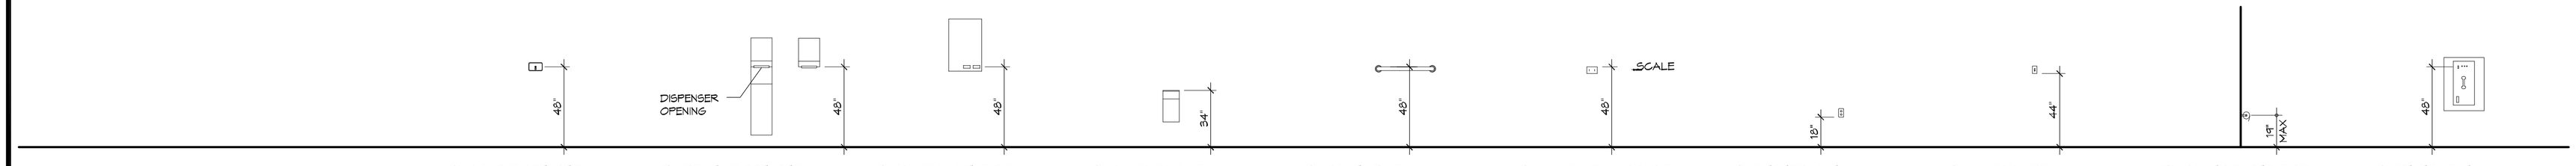

U SOAP DISPENSER T TOWEL DISPENSER S TAMPON VENDOR R SANITARY NAPKIN Q TOWEL BAR F ALARM PULL STATION O RECEPTACLE N LIGHT SWITCH M TOILET PAPER DISP L TELEPHONE

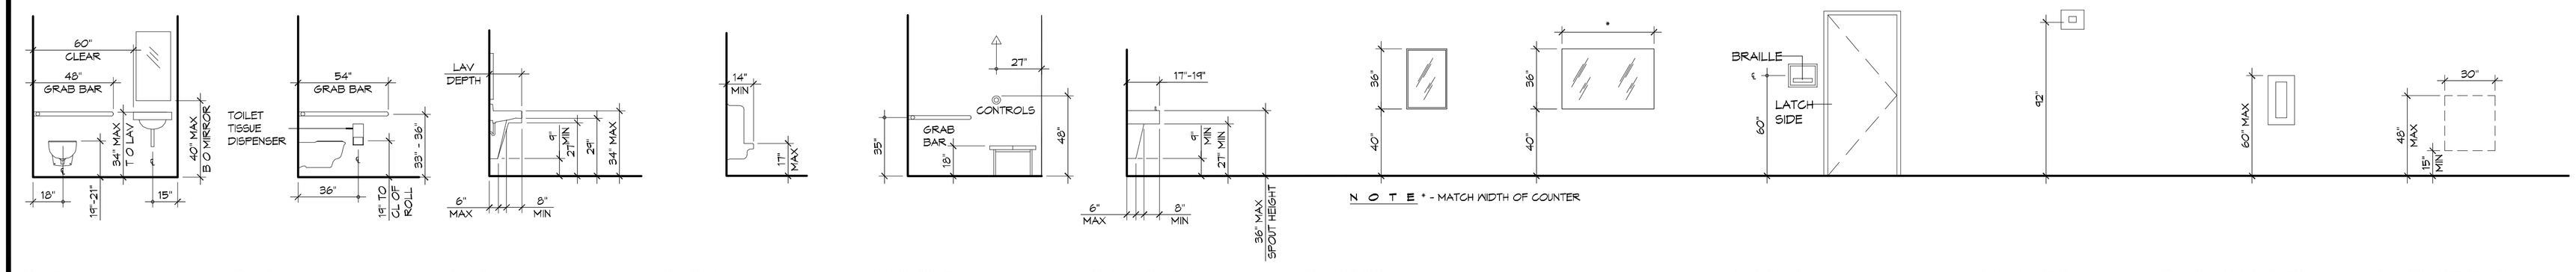

K TOILET J TOILET I TOILET H URINAL G SHOWER F WATER FOUNTAIN E MIRRORS D SIGNAGE C VISUAL ALARMS B FIRE EXTINGUISHER A FORWARD REACH

1 MOUNTING HEIGHTS
SCALE: 1/4" = 1'-0"

GENERAL SHEET NOTES

DOOR CLEARANCE NOTES

1. ALCOVES SHALL COMPLY WITH THE CLEARANCES FOR FRONT APPROACHES. 3I/G003 - 3K/G003.
2. DOOR HARDWARE SHALL BE LEVER TYPE.
3. MAX DOOR OPENING FORCE:
   - A. INTERIOR HINGED DOORS: 5 LBF
   - B. EXTERIOR HINGED DOORS: 8.5 LBF
   - C. SLIDING OR FOLDING DOORS: 5 LBF
   - D. FIRE DOORS SHALL HAVE THE MINIMUM OPENING FORCE ALLOWABLE BY THE APPROPRIATE ADMINISTRATIVE AUTHORITY.
4. HARDWARE REQUIRED FOR ACCESSIBLE DOOR PASSAGE SHALL BE MOUNTED NO HIGHER THAN 48" AND NOT LESS THAN 34" ABOVE FINISHED FLOOR.
5. THE FLOOR OR GROUND AREA WITHIN THE REQUIRED CLEARANCES SHALL BE LEVEL AND CLEAR.
6. THRESHOLDS AT DOORWAYS SHALL NOT EXCEED 3/4" IN HEIGHT FOR EXTERIOR SLIDING DOORS OR 1/2" FOR OTHER TYPES OF DOORS. RAISED THRESHOLDS AND FLOOR LEVEL CHANGES AT ACCESSIBLE DOORWAYS SHALL BE BEVELED WITH A SLOPE NO GREATER THAN 1:2.
7. DOORWAYS SHALL HAVE A MINIMUM CLEAR OPENING OF 32" WITH THE DOOR OPEN 90°, MEASURED BETWEEN THE FACE OF THE DOOR AND THE OPPOSITE STOP. OPENINGS MORE THAN 24" IN DEPTH SHALL MAINTAIN 32" MIN CLEARANCE.

RAMP NOTES

1. THE CLEAR SPACE BETWEEN THE HANDRAIL AND THE WALL SHALL BE MIN 1 1/2" CLEAR.
2. GRIPPING SURFACES SHALL BE CONTINUOUS AND UNOBSTRUCTED..
3. ENDS OF HANDRAILS SHALL BE EITHER ROUNDED OR RETURNED SMOOTHLY TO FLOOR, WALL, OR POST.
4. HANDRAILS SHALL NOT ROTATE WITHIN THEIR FITTINGS.
5. THE CROSS SLOPE OF RAMP SURFACES SHALL BE NO GREATER THAN 1:50.
6. OUTDOOR RAMPS AND THEIR APPROACHES SHALL BE DESIGNED SO THAT WATER WILL NOT ACCUMULATE ON WALKING SURFACES.
7. RAMPS AND LANDINGS WITH DROP-OFFS SHALL HAVE CURBS, WALLS, RAILINGS, OR PROJECTING SURFACES THAT PREVENT PEOPLE FROM SLIPPING OFF THE RAMP. CURBS SHALL BE A MINIMUM OF 2" HIGH.
8. HANDRAILS SHALL BE PROVIDED ALONG BOTH SIDES OF RAMP SEGMENTS. THE INSIDE HANDRAIL ON SWITCHBACK OR DOGLEG RAMPS SHALL ALWAYS BE CONTINUOUS.
9. RAMP LANDINGS SHALL BE AT LEAST AS WIDE AS THE RAMP RUN LEADING TO IT.

DAMMON ENGINEERING, INC.
Architects & Engineers
Chief Architect: Kevin J. Klocheck, NCARB
Chief Engineer: Brian Mistich, PE
554 Old Spanish Trail
Slidell, LA 70458
www.dammonengineering.com
info@dammonengineering.com
PH: 985.649.5832
FX: 985.641.5950

REVISIONS

#	DESCRIPTION	DATE

SEAL:

The above drawing and specifications, ideas and arrangements represented thereby are and shall remain the property of the Architect and no part thereof shall be copied, disclosed to others or used in connection with any work or project other than the specific project for which they have been prepared and developed without the written consent of the Architect. Visual contact with these drawings or specifications shall constitute conclusive evidence of acceptance of these restrictions.

OFFICE BUILDOUT FOR
KBR ENTERPRISES
176 STRAWBERRY STREET
SLIDELL, LOUISIANA 70460

JOB No:	2221	DATE:	KJK
DRAWN BY:	KJK	CHECKED BY:	KJK

SHEET TITLE:
ADAAG INFORMATION

DRAWING NUMBER:
G002

SHEET No: 2 of 11