


1ST FLOOR POWERLIGHTING
SCALE: 1/4"=1'

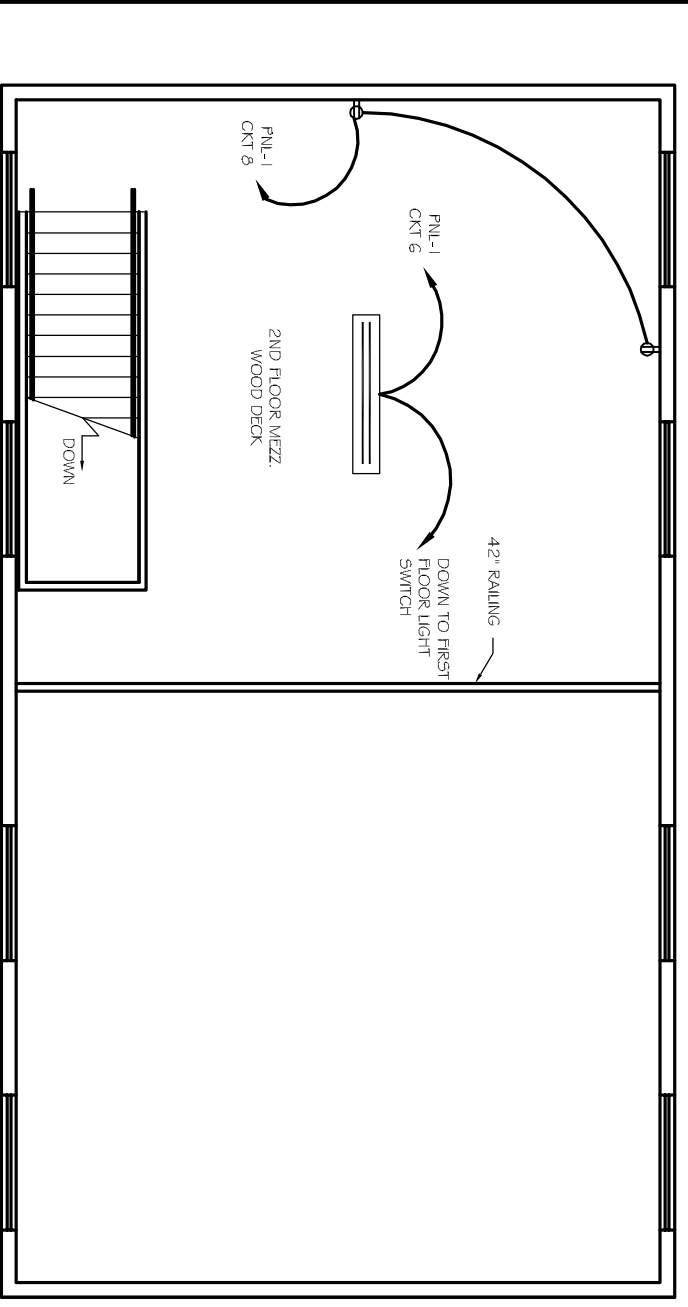

2ND FLOOR POWERLIGHTING
SCALE: 1/4"=1'

LEGEND	
	4. FOUR BULB FLUORESCENT LIGHTING.
	6. TWO BULB FLUORESCENT LIGHTING.
	EXTERIOR LIGHT FIXTURE WITH 90 MIN. BACKUP.
	EMERGENCY LIGHTING WITH 90 MINUTE BATTERY BACKUP.
	WALL OR CEILING MOUNTED EMERGENCY EXIT LIGHT WITH 90 MIN. BATTERY BACKUP.
	WALL MOUNTED LIGHT SWITCH.
	JUNCTION BOX

CIRCUIT NO.	THRN WIRE SIZE	LOCATION	BREAKER		LOAD (VA)	% BS	LOAD (VA)		BREAKER		LOAD DESCRIPTION	THRN WIRE SIZE	CIR. NO.
			AMP	POLE			AMP	POLE					
1	#12	RECEPTACLES GROUND FLOOR	20	1	1040	100	1	20	1	20	RECEPTACLES GROUND FLOOR	#12	2
3	#12	EXT. DIRECTIONAL DIVIDOR WALLMNT. LIGHT	20	1	620	100	1	20	1	20	EXT. DIRECTIONAL DIVIDOR WALLMNT. LIGHT	#12	4
5	#12	LIGHTS GROUND FLOOR	20	1	400	100	1	20	1	20	LIGHTS GROUND FLOOR	#12	6
7	#12	ROLL UP DOOR CIRCUIT	20	1	180	100	1	20	1	20	RECEPTACLES SECOND FLOOR	#12	8
9	#12	SPACEL	20	1	-	100	1	20	1	20	RECEPTACLES SECOND FLOOR	#12	10
11	#12	SPACEL	20	1	-	100	1	20	1	20	SPACEL	#12	12
13	#12	SPACEL	20	1	-	100	1	20	1	20	SPACEL	#12	14
15	#12	SPACEL	20	1	-	100	1	20	1	20	SPACEL	#12	16
17	#12	SPACEL	20	1	-	100	1	20	1	20	SPACEL	#12	18
19	#12	SPACEL	20	1	-	100	1	20	1	20	SPACEL	#12	20
21	#12	SPACEL	20	1	-	100	1	20	1	20	SPACEL	#12	22
23	#12	SPACEL	20	1	-	100	1	20	1	20	SPACEL	#12	24
TOTAL CONNECTED LOAD (VA)=53,396					400		20		20		GROUND BUS (GROUND WIRE) 60		

ELECTRICAL NOTES

1. ALL WORK SHALL CONFORM TO THE LATEST EDITION OF THE NATIONAL ELECTRICAL CODE, THE GOVERNING ELECTRICAL CODE AND ALL OTHER INSPECTION DEPARTMENT'S HAVING JURISDICTION. OBTAIN CERTIFICATES OR APPROVAL WHERE REQUIRED.
2. ALL MATERIALS FURNISHED SHALL BE NEW AND SHALL BE U.L. LISTED.
3. THE DRAWINGS INDICATE SIZE AND GENERAL LOCATION OF WORK. SCALE DIMENSIONS SHALL NOT BE USED. THE EXACT LOCATION AND LOCATION OF ALL LIGHTING FIXTURES, RECEPTACLES AND TELEPHONE OUTLETS, ETC. SHALL BE DETERMINED BY ACTUAL CONDITIONS IN THE FIELD.
4. PRIOR TO BIDDING, CONTRACTOR SHALL VISIT THE JOB SITE AND FAMILIARIZE THEMSELVES WITH THE EXISTING CONDITIONS.
5. ELECTRICAL CONTRACTOR SHALL COORDINATE HIS WORK WITH OTHER TRADES AND WITH OTHER CONTRACTORS WHOSE WORK MAY AFFECT THIS INSTALLATION.
6. ELECTRICAL CONTRACTOR SHALL COORDINATE INCOMING ELECTRICAL SERVICE WITH UTILITY COMPANY AND INCLUDE IN HIS BID ALL CHARGES AND FEES INCURRED IN MODIFICATIONS, WHERE MORE THAN ONE SWITCH OCCURS IN THE SAME LOCATION. THEY SHALL BE INSTALLED IN A GANG TYPE BOX UNDER ONE COVER PLATE.
7. ELECTRICAL CONTRACTOR SHALL COORDINATE THE TELEPHONE INSTALLATION WITH THE TELEPHONE COMPANY AND THE GENERAL CONTRACTOR.
8. ELECTRICAL CONTRACTOR, BEFORE INSTALLING ANY OF THE WORK, SHALL SEE THAT IT DOES NOT INTERFERE WITH CLEARANCES REQUIRED FOR FINISHED COLUMNS, HUNG CEILINGS, PLASTER, PARTITIONS, WALLS, ETC. AS SHOWN IN THE ARCHITECTURAL DRAWINGS AND DETAILS. IF ANY WORK IS INSTALLED AND IT LATER DEVELOPS THAT SUCH DETAILS OR DESIGN CANNOT BE FOLLOWED, THE CONTRACTOR, AT HIS OWN EXPENSE, SHALL MAKE SUCH CHANGES IN THE WORK AS DIRECTED BY THE ARCHITECT, AS WELL AS TO PERMIT THE INSTALLATION OF THE ARCHITECTURAL WORK AS SHOWN ON THE PLANS AND DETAILS.
10. PERFORM TEST REQUIRED BY THE OWNER OR THE ENGINEER IN CONNECTION WITH THE OPERATION OF THE ELECTRICAL SYSTEM IN THE BUILDING.
11. ALL TESTS SHALL BE MADE IN ACCORDANCE WITH THE LATEST STANDARD OF THE IEEE AND THE NATIONAL ELECTRICAL CODE.
12. MINIMUM CONDUCTOR SIZE SHALL BE #12. 600V INSULATION. MINIMUM SIZE CONDUIT SHALL BE 3/4" EMT FOR INTERIOR USE, AND 1/2" RIGID ALUMINUM FOR EXTERIOR USE. USE TYPE NMC CABLE COPPER. FOR LIGHTS AND RECEPTACLE CIRCUITS. EXTERIOR FITTINGS SHALL BE CAST BOXES AND COVERS. INTERIOR FITTINGS SHALL BE CAST WHERE EXPOSED ON WALLS. STAMPED BOXES MAY BE USED ABOVE CEILINGS IN AIR CONDITIONED SPACES. WHERE LAY IN FIXTURES ARE IN USE. USE 1/4" x 2" ALLOWED FOR 6" WIDTH.
13. CONTRACTOR SHALL INSTALL WIRING AND OTHER CIRCUIT COMPONENTS TO MATCH EQUIPMENT ACTUALLY INSTALLED.
14. INSTALL GROUND FAULT RECEPTACLES AT RECEPTACLE LOCATIONS WITHIN 5' OF SINKS OR LAVATORIES, AND AT EXTERIOR LOCATIONS. EXTERIOR RECEPTACLES SHALL ALSO BE WATERPROOF.
15. BONDING AND GROUNDING SHALL BE IN ACCORDANCE WITH NFPA 70:230-63, NFPA 250-23, 250-71 & 250-72.
16. GROUND NEUTRAL IN ACCORDANCE WITH NFPA 70:250-23b.
17. FUSES SHALL BE ITT CLASS K5, 250 VOLT, 200,000 AMP INTERRUPTING CAP.
18. PROVIDE SERVICES OF A FIRE/SMOKE DETECTION AND ALARM COMPANY TO DESIGN AND INSTALL ALARM SYSTEM TO MEET REQUIREMENTS OF THE STATE FIRE MARSHALL.
19. EXTERIOR LIGHTING SHALL BE SHADDED OR INWARDLY DIRECTED IN SUCH A MANNER SO THAT NO DIRECT LIGHTING OR GLARE IS CAST BEYOND THE PROPERTY LINE. THE INTENSITY OF SUCH LIGHTING SHALL NOT EXCEED ONE FOOT CANDLE AS MEASURED AT THE ADJUTING PROPERTY LINE.
20. ALL ELECTRICAL, MECHANICAL AND PLUMBING PENETRATING THE PARTITIONS SHALL BE FIRE CAULKED. PENETRATIONS THROUGH RAISED CONSTRUCTION SHALL BE SEALED WITH A MATERIAL CAPABLE OF PREVENTING THE PASSAGE OF FLAMES AND HOT GASES WHEN TESTED IN ACCORDANCE WITH ASTM E-143.

554 OLD SPANISH TRAIL
SLIDELL, LA. 70458
OFFICE: 985-649-5832
FAX: 985-641-5950

WWW.DAMMONENGINEERING.COM
EMAIL: DAMMONENG@BELLOUTH.NET

ARCHITECTURE
ENGINEERING
STUDIES
PLANNING
INVESTIGATION
EXPERT WITNESS

DAMMON
ENGINEERING, INC.

CHIEF ENGINEER
EMMETT
DAMMON, P.E.

CHIEF ARCHITECT
ROBERT
WILTSE

VESSEL
PROPERTIES
384 VOTERS RD.
SLIDELL, LA

REVISIONS

SCALE: AS NOTED

JOB#: 2122

DATE: 09-23-11

SHEET 6

E-1