GENERAL NOTES

1. INSULATION AND INSULATION ASSEMBLIES SHALL MEET THE REQUIREMENTS OF SECTION 719.
   A. CONCEALED INSULATION SHALL HAVE A FLAME SPREAD OF 0-25 AND SMOKE DEVELOPED INDEX OF 0-450. EXCEPT THAT IN COMBUSTIBLE (WOOD FRAME) CONSTRUCTION.
   B. FACING SHALL COMPLY WITH IBC 2006.
2. PROVIDE 5'x5' LANDINGS, LEVEL WITH FINISHED FLOOR, OUTSIDE EXTERIOR DOORS. THRESHOLDS SHALL BE NOT MORE THAN 1/2" IN HEIGHT AND SHALL BE BEVELED IF MORE THAT 1/4".
3. DIMENSIONS ARE TO CENTERLINE, FACE OF STUDS, CENTER OF COLUMNS, OR FACE OF VENEER.
4. CONTRACTOR TO VERIFY ALL SITE CONDITIONS, BUILDING LOCATIONS, AND DIMENSIONS PRIOR TO CONSTRUCTION.
5. MATERIALS SHALL BE NEW AND U.L. LISTED.
6. NO WORK SHALL BE CONCEALED UNTIL APPROVED BY LOCAL INSPECTORS.
7. CONSTRUCTION SHALL COMPLY WITH ALL PARISH, STATE, AND LOCAL CODES.
8. CONTRACTOR TO GUARANTEE WORK FOR ONE YEAR.
9. CONTRACTOR SHALL FURNISH WATER AND POWER FROM EXISTING SOURCES.
10. EXTERIOR CAULK SHALL BE DOW CORNING 790 SILICONE, INSTALL IN ACCORDANCE WITH MFR. REQ. COORDINATE WITH ARCHITECT/OWNER AS TO COLOR. INTERIOR CAULK SHALL BE EQUAL TO DAP PAINTABLE LATEX WITH SILICONE.
11. PAINT GRADE TO SHALL BE SHERWIN WILLIAMS OR EQUIVALENT. ALL WORK TO RECEIVE 3 COATS. COLOR SELECTION BY OWNER.
12. PROVIDE CLEANUP ON A REGULAR BASIS. NO TRASH STORED IN BUILDING.
13. ALL BATT INSULATION SHALL HAVE A CLASS "A" (0-25) FLAME SPREAD IN COMPLIANCE WITH APPLICABLE CODE.
14. USE 6" STUDS, OR 4" STAGGERED STUDS AT ALL PLUMBING WALLS.
15. PROVIDE GALVANIZED METAL PAN WITH DRAIN AT WATER HEATER LOCATION.
16. ALL CORNERS SHALL BE PROPERLY BRACED FOR WIND LOADS. A 48" SHEATHING SHALL BE PROVIDED EVERY 20 FEET OF WALL LENGTH.
17. FLOORING SHALL BE NON-SLIP.
18. INTERIOR LOCKS ON DOORS IN MEANS OF EGRESS SHALL NOT REQUIRE THE USE OF A KEY, SPECIAL KNOWLEDGE, OR SPECIAL DEVICE TO OPEN IN THE DIRECTION OF EGRESS. ALL DOORS SHALL HAVE LEVER TYPE HANDLES.
19. INTERIOR WALLS AND CEILINGS SHALL HAVE A FLAME SPREAD OF 0-200 AND A SMOKE DEVELOPMENT RATING OF 0-450.
20. ALL WORK SHALL COMPLY WITH THE LATEST EDITION OF ALL LOCAL, STATE, AND NATIONAL CODES COVERING THE TYPE OF WORK BEING PERFORMED.
21. PROVIDE PORTABLE FIRE EXTINGUISHERS IN ACCORDANCE WITH NFPA 101. SEE APPENDIX "E" OF NFPA 101 FOR DISTRIBUTION OF EXTINGUISHERS.
22. ALL FIRE WALLS SHALL EXTEND TIGHT TO ROOF SHEATHING, AND BE SEALED WITH AN APPROVED FIRE CAULK.
23. ALL ELECTRICAL, MECHANICAL, AND PLUMBING MATERIALS PENETRATING FIRE WALLS SHALL BE FIRE CAULKED. (PENETRATIONS THROUGH RATED CONSTRUCTION SHALL BE SEALED WITH A MATERIAL CAPABLE OF PREVENTING THE PASSAGE OF FLAMES AND HOT GASES WHEN TESTED IN ACCORDANCE WITH ASTM-E814.)
24. SERVICE COUNTER SHALL HAVE A HCP ACCESSIBLE WRITING SURFACE, MAX. 36" FROM F.F. (ADAAG MANUAL 1998, PG 135)

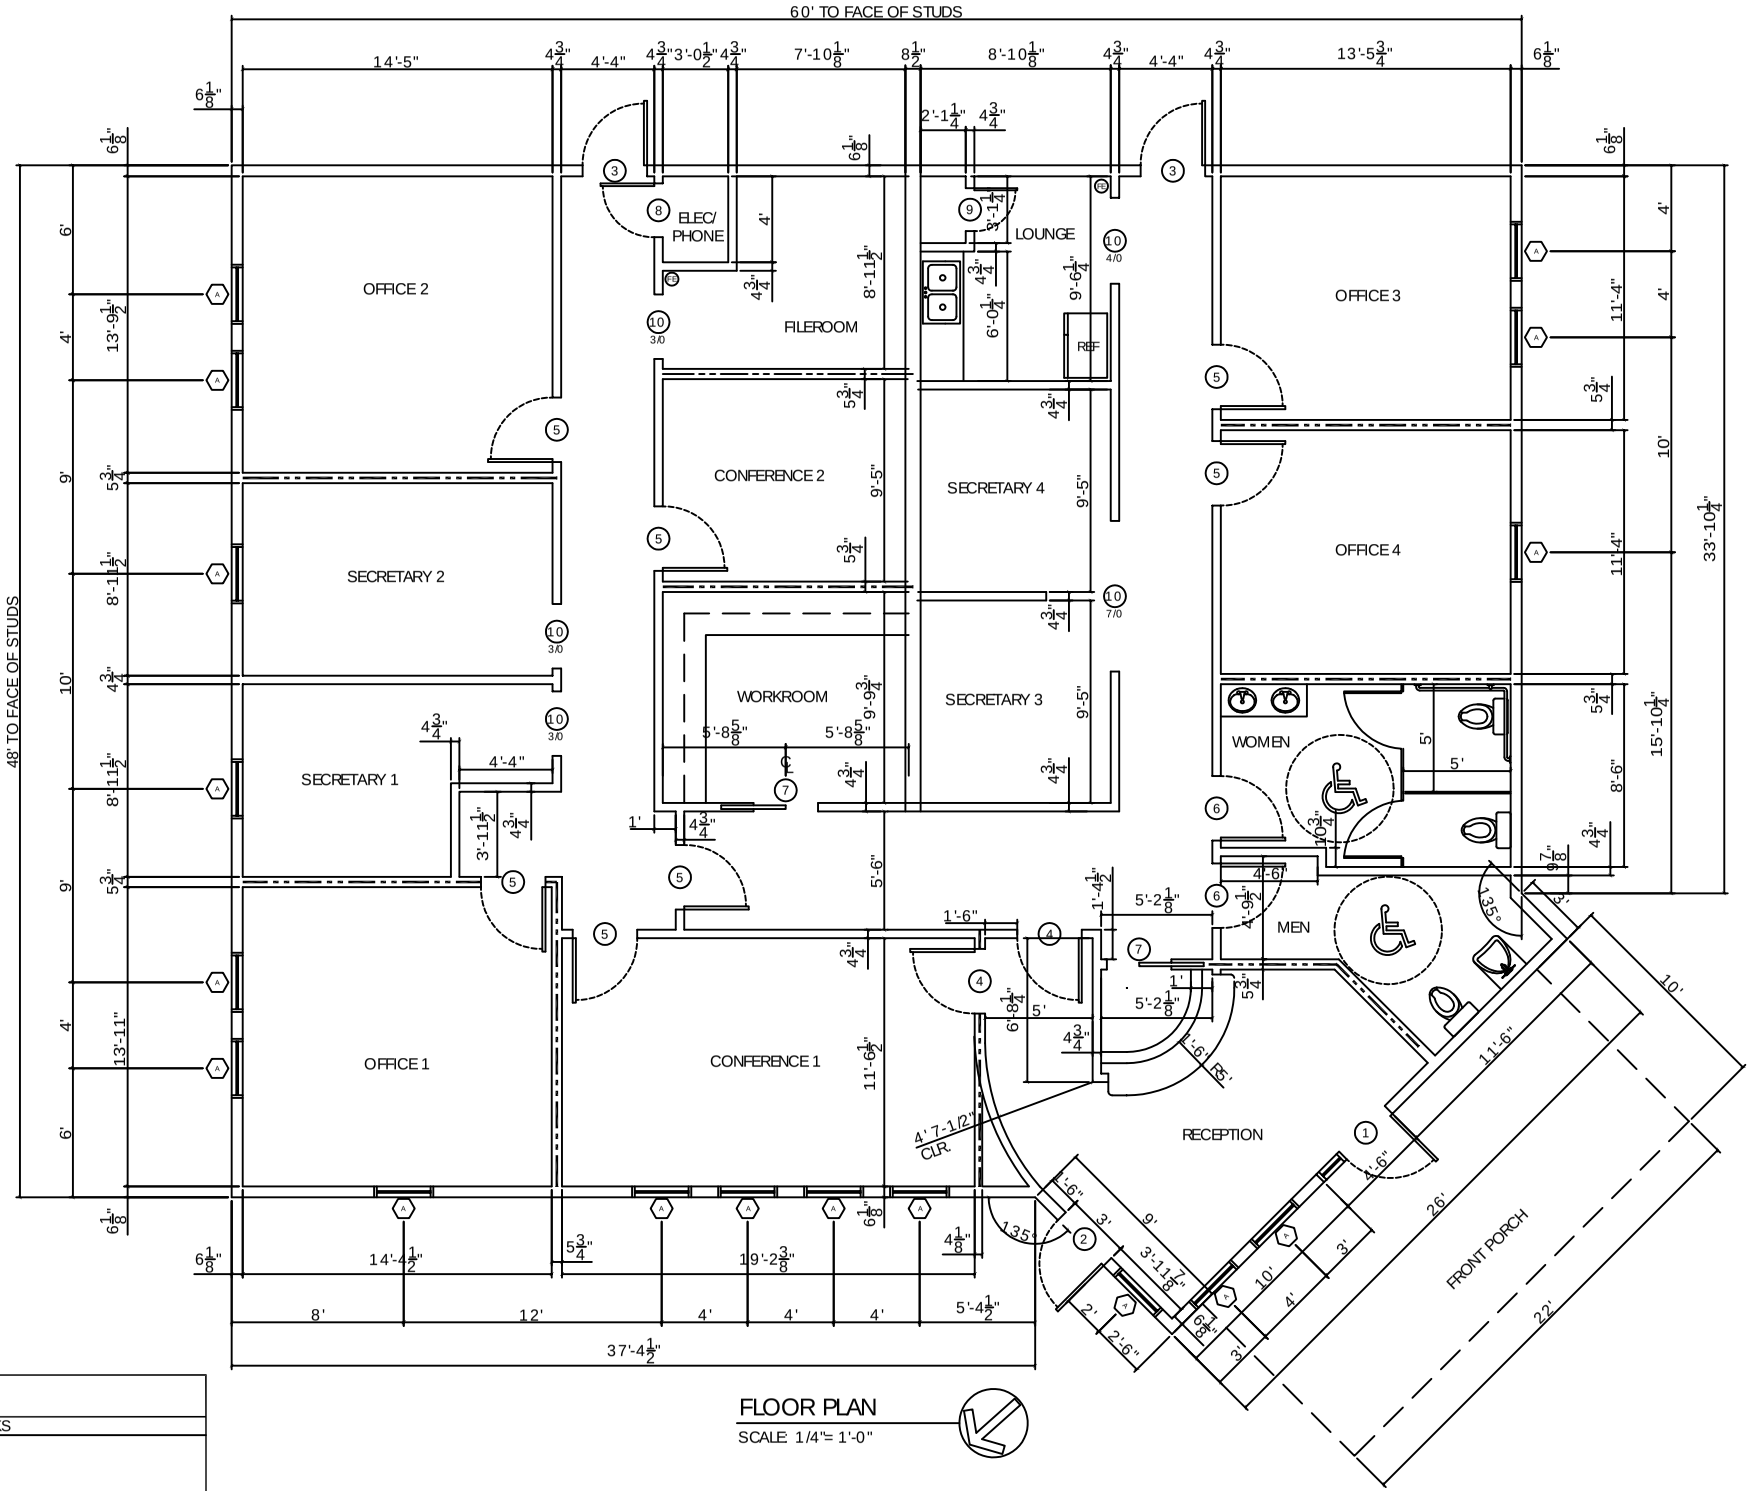

WINDOW SCHEDULE (A)

MK	SIZE	TYPE: FIXED	S. HUNG	D. HUNG	HORIZ. SLIDE	VERT. SLIDE	FRAME: STEEL	ALUMINUM*	WOOD	GLASS: TINTED	INSUL. LOW E	TEMPERED	WIREGLASS	LITES: NONE	2/2	2/4	6/6	SEE ELEV.	ACCESSORIES: ALARM	SCREEN	SHUTTER	REMARKS
A	2/6 x 6/0	●				●		●			●				●					●	●	NOTE #7,

*ALL ALUMINUM FRAMES TO HAVE DARK BRONZE FINISH.

DOOR & HARDWARE SCHEDULE (X)

MK	DOOR	TYPE: SOLID WOOD	HOLLOW METAL	SLIDING	STORE-FRONT	CASED OPENING	FRAME: STEEL	ALUMINUM	WOOD	CASED OPENING	HINGE: DBL SWING	BUTT 1-1/2 PR	BURGLERPRF	FIXED	LOCK: PASSAGE	PRIVACY	DEADBOLT	KEYED HANDLE OFFICE/ENTR.	PUSH PULL	ACCESSORIES: PANIC BAR	THRESHOLD	WEATHERSTRIP	DOOR STOP	ALARM	SILENCER	CLOSER	REMARKS
1	PR. 3/0 x 7/0	●							●			●						●			●	●	●				NOTE #7, W/ MATCHING SIDELIGHT AND TRANSOM, SEE ELEV.
2	3/0 x 7/0	●							●			●						●			●	●	●				NOTE #7, TO MATCH MK.1
3	3/0 x 6/8		●				●					●					●				●	●	●				18 GA. GALV.
4	3/0 x 7/0	●							●			●						●									NOTE #7, TO MATCH MK.1 & 2
5	3/0 x 7/0	●							●			●						●									NOTE #7
6	3/0 x 7/0	●							●			●				●										●	NOTE #7, TO MATCH MK.5
7	3/0 x 7/0			●					●										●								NOTE #7, TO MATCH MK.5 & 6.
8	2/6 x 6/8	●							●			●				●											NOTE #7, TO MATCH MK.5, 6, & 7
9	2/6 x 6/8	●							●			●				●											NOTE #7
10	7/0 HGT.					●			●	●																	#7 &8, SEE F.P. FOR WIDTH, TRIM TO MATCH MK. 5, 6, &7

DOOR & HARDWARE NOTES:
1. ALL GLAZING TO BE LAMINATED SAFETY GLASS.
2. DOOR HINGES TO BE STANLEY FULL MORTISE STANDARD WEIGHT, BALL BEARING HINGES, STAINLESS STEEL WITH DARK BRONZE FINISH @ EXTERIOR & MATCHING DARK BRONZE FINISH ON STANDARD STEEL @ INTERIOR.
3. PROVIDE LEVER HANDLE ADA APPROVED LOCKSETS WITH MATCHING DARK BRONZE FINISH, TO BE SELECTED BY OWNER.
4. COORDINATE KEYING SCHEDULE WITH OWNER.
5. DOOR STOPS TO BE EQUAL TO IVES No. 436 OR 437, AS REQUIRED IN MATCHING DARK BRONZE FINISH.
6. WEATHER-STRIP & THRESHOLD FINISH TO COMPLEMENT OTHER HARDWARE.
7. WD. DOOR, TRIM, & BASE TO BE SELECTED BY OWNER.
8. USE STANLEY HARDWARE COMPLETE POCKET DOOR MOUNTING SET - ITEM NO.405940, OR EQUAL.

OCCUPANT LOAD CALCULATIONS

OCCUPANCY CLASSIFICATION PER IBC 2006 (SECTION 304.1)
OCCUPANCY GROUP: B
OCCUPANT LOADS ARE CALCULATED PER VALUES GIVEN BY NFPA 101, 2006. TABLE 7.3.1.2

INHABITABLE SPACE SHALL BE CONSIDERED BUSINESS USE: 100 S.F. PER OCC.
TOTAL OFFICE AREA: 2,850 S.F.
TOTAL OCCUPANT LOAD: 2,875 S.F. ÷ 100 S.F. = 28.75 OCCUPANTS

LEGEND

- WOOD STUD WALL W/ 5/8" GYPSUM ON ONE OR BOTH SIDES, SEE PLANS
- WOOD STUD WALL W/ 5/8" GYPSUM + 1/2" SOUND BOARD ON ONE OR BOTH SIDES, SEE PLANS
- (FE) - FIRE EXTINGUISHER

DAMMON ENGINEERING, INC.
CHIEF ENGINEER
EMMETT
DAMMON, P.E.
CHIEF ARCHITECT
ROBERT
WILTSE
1095 FLORIDA AVENUE
SLIDELL, LA. 70458
OFFICE: 985-649-5832
FAX: 985-641-5950
WEBSITE:
WWW.DAMMONENGINEERING.COM
EMAIL:
DAMMONENG@BELLSOUTH.NET
ARCHITECTURE
ENGINEERING
STUDIES
PLANNING
INVESTIGATION
EXPERT WITNESS

ALFORD & ALFORD, LLP

NEIL & LYDIA ALFORD
542 OLD SPANISH TRAIL
SLIDELL, LA

FLOOR PLAN

REV:

SCALE: AS NOTED

JOB#: 1924

DATE: XX-XX-08

SHEET

A-1

OF