


SEWER FORCE MAIN NOTES

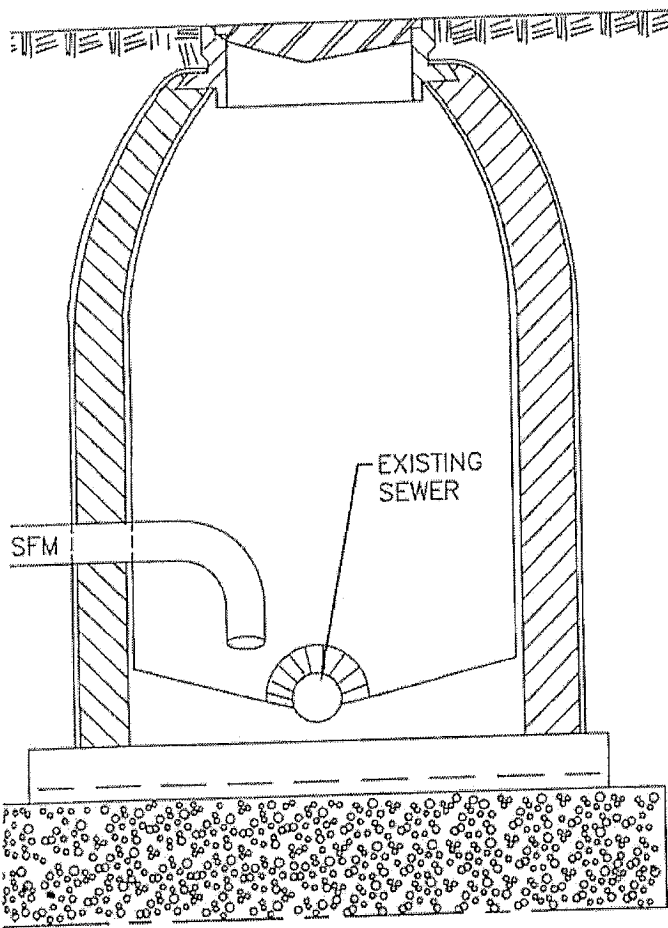

1. SEWER FORCE MAIN SHALL BE PE ~~4710~~ HIGH DENSITY POLYETHYLENE PIPE CONFORMING TO ASTM D3350. ALL JOINTS ARE TO BE FUSED IN ACCORDANCE WITH MANUFACTURER RECOMMENDATIONS.
2. FORCE MAIN SHALL BE PRESSURE TESTED TO 100 PSI FOR 2 HOURS.
3. FORCE MAIN SHALL HAVE A MINIMUM OF 3 FOOT COVER.
4. FORCE MAIN SHALL BE TIED TO EXISTING MANHOLE APPROXIMATELY 1 FOOT ABOVE THE INVERT OF THE MANHOLE. THE TIE-IN SHALL BE SEALED WITH NON-SHRINK GROUT. ~~W/TYPEX MIX.~~
6. THE SEWERAGE LIFT STATION AND THE 4" SEWER FORCE MAIN ARE TO BE PRIVATELY OWNED AND MAINTAINED.
7. THE INSTALLATION OF THE SEWER FORCE MAIN INTO THE EXISTING SEWER MANHOLE SHALL NOT INTERFERE WITH ACCESS TO THE MANHOLE STEPS.

- ⊗ GROUT BOTTOM OF MANHOLE TO PROVIDE PROPER CHANNELLING OF SFM DISCHARGE TO EFFLUENT GRAVITY LINE.

SEWER FORCE MAIN DETAILS
JEFFERSON PARISH

N.T.S.