

Ceiling Cutout: 6 9/16" (167 mm) Dia.

### Reflector Trim

- 8021 CCLW** Comfort Clear™, White Flange
- 8021 CCLP** Comfort Clear™, Polished Flange
- 8021 CCL** Comfort Clear™, Molded Trim Ring
- 8021**  Add suffix. See options for other finishes.

### Frame-In Kit

- S6132BU** 6" aperture, 1 lamp 26/32W Triple Tube CFL (120/277V) 4-Pin (Amalgam)
- Standard Dimming Options:
- S6132B**
  - CU3** Lightolier PowerSpec 3% Dimming (120/277V)
  - J1LD3** Lutron 5% Dimming (120V)
  - J2LD3** Lutron 5% Dimming (277V)
  - JUM7** Mark 7 Dimming (120/277V)
  - J1MX** Mark 10 Dimming (120V)
  - J2MX** Mark 10 Dimming (277V)
- Other dimming product available, please consult factory

### Remodeler Frame-In Kits

- 6126BURM** 6" aperture, 1 lamp 26W Triple Tube CFL (120/277V) 4-Pin (Amalgam)
- 6132BURM** 6" aperture, 1 lamp 26/32W Triple Tube CFL (120/277V) 4-Pin (Amalgam)

### Features

- 1. Reflector:** 16 ga. Alzak® aluminum, 50° visual cutoff to lamp and lamp image, medium distribution. Comfort Clear™ low iridescence finish. Self-flanged or flangeless with molded white trim ring (field paintable).
- 2. Socket Cup:** Effectively dissipates heat and positions lamp holder. Snaps onto reflector neck to assure consistently correct optical alignment without tools.
- 3. Mounting Frame:** Galvanized steel for dry or plaster ceilings. Accepts other 6" Triple Tube reflectors (see S6132BU Spec Sheet).
- 4. Retaining Springs:** Precision-tooled steel friction springs secure reflector to mounting frame for quick, tool-less installation.
- 5. Mounting Brackets:** 16 ga. steel. Adjust from inside of fixture. Use 3/4" or 1 1/2" lathing channel, 1/2" EMT, or optional mounting bars.
- 6. Ballast/J-Box:** Electronic 120V-277V. UL listed for through branch circuit wiring with max of (8) No. 12 AWG, 90°C supply conductors. Outboard mounted to reduce heat transfer and maintain lamp efficacy and life. Service from below without tools.

### Options and Accessories (continued)

- Emergency Ltg. Kit **FA EM3E\***
- FA EM4\***
- Fuse (Slow Blow) Add suffix **F**
- Existing/Thk. Ceiling **FA EC6\***
- Emergency Add suffix **EM\***
- Chicago Plenum Use S6132BULC
- \*See Spec. Sheets: FAEM, FAEC
- Mounting Bars & Accessories; see Specification Sheet MBA.
- Sloped Ceiling Adapters; see Specification Sheet SCA.
- IC Frame available; see **C6CFL32** Specification Sheet.

### Labels

- UL Listed for damp locations.
- Alzak® is a registered trademark of ALCOA.

### Electrical

**Note:** For ballast electrical data and latest lamp/ballast compatibility refer to "Ballast" specification sheet for complete electrical data.  
UL Listed for through branch circuit wiring with max of (8) No 12 AWG, 90 degree C supply conductors.

### Options and Accessories

Comfort Clear™ Finishes <sup>1</sup>		Other Finishes	
Diffuse	<b>CCD</b>	White	<b>WH</b>
Champagne Bronze	<b>CCZ</b>	Specular Clear	<b>CL</b>
Multigroove	<b>MG</b>		


<sup>1</sup>Specify desired flange. **W** White, **P** Polished, Blank - Molded Ring

### Job Information

Type:

**Job Name:**  
**Cat. No.:**  
**Lamp(s):**  
**Notes:**

## 26W Quick Calculator

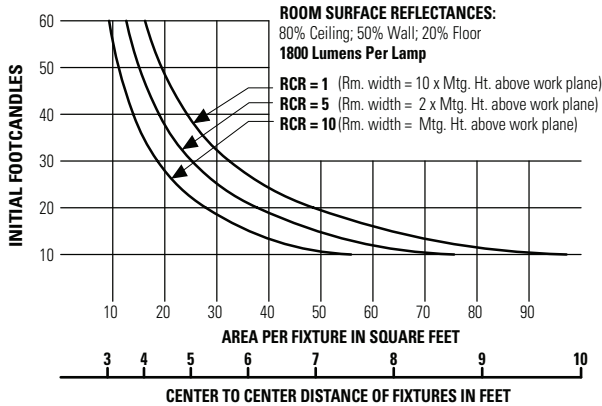


This quick calculator chart determines the number and spacing of 1 ft.-26W TTT units with Comfort Clear™ reflector, for any level of illumination.

## Spacing Ratio = 1.0

REPORT NO: LSI 14025  
LIGHTOLIER RECESSED FLUORESCENT LUMINAIRE,  
WITH COMFORT CLEAR™ REFLECTOR  
ONE 26 WATT CPFL GE LAMP,  
CAT# F26TBX/SPX35-835.  
LUMEN RATING = 1800 LMS.

0	775	
5	806	77
10	780	
15	708	199
20	646	
25	566	258
30	478	
35	402	245
40	285	
45	78	81
50	13	
55	4	4
60	2	
65	1	2
70	1	
75	1	1
80	0	
85	0	0

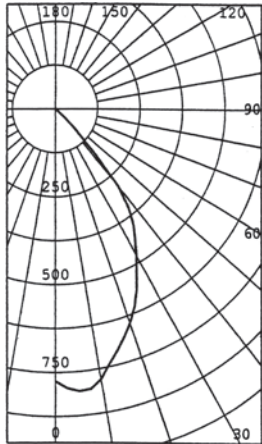

\*\*EFFICIENCY=48.1%\*\*  
DATE: 4-23-99  
CIE TYPE DIRECT  
LUMINOUS DIAMETER: 6.000  
THIS REPORT BASED ON LM-1 AND OTHER PERTINENT IES PROCEDURES.


0-30	533	29.66	61.66
0-40	778	43.25	89.92
0-60	863	47.98	99.75
0-90	865	48.10	100.00
40-90	87	4.85	10.08
60-90	2	.12	.25
90-180	0	.00	.00
0-180	865	48.10	100.00

## Coefficients of Utilization

EFFECTIVE FLOOR CAVITY REFLECTANCE = .20

ROOM CAVITY RATIO	EFFECTIVE FLOOR CAVITY REFLECTANCE = .20														
	80		70		50		30		10		0				
	50	30	10	50	30	10	50	30	10	50		30	10		
1	.54	.53	.52	.53	.52	.51	.51	.50	.49	.49	.48	.47	.47	.46	.46
2	.50	.49	.47	.50	.48	.47	.48	.47	.46	.47	.46	.45	.45	.44	.43
3	.47	.45	.44	.47	.45	.43	.46	.44	.43	.44	.43	.42	.43	.42	.41
4	.45	.42	.40	.44	.42	.40	.43	.41	.40	.42	.41	.39	.41	.40	.38
5	.42	.39	.37	.42	.39	.37	.41	.39	.37	.40	.38	.37	.39	.38	.36
6	.40	.37	.35	.39	.37	.35	.39	.36	.35	.38	.36	.34	.37	.36	.34
7	.37	.34	.33	.37	.34	.32	.36	.34	.32	.36	.34	.32	.35	.33	.31
8	.35	.32	.30	.34	.32	.30	.34	.31	.30	.34	.31	.30	.33	.31	.29
9	.33	.30	.28	.32	.30	.28	.32	.29	.28	.32	.29	.28	.31	.29	.27
10	.31	.28	.26	.30	.28	.26	.30	.27	.26	.29	.27	.26	.29	.27	.25


## 32W Quick Calculator

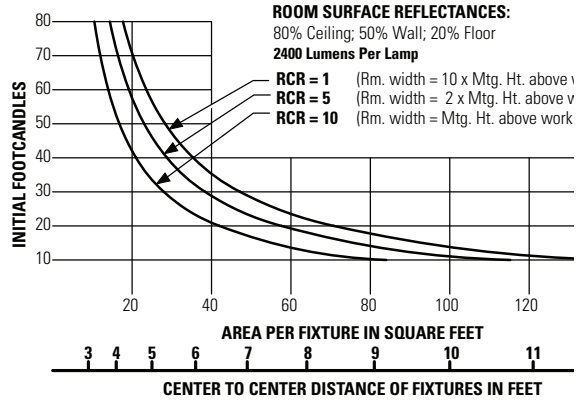

This quick calculator chart determines the number and spacing of 1 ft.-32W TTT unit with Comfort Clear™ reflector, for any level of illumination.

## Spacing Ratio = 1.1

REPORT PREPARED FOR: LIGHTOLIER 04-27-1999  
REPORT NO: LRL 499-9G  
LAMPS: 1 PLT-32 LUMENS: 2400  
DESCRIP: 6" DIA X 10" HT RECESSED DOWNLIGHT  
WITH COMFORT CLEAR™ REFLECTOR. VERTICAL LAMP.

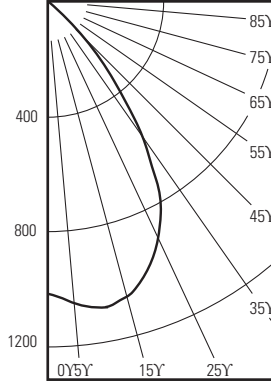

\*\*EFFICIENCY=52.7%\*\*  
DATE: 4-27-99  
CIE TYPE DIRECT  
LUMINOUS DIAMETER: 6.000  
THIS REPORT BASED ON LM-1 AND OTHER PERTINENT IES PROCEDURES.

ZONAL SUMMARY  
ZONE AVG\* ZONAL DEG. C.P. LUMENS

180	0	
175	0	0
165	0	0
155	0	0
145	0	0
135	0	0
125	0	0
115	0	0
105	0	0
95	0	0
90	0	0
85	1	1
75	1	1
65	3	3
55	9	8
45	99	77
35	563	354
25	904	418
15	1063	301
5	1066	102
0	1035	

0-30	821	34.2	64.9
0-40	1175	49.0	92.9
0-60	1260	52.5	99.6
0-90	1265	52.7	100.0
40-90	90	3.8	7.1
60-90	5	0.2	0.4
90-120	0	0.0	0.0
90-150	0	0.0	0.0
90-180	0	0.0	0.0
0-180	1265	52.7	100.0

## Coefficients of Utilization

EFFECTIVE FLOOR CAVITY REFLECTANCE = .20

ROOM CAVITY RATIO	EFFECTIVE FLOOR CAVITY REFLECTANCE = .20														
	80		70		50		30		10		0				
	50	30	10	50	30	10	50	30	10	50		30	10		
1	.59	.58	.57	.58	.57	.56	.56	.55	.54	.54	.53	.52	.52	.51	.50
2	.56	.54	.53	.55	.54	.52	.54	.52	.51	.52	.51	.50	.51	.50	.48
3	.53	.51	.50	.53	.51	.49	.51	.50	.49	.50	.49	.48	.49	.48	.46
4	.51	.48	.47	.50	.48	.46	.49	.47	.46	.48	.46	.45	.47	.46	.44
5	.48	.46	.44	.48	.45	.44	.47	.45	.43	.46	.44	.43	.45	.44	.42
6	.46	.43	.42	.46	.43	.41	.45	.43	.41	.44	.42	.41	.44	.42	.40
7	.44	.41	.39	.43	.41	.39	.43	.41	.39	.42	.40	.39	.42	.40	.38
8	.41	.39	.37	.41	.39	.37	.41	.38	.37	.40	.38	.37	.40	.38	.36
9	.39	.36	.35	.39	.36	.35	.38	.36	.35	.38	.36	.34	.38	.36	.34
10	.35	.32	.31	.35	.32	.31	.35	.32	.30	.34	.32	.30	.34	.32	.30

## Job Information

Type: