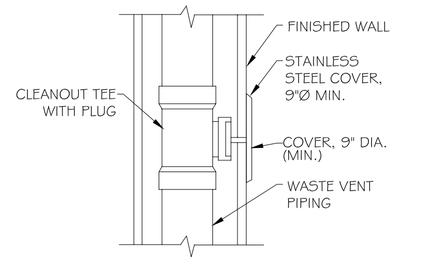

WALL CLEANOUT DETAIL
N.T.S.

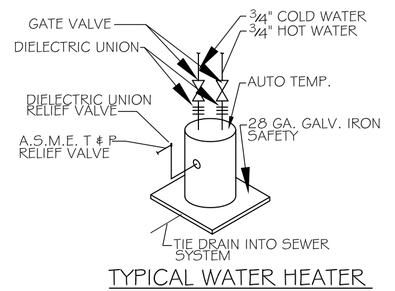

TYPICAL WATER HEATER
N.T.S.

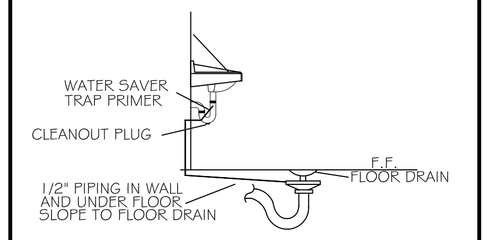

FLOOR DRAIN DETAIL
N.T.S.

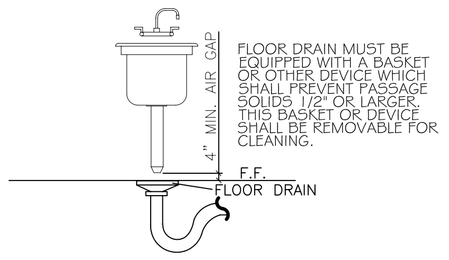

TYPICAL FLOOR SINK WITH FLOOR DRAIN DETAIL
N.T.S.

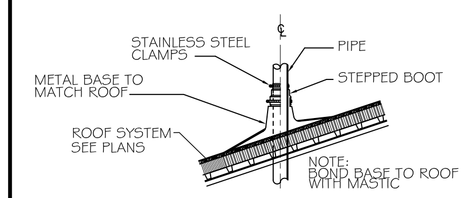

VENT THRU ROOF DETAIL
N.T.S.

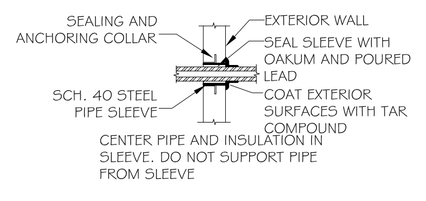

EXTERIOR WALL SLEEVE DETAIL
N.T.S.

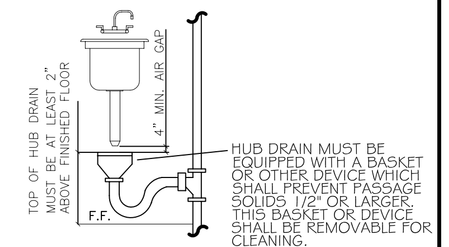

TYPICAL FLOOR SINK WITH HUB DRAIN DETAIL
N.T.S.

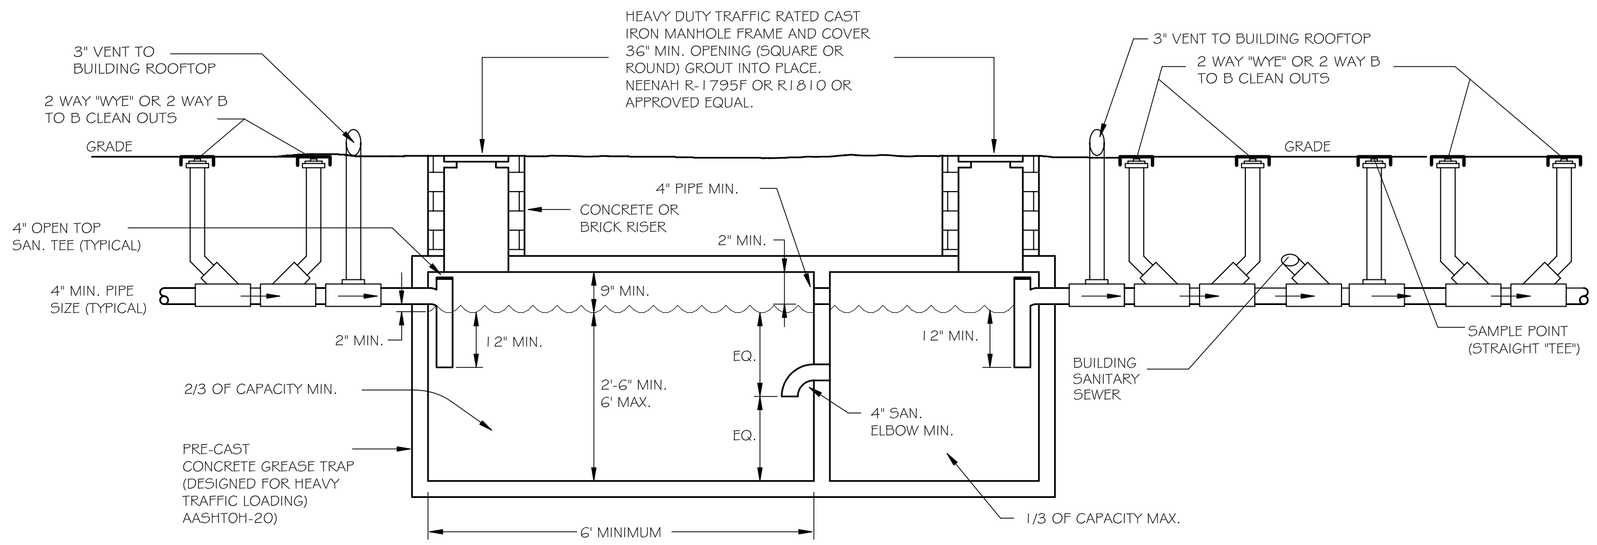

NOTE: SUBMIT SHOP DRAWINGS OF PRE-CAST TANK FOR REVIEW.

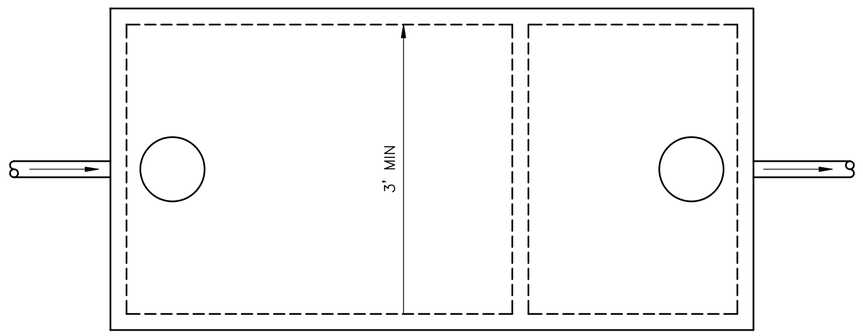

PLAN VIEW

TYPICAL GREASE TRAP WITH TWO MANHOLE COVERS AND EXTERNAL ACCESS COVERS
N.T.S.

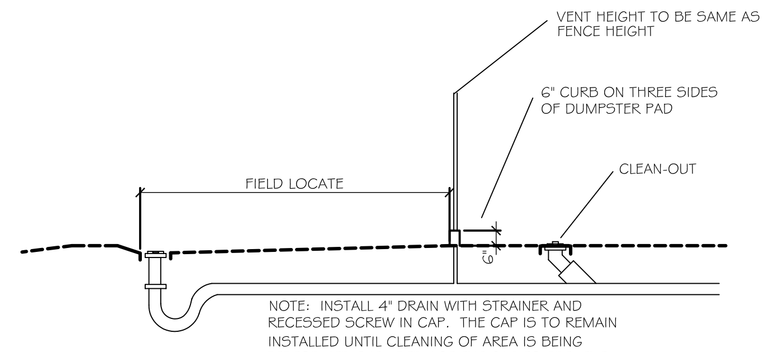

NOTE: INSTALL 4" DRAIN WITH STRAINER AND RECESSED SCREW IN CAP. THE CAP IS TO REMAIN INSTALLED UNTIL CLEANING OF AREA IS BEING PERFORMED THEN REPLACE THE CAP TO PREVENT WATER FROM ENTERING THE SANITARY SEWAGE SYSTEM.

DUMPSTER SECTION
N.T.S.

PLUMBING NOTES

1. PROVIDE ALL LABOR, MATERIAL AND EQUIPMENT FOR A COMPLETE OPERATING SYSTEM. THE SYSTEM SHALL INCLUDE HOT AND COLD WATER PIPING, SEWER AND VENT PIPING, INSULATION, WATER HEATER, HANGERS, VALVES & SUPPORTS WITHOUT ANY RESTRICTIONS TO COLUMN. CUT AND PATCH AS REQUIRED TO INSTALL PIPES.
2. ALL WORK AND MATERIAL SHALL CONFORM STRICTLY TO THE LATEST LOCAL, CITY, PARISH, STATE AND NATIONAL GOVERNING CODES.
3. CONTRACTOR IS TO FIELD VERIFY ALL EXISTING UTILITY LOCATIONS, ELEVATIONS AND SIZES PRIOR TO COMMENCING ANY WORK. CONTRACTOR SHALL PAY NECESSARY FEES FOR THE UTILITIES CONNECTIONS.
4. CONTRACTOR IS RESPONSIBLE TO VERIFY THE EXISTING INVERTS AND SET NEW INVERTS OF SEWERAGE AND DRAINAGE PIPES.
5. SEWERAGE LINES 3-INCH AND SMALLER SHALL BE SLOPED ¼" PER FOOT AND LINE 4-INCH AND LARGER SHALL BE ⅛" PER FOOT.
6. TEST ALL PIPING AT REQUIRED PRESSURE.
7. ALL PLUMBING SHALL BE CLOSELY COORDINATED WITH STRUCTURAL SYSTEM, MECHANICAL SYSTEM AND ELECTRICAL TO INSURE NO TRADES WILL CONFLICT WITH EACH OTHER.
8. DO NOT SCALE DRAWINGS. SEE ARCHITECTURAL DRAWINGS FOR EXACT LOCATIONS OF DOORS, WINDOWS, WALLS, FIXTURES, ETC.
9. ALL WATER MAINS AND PIPING NOT SHOWN FOR CLARITY, ALL LOCATIONS FIELD VERIFIED.
10. DOMESTIC HOT AND COLD WATER PIPING AND FITTINGS UNDER SLAB SHALL BE ASTM B88 COPPER WATER TUBE, TYPE K SOFT ANNEALED. NO JOINTS SHALL BE ALLOWED UNDER THE SLAB.
11. DOMESTIC WATER PIPING AND FITTINGS ABOVE THE SLAB SHALL BE ASTM B88 COPPER WATER TUBE, TYPE L, HARD DRAWN WITH COPPER PRESSURE TYPE FITTINGS, ANSI B16.22. THE JOINTS SHALL BE SOLDERED TYPING USING ASTM B32, ALLOY GRADE 95A (95-5) SOLDER.
12. SOIL, WASTE, VENT PIPING AND FITTINGS ABOVE THE SLAB SHALL BE SERVICE WEIGHT CAST IRON PIPE WITH BELL AND SPIGOT ENDS AND ONE PIECE NEOPRENE INSERT TYPE GASKET. USE PVC SCHEDULE 40 OR ABS DWV PIPES AND FITTINGS WHERE PERMITTED BY CODE.
13. ALL WATER PIPING AND FITTINGS ABOVE THE FLOOR SHALL BE INSULATED WITH ½" THICK FIBERGLASS INSULATION AND JACKET.
14. ALL ELECTRICAL, MECHANICAL AND PLUMBING PENETRATING FIRE PARTITIONS SHALL BE FIRE CAULKED. (PENETRATIONS THROUGH RATED CONSTRUCTION SHALL BE SEALED WITH A MATERIAL CAPABLE OF PREVENTING THE PASSAGE OF FLAMES AND HOT GASES WHEN TESTED IN ACCORDANCE WITH ASTM-E814.)
15. ALL PLUMBING LINES SHOWN ARE DIAGRAMMATIC.

in joint venture with:

DAMMON ENGINEERING, INC.
Architects & Engineers
Chief Architect: Kevin J. Kinchen, NCARB
Chief Engineer: Brian Mistich, PE
554 Old Spanish Trail
Slidell, LA 70458
www.dammonengineering.com
dammoneng@bellsouth.net
PH: 985.649.5832
F: 985.641.5950

project no. 20-1348/
drawn JTL
checked CKD
date 07.22.2014
revised

Meyer Engineers, Ltd.
4937 Hearst Street . Suite 1B . Metairie, Louisiana 70001
2031 Claiborne Street . Mandeville, Louisiana 70448
phone.504.885.9892 . fax.504.887.5056
website.www.meyer-e-l.com

PLUMBING NOTES & DETAILS
MUGSHOTS GRILL & BAR
RIDGELAND, MS

sheet no.
P-2
of ____ sheets