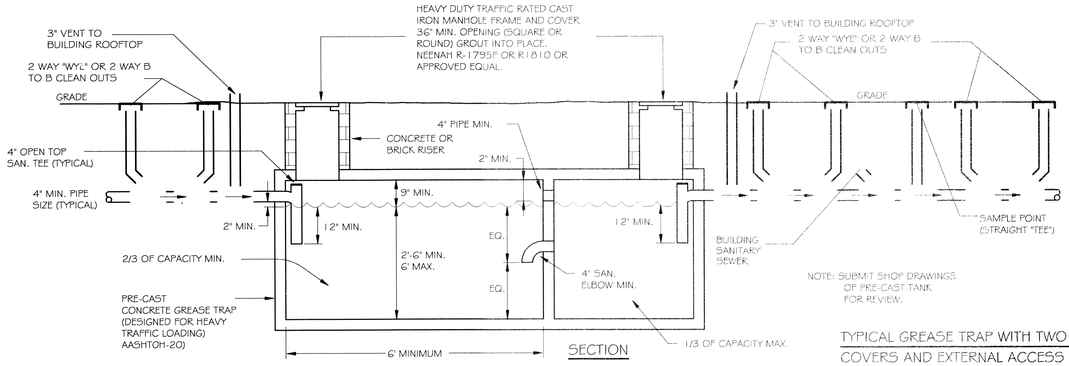

TYPICAL GREASE TRAP WITH TWO MANHOLE COVERS AND EXTERNAL ACCESS COVERS

N.T.S.

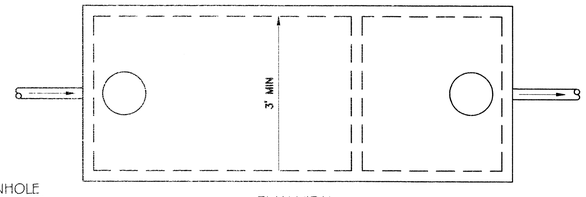

PLUMBING NOTES

1. PROVIDE ALL LABOR, MATERIAL AND EQUIPMENT FOR A COMPLETE OPERATING SYSTEM. THE SYSTEM SHALL INCLUDE HOT AND COLD WATER PIPING, SEWER AND VENT PIPING, INSULATION, WATER HEATER, HANGERS, VALVES & SUPPORTS WITHOUT ANY RESTRICTIONS TO FLOW. CUT AND PATCH AS REQUIRED TO INSTALL PIPES.
2. ALL WORK AND MATERIAL SHALL CONFORM STRICTLY TO THE LATEST LOCAL, CITY, PARISH, STATE AND NATIONAL GOVERNING CODES.
3. CONTRACTOR IS TO FIELD VERIFY ALL EXISTING UTILITY LOCATIONS, ELEVATIONS AND SIZES PRIOR TO COMMENCING ANY WORK. CONTRACTOR SHALL PAY NECESSARY FEES FOR THE UTILITIES CONNECTIONS.
4. CONTRACTOR IS RESPONSIBLE TO VERIFY THE EXISTING INVERTS AND SET NEW INVERTS OF SEWERAGE AND DRAINAGE PIPES.
5. SEWERAGE LINES 3-INCH AND SMALLER SHALL BE SLOPED ¼" PER FOOT AND LINE 4-INCH AND LARGER SHALL BE ⅛" PER FOOT.
6. TEST ALL PIPING AT REQUIRED PRESSURE.
7. ALL PLUMBING SHALL BE CLOSELY COORDINATED WITH STRUCTURAL SYSTEM, MECHANICAL SYSTEM AND ELECTRICAL TO INSURE NO TRADES WILL CONFLICT WITH EACH OTHER.
8. DO NOT SCALE DRAWINGS. SEE ARCHITECTURAL DRAWINGS FOR EXACT LOCATIONS OF DOORS, WINDOWS, WALLS, FIXTURES, ETC.
9. ALL WATER MAINS AND PIPING NOT SHOWN FOR CLARITY, ALL LOCATIONS FIELD VERIFIED.
10. DOMESTIC HOT AND COLD WATER PIPING AND FITTINGS UNDER SLAB SHALL BE ASTM B88 COPPER WATER TUBE, TYPE K SOFT ANNEALED. NO JOINTS SHALL BE ALLOWED UNDER THE SLAB.
11. DOMESTIC WATER PIPING AND FITTINGS ABOVE THE SLAB SHALL BE ASTM B88 COPPER WATER TUBE, TYPE L HARD DRAWN WITH COPPER PRESSURE TYPE FITTINGS, ANSI B16.22. THE JOINTS SHALL BE SOLDERED TYPING USING ASTM B32, ALLOY GRADE 95A (95-5) SOLDER. INSTALL WATER HAMMER ARRESTORS AT EACH FIXTURE.
12. SOIL, WASTE, VENT PIPING AND FITTINGS ABOVE THE SLAB SHALL BE SERVICE WEIGHT CAST IRON PIPE WITH BELL AND SPIGOT ENDS AND ONE PIECE NEOPRENE INSERT TYPE GASKET. USE PVC SCHEDULE 40 OR ABS DWV PIPES AND FITTINGS WHERE PERMITTED BY CODE.
13. ALL WATER PIPING AND FITTINGS ABOVE THE FLOOR SHALL BE INSULATED WITH ½" THICK FIBERGLASS INSULATION AND JACKET.
14. ALL ELECTRICAL, MECHANICAL AND PLUMBING PENETRATING FIRE PARTITIONS SHALL BE FIRE CAULKED. (PENETRATIONS THROUGH RATED CONSTRUCTION SHALL BE SEALED WITH A MATERIAL CAPABLE OF PREVENTING THE PASSAGE OF FLAMES AND HOT GASES WHEN TESTED IN ACCORDANCE WITH ASTM E814.)
15. ALL PLUMBING LINES SHOWN ARE DIAGRAMMATIC.

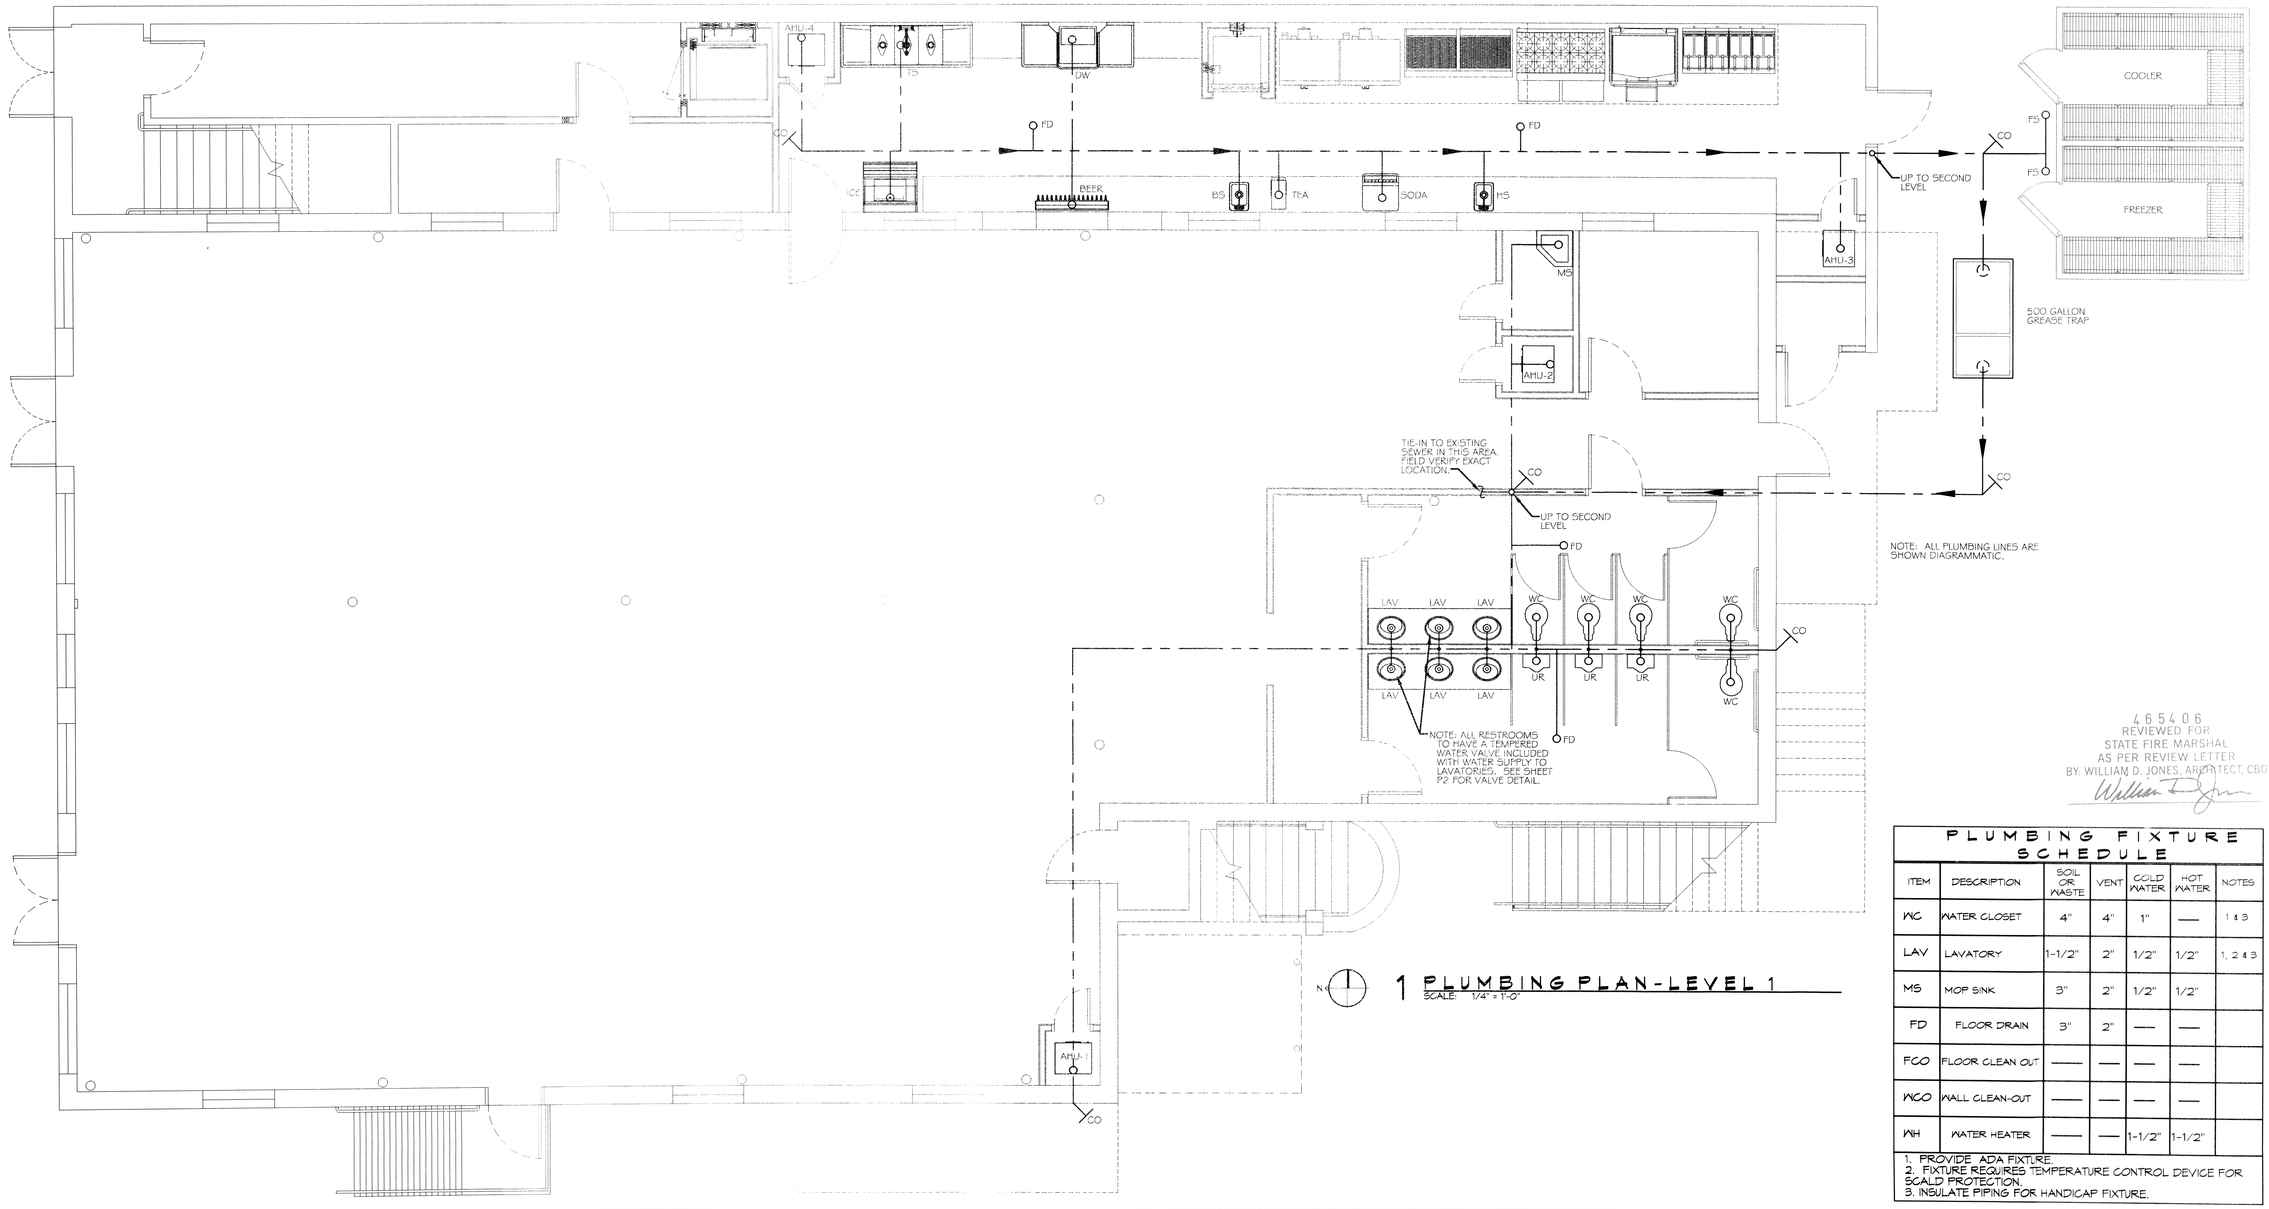

1 PLUMBING PLAN-LEVEL 1

SCALE: 1/4" = 1'-0"

465406
REVIEWED FOR
STATE FIRE MARSHAL
AS PER REVIEW LETTER
BY: WILLIAM D. JONES, ARCHITECT, CBO

PLUMBING FIXTURE SCHEDULE

ITEM	DESCRIPTION	SOIL OR WASTE	VENT	COLD WATER	HOT WATER	NOTES
WC	WATER CLOSET	4"	4"	1"	—	1 & 3
LAV	LAVATORY	1-1/2"	2"	1/2"	1/2"	1, 2 & 3
MS	MOP SINK	3"	2"	1/2"	1/2"	
FD	FLOOR DRAIN	3"	2"	—	—	
FCO	FLOOR CLEAN OUT	—	—	—	—	
WCO	WALL CLEAN-OUT	—	—	—	—	
WH	WATER HEATER	—	—	1-1/2"	1-1/2"	

1. PROVIDE ADA FIXTURE.
2. FIXTURE REQUIRES TEMPERATURE CONTROL DEVICE FOR SCALD PROTECTION.
3. INSULATE PIPING FOR HANDICAP FIXTURE.

DAMMON ENGINEERING, INC.
architects & engineers
www.dammonengineering.com
info@dammonengineering.com
Ph: 985.447.5952
Fx: 985.447.5952
Chief Architect: Kevin J. Kinchen, NCARB
Chief Engineer: Brian Mistich, PE
534 Old Spanish Trail
Slidell, LA 70458

REVISIONS

#	DESCRIPTION	DATE

SEAL:

3/11/15

RECEPTION HALL RENOVATION FOR:

BEV, INCORPORATED

211 COHEN STREET
SLIDELL, LOUISIANA 70458

JOB No: 2220 | DATE: MARCH 09, 2015
DRAWN BY: KJK | CHECKED BY: CKD

These plans and specifications and copies thereof as instruments of service are and shall remain the property of Dammon Engineering, and are not to be changed or copied in any form or manner whatsoever, nor are they to be assigned to any third party, without first obtaining the express written permission and consent of Dammon Engineering. In the event unauthorized reuse of these plans by any third party occurs, the third party responsible for such reuse shall indemnify and hold harmless Dammon Engineering against all claims, damages, losses and expenses including attorney's fees arising out of or resulting therefrom.

SHEET TITLE:
PLUMBING PLAN
LEVEL 1

DRAWING NUMBER:

P1

SHEET No: 9 of 19