



| PANEL SCHEDULE | | | | VOLTAGE | | | | |
|-------------------------------|---------------------|----------|-----------------|-------------|-----------------|-------------|-----------------|--|
| PANEL NO. 1 | | | | PANEL NO. 2 | | | | |
| LOAD NO. | DESCRIPTION | BREAKER | LOAD | LOAD | BREAKER | LOAD | LOAD | |
| NO. | LOCATION | AMP/POLE | AMP (KW) | AMP (KW) | POLE AMP | DESCRIPTION | MIN. CIRC. SIZE | |
| 1 | | | 4.1 | 0 | 55 | | 2 | |
| 2 | ZONE CONDENSER UNIT | | 4.1 | 0 | 55 | | 4 | |
| 3 | ZONE CONDENSER UNIT | | 4.1 | 0 | 55 | | 4 | |
| 4 | ZONE CONDENSER UNIT | | 4.1 | 0 | 55 | | 4 | |
| 5 | | | 4.1 | 0 | 55 | | 6 | |
| 6 | | | 5.8 | 0 | 0.4 | CONDENSER | 0 | |
| 7 | | | 5.8 | 0 | 0.1 | CONDENSER | 0 | |
| 8 | | | 5.8 | 0 | 0.1 | CONDENSER | 0 | |
| 9 | | | 5.8 | 0 | 0.1 | CONDENSER | 0 | |
| 10 | | | 5.8 | 0 | 0.1 | CONDENSER | 0 | |
| 11 | | | 5.8 | 0 | 0.1 | CONDENSER | 0 | |
| 12 | | | 5.8 | 0 | 0.1 | CONDENSER | 0 | |
| 13 | | | 5.8 | 0 | 0.1 | CONDENSER | 0 | |
| 14 | | | 5.8 | 0 | 0.1 | CONDENSER | 0 | |
| 15 | | | 5.8 | 0 | 0.1 | CONDENSER | 0 | |
| 16 | | | 5.8 | 0 | 0.1 | CONDENSER | 0 | |
| 17 | | | 5.8 | 0 | 0.1 | CONDENSER | 0 | |
| 18 | | | 5.8 | 0 | 0.1 | CONDENSER | 0 | |
| 19 | | | 5.8 | 0 | 0.1 | CONDENSER | 0 | |
| 20 | | | 5.8 | 0 | 0.1 | CONDENSER | 0 | |
| 21 | | | 5.8 | 0 | 0.1 | CONDENSER | 0 | |
| 22 | | | 5.8 | 0 | 0.1 | CONDENSER | 0 | |
| 23 | | | 5.8 | 0 | 0.1 | CONDENSER | 0 | |
| 24 | | | 5.8 | 0 | 0.1 | CONDENSER | 0 | |
| 25 | | | 5.8 | 0 | 0.1 | CONDENSER | 0 | |
| 26 | | | 5.8 | 0 | 0.1 | CONDENSER | 0 | |
| 27 | | | 5.8 | 0 | 0.1 | CONDENSER | 0 | |
| 28 | | | 5.8 | 0 | 0.1 | CONDENSER | 0 | |
| 29 | | | 5.8 | 0 | 0.1 | CONDENSER | 0 | |
| 30 | | | 5.8 | 0 | 0.1 | CONDENSER | 0 | |
| 31 | | | 5.8 | 0 | 0.1 | CONDENSER | 0 | |
| 32 | | | 5.8 | 0 | 0.1 | CONDENSER | 0 | |
| 33 | | | 5.8 | 0 | 0.1 | CONDENSER | 0 | |
| 34 | | | 5.8 | 0 | 0.1 | CONDENSER | 0 | |
| 35 | | | 5.8 | 0 | 0.1 | CONDENSER | 0 | |
| 36 | | | 5.8 | 0 | 0.1 | CONDENSER | 0 | |
| 37 | | | 5.8 | 0 | 0.1 | CONDENSER | 0 | |
| 38 | | | 5.8 | 0 | 0.1 | CONDENSER | 0 | |
| 39 | | | 5.8 | 0 | 0.1 | CONDENSER | 0 | |
| 40 | | | 5.8 | 0 | 0.1 | CONDENSER | 0 | |
| 41 | | | 5.8 | 0 | 0.1 | CONDENSER | 0 | |
| 42 | | | 5.8 | 0 | 0.1 | CONDENSER | 0 | |
| TOTAL CONNECTED LOAD (KW) 310 | | | 407.258 KW | | 507.123 KW | | 607.123 KW | |
| GROUND BUS (0) | | | GROUND WIRE (0) | | GROUND WIRE (0) | | GROUND WIRE (0) | |

911 ADDRESS SHALL BE A MINIMUM 3" LETTERING MARKED ON THE JUNCTION BOX AND SHALL BE VISIBLE FROM THE STREET.

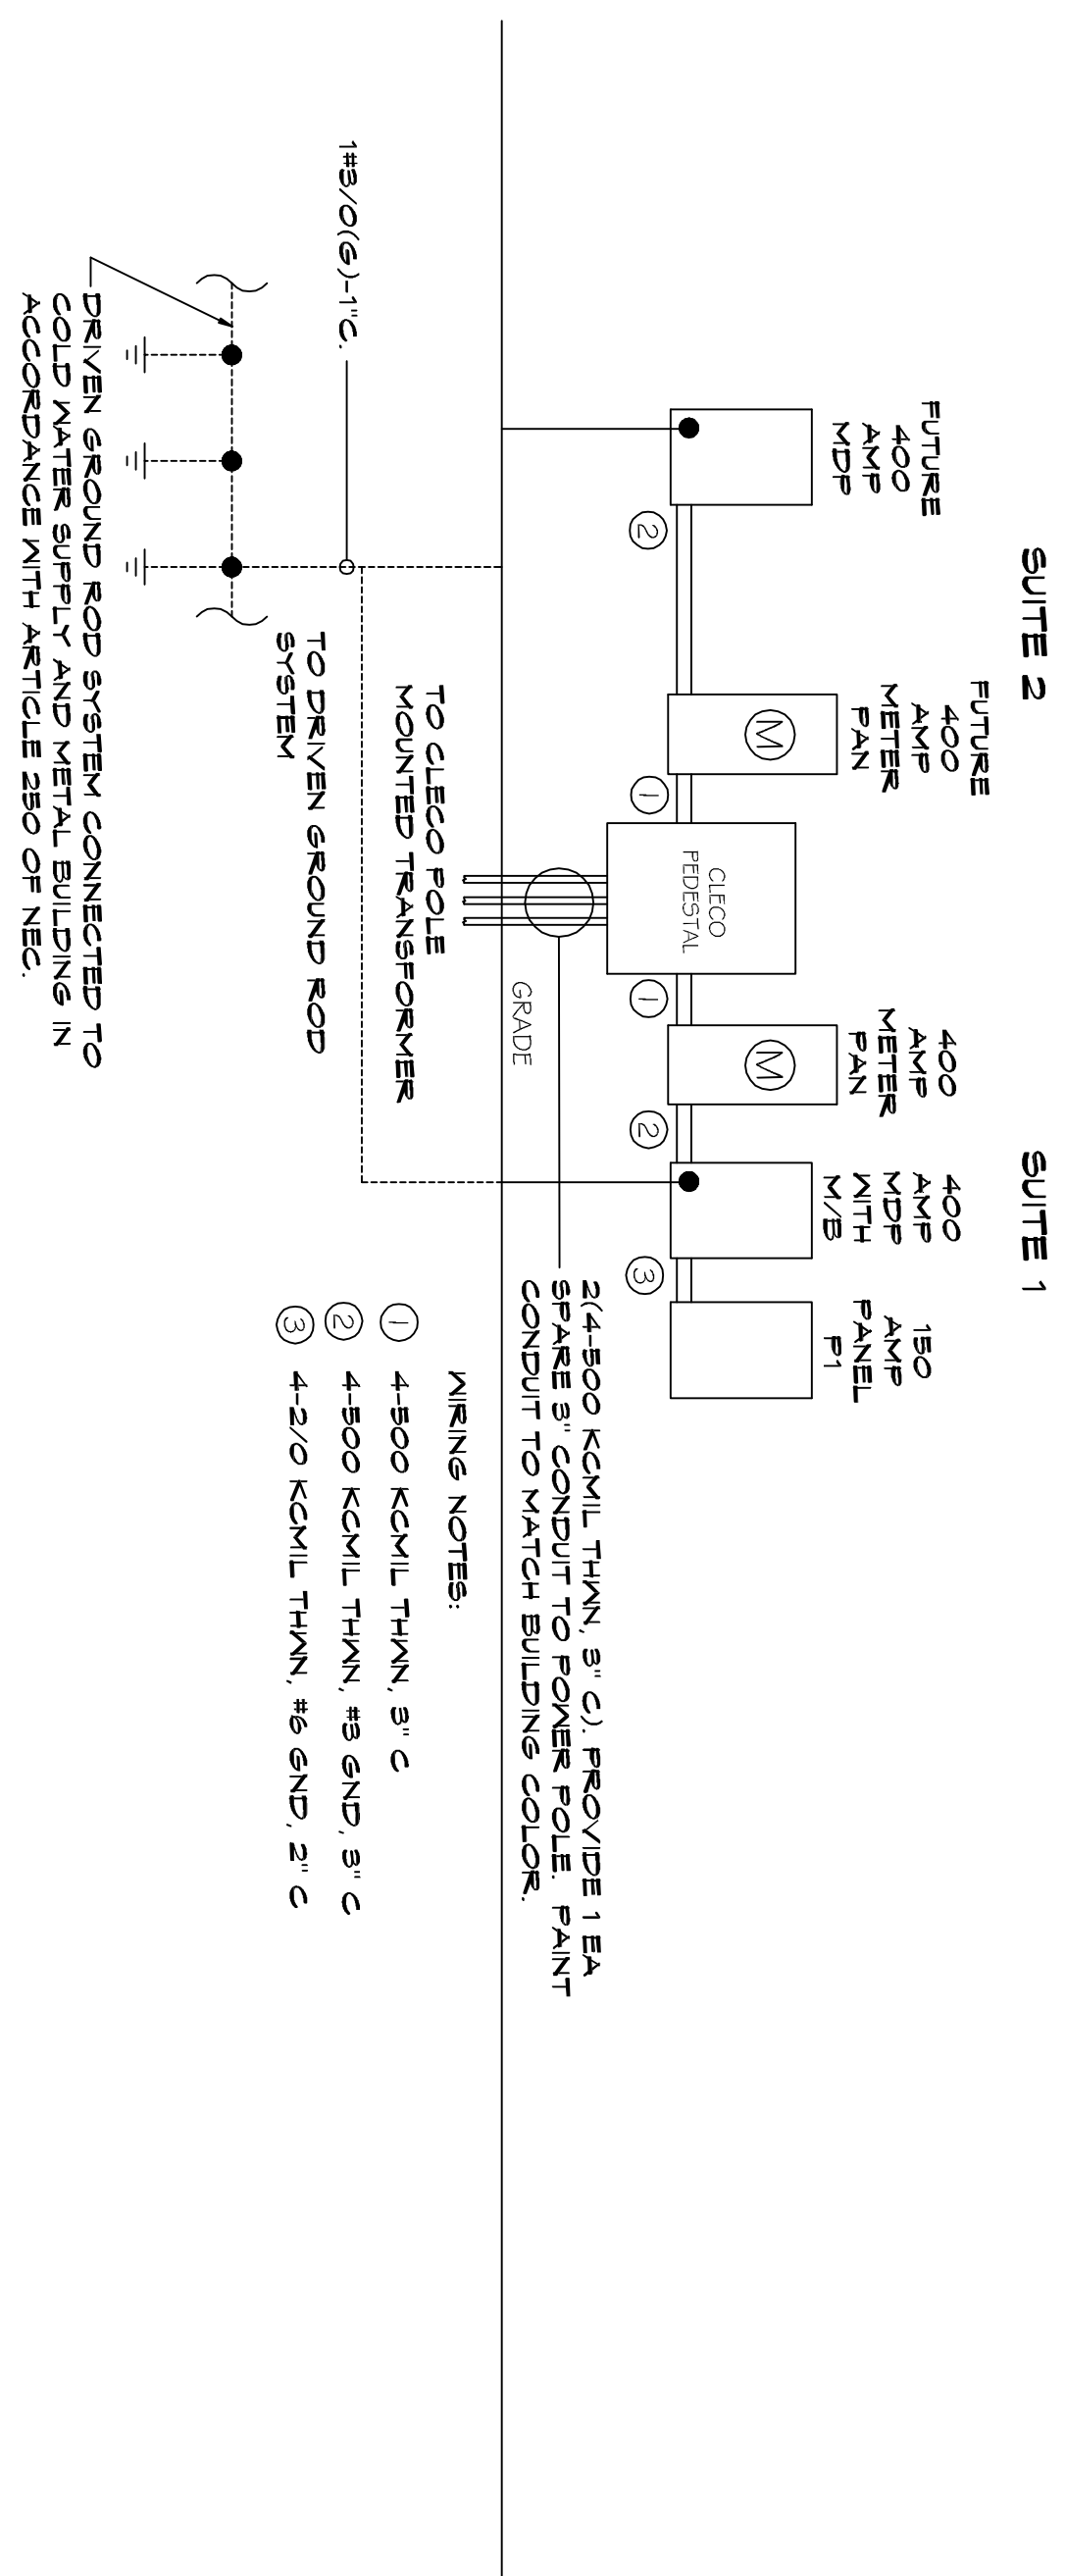

ONE LINE DIAGRAM
SCALE: N.T.S.

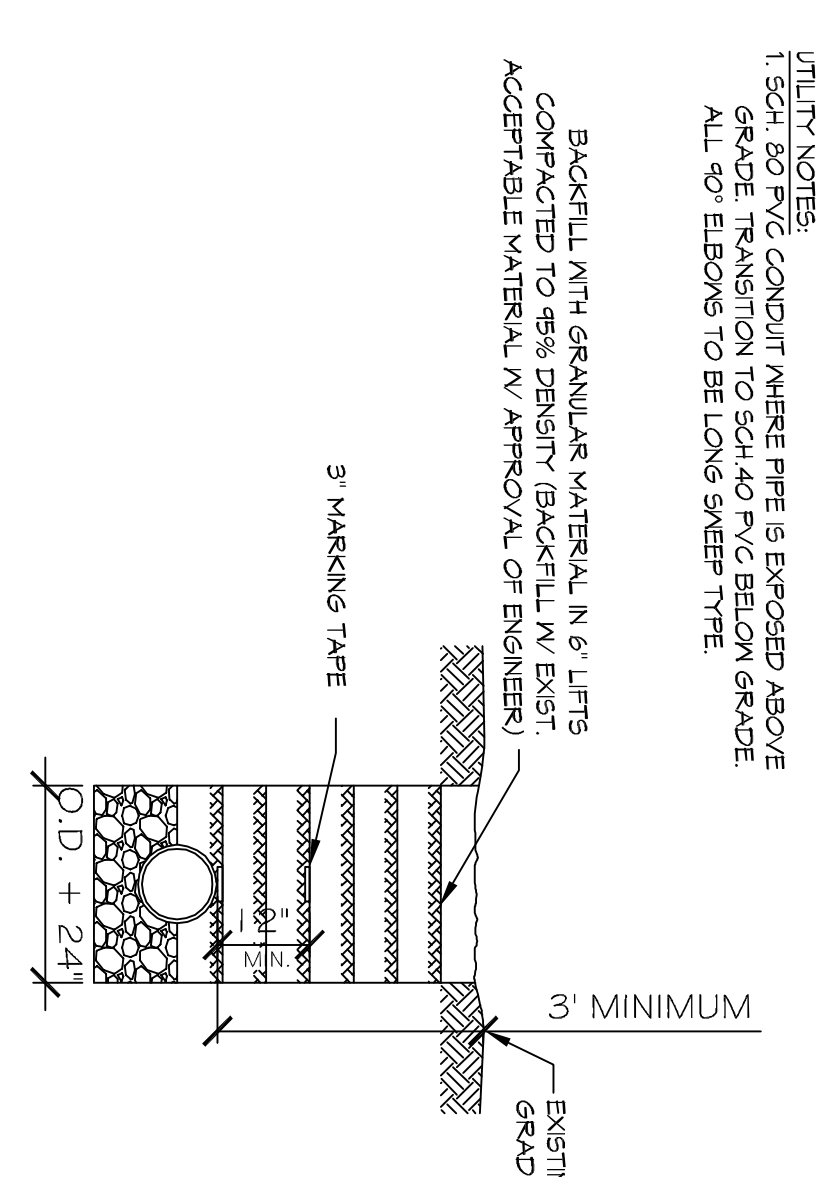

PIPE DETAIL FOR ELECTRICAL SERVICE
SCALE: N.T.S.

| REVISIONS | | |
|-----------|-------------|------|
| # | DESCRIPTION | DATE |
| | | |
| | | |
| | | |
| | | |



DAMMON ENGINEERING, INC.
 LOUISIANA & MISSISSIPPI

Chief Engineer: Brian Mstich, PE
 554 Old Spanish Trail
 Slidell, LA 70458

www.dammonengineering.com
 info@dammonengineering.com
 PH: 985.649.5832

NEW PREP FACILITY

OLD TOWN KITCHEN

SHEET TITLE:
 PANEL SCHEDULES AND ONE LINE DIAGRAM

227 COUSIN STREET
 SLIDELL, LA 70458

JOB No: 2324 DATE: 11-21-17
 DRAWN BY: JTL CHECKED BY: [Signature]

The above drawings and specifications, together with all progress reports, reports and test data, remain the property of Dammon Engineering, Inc. and shall be held in confidence and not be used in connection with any work or project other than that specifically intended for which they have been prepared and designed, without written consent of Dammon Engineering. Please contact with those drawings or specifications that constitute the contract documents.

DRAWING NUMBER:
E102

SHEET NO.: 5 of 5