PLUMBING ABBREVIATION LEGEND

@	—	AT
ABV	—	ABOVE
A.F.F.	—	ABOVE FINISH FLOOR
WC	—	WATER CLOSET
CLG	—	CEILING
CO	—	CLEANOUT
CONN	—	CONNECT/CONNECTION
CONT	—	CONTINUATION
3CS	—	THREE COMPARTMENT SINK
4CS	—	FOUR COMPARTMENT SINK
CW	—	COLD WATER
D	—	DISPOSAL
DF	—	DRINKING FOUNTAIN
DRWG	—	DRAWING
DW	—	DISHWASHER
EA	—	EACH
EXT	—	EXTEND
FAC	—	FURNACE/AIR COND.
FCO	—	FLOOR CLEANOUT
FD	—	FLOOR DRAIN
FFE	—	FINISH FLOOR ELEVATION
FIXT	—	FIXTURE
FL	—	FLOOR
FFWH	—	FREEZE PROOF WALL HYDRANT
FS	—	FLOOR SINK
GC	—	GENERAL CONTRACTOR
GT	—	GREASE TRAP
HB	—	HOSE BIBB
HW	—	HOT WATER
L	—	LAVATORY
LOC	—	LOCATION
MC	—	MECHANICAL CONTRACTOR
MS	—	MOP SINK
MTD	—	MOUNTED
NG	—	NATURAL GAS
PC	—	PLUMBING CONTRACTOR
PME	—	PLUMBING/MECHANICAL/ELECTRICAL
REF	—	REFER/REFERENCE
RTU	—	ROOF TOP HVAC UNIT
SS	—	SANITARY SEWER
T&P	—	TEMPERATURE AND PRESSURE
TP	—	TRAP PRIMER
TYP	—	TYPICAL
UR	—	URINAL
V	—	VENT
VS	—	VEGETABLE SINK
VTR	—	VENT THROUGH ROOF
W	—	WASTE
W/	—	WITH
WB	—	WASHER BOX
WCO	—	WALL CLEANOUT
WH	—	WATER HEATER
WM	—	WATER METER
	—	CONNECT NEW TO EXISTING

NOTE : ALL ABBREVIATIONS MAY NOT APPLY

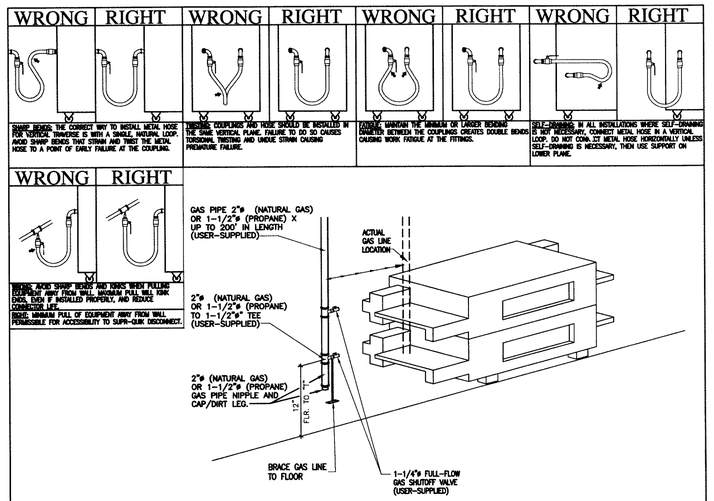

GAS SERVICE REQUIREMENTS

REQUIRED GAS PRESSURE
NATURAL: 8" - 14" WC

PS360 WB-D OVENS ROUGH - IN ISOMETRIC

NO SCALE (HOOD NOT SHOWN)

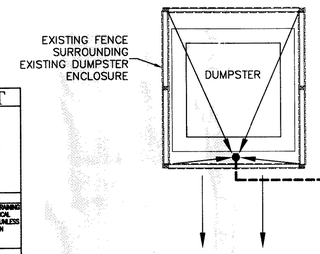

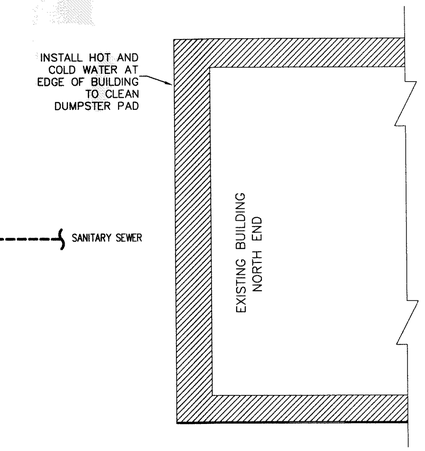

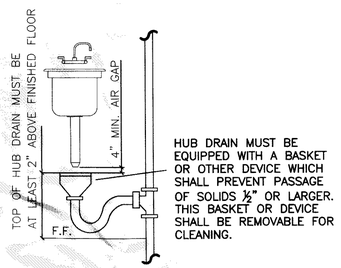

TYPICAL FLOOR SINK WITH HUB DRAIN

N.T.S.

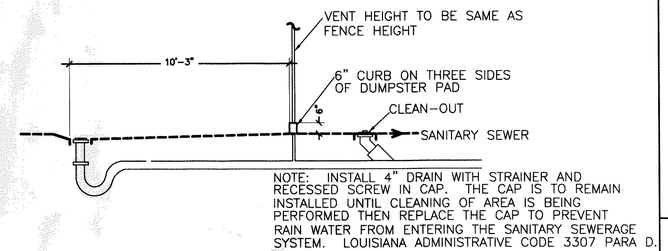

DUMPSTER SECTION

N.T.S.

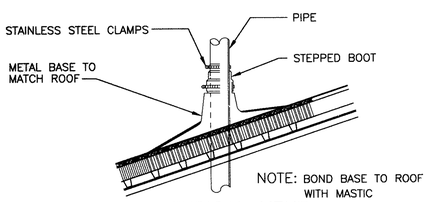

TYPICAL VENT THRU ROOF DETAIL

N.T.S.

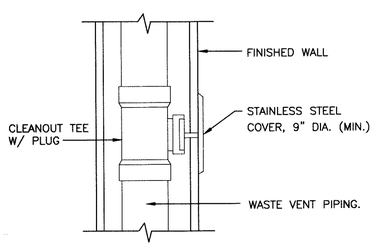

WALL CLEANOUT DETAIL

N.T.S.

NOTE:
1. P.C. SHALL FIELD VERIFY ALL DIMENSIONS.
2. ALL GAS PIPING IS INSTALLED INSIDE HIGH IN CEILING SPACE EXCEPT WHERE NOTED OTHERWISE.

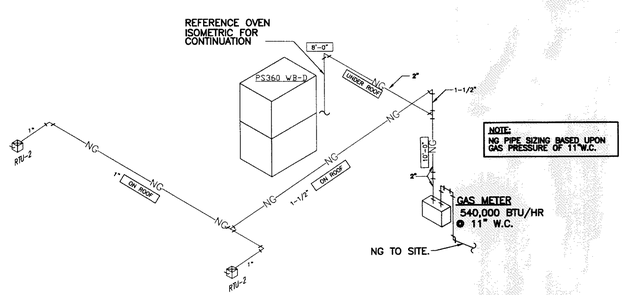

NOTE:
NG PIPE SIZING BASED UPON GAS PRESSURE OF 11"W.C.

EQUIPMENT	BTUH INPUT
CONVECTION OVEN (2)	340,000
RTU-2	100,000
RTU-3	100,000
TOTAL USAGE	540,000
APPROX. DISTANCE FROM REGULATOR TO FARTHEST TAKE OFF 50'	
GAS TYPE:	NATURAL GAS

NATURAL GAS PIPING DIAGRAM

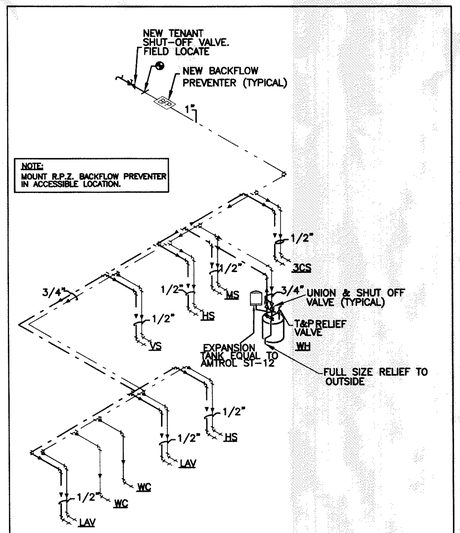

NOTE:
MOUNT R.P.Z. BACKFLOW PREVENTER IN ACCESSIBLE LOCATION.

WATER RISER DIAGRAM

N.T.S.

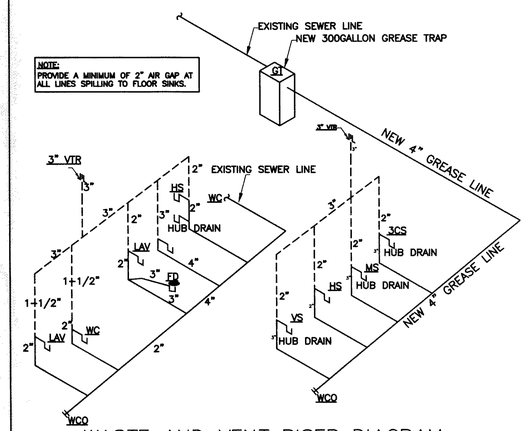

NOTE:
PROVIDE A MINIMUM OF 2" AIR GAP AT ALL LINES SPILLING TO FLOOR SINKS.

WASTE AND VENT RISER DIAGRAM

N.T.S

390486
REVIEWED FOR
STATE FIRE MARSHAL
SUBJECT TO FIELD
INSPECTION
BY 3RD PARTY

Ghassan Haddad

DAMMON ENGINEERING, INC.

EMMETT DAMMON

ARCHITECT
ROBERT WILTSE

1095 FLORIDA AVENUE
SLIDELL, LA. 70458
985-649-5832

WEBSITE:
WWW.DAMMONENGINEERING.COM

EMAIL:
DAMMONENG@BELLSOUTH.NET

ARCHITECTURE

ENGINEERING

STUDIES

PLANNING

INVESTIGATION

EXPERT WITNESS

MARCO'S PIZZA TENANT BUILDOUT

532 GAUSE BLVD
SLIDELL, LA
70458

PLUMBING DETAILS

STATE OF LOUISIANA
EMMETT C. DAMMON, JR.
LICENSE NO. 8708
PROFESSIONAL ENGINEER

SCALE: AS NOTED
JOB#: 2083
DATE: 11-10-10
SHEET 11

P-2

OF 11