



HOOD INFORMATION TABLE																				
AIR REQUIREMENTS																				
HOOD NO.	MODEL	LGTH	WTH	MAX. COOKING TEMP.	QTY	EXHAUST COLLAR			SUPPLY COLLAR			HOOD CONSTRUCTION	HOOD CONFIGURATION	PLENUM BACK	FRONT MATERIAL	CEILING ENCLOSURE HEIGHT				
						SIZE	EXHAUST	TOTAL	SIZE	SUPPLY	TOTAL									
1	SC	11'-0"	72"	450 DEG.	1	16"	16"	3300	625"	3300	1	10"	36"	2310	25"	2310	430 S/S	-	-	-


* 48" TALL BACKWALL SPLASH PANEL PROVIDED WITH HOOD

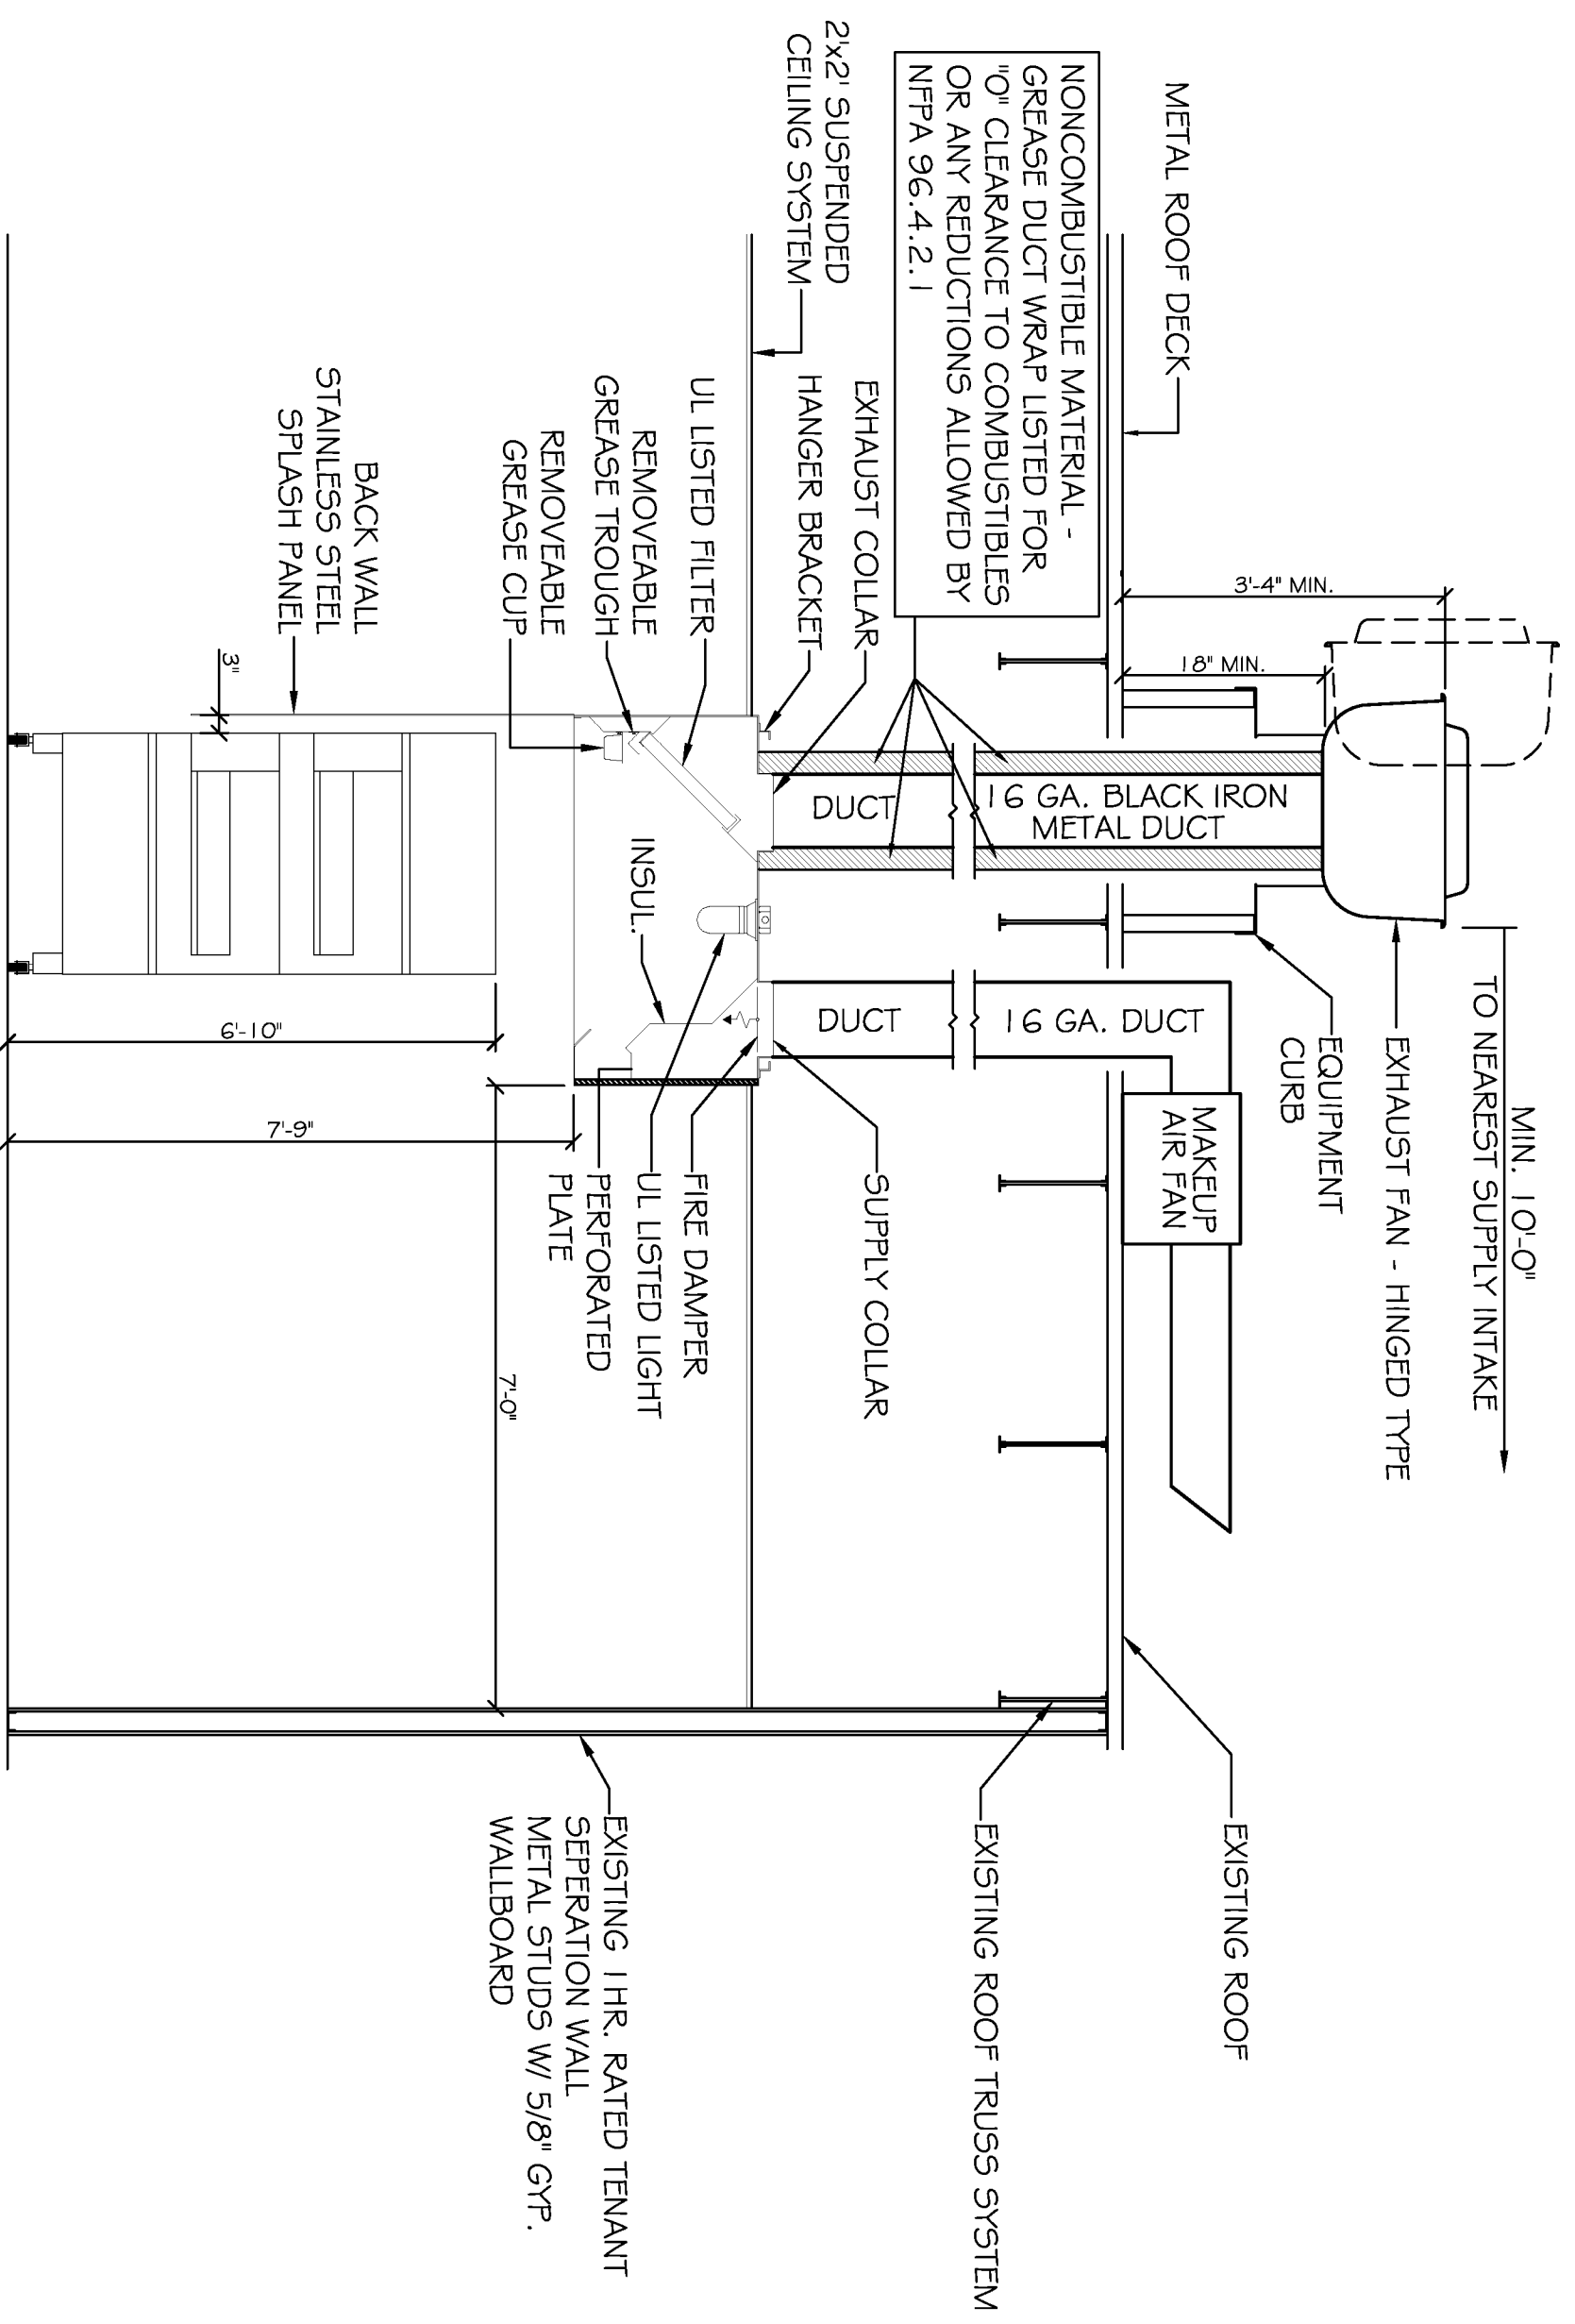


TYPICAL MARCOS PIZZA HOOD & DUCT INSTALLATION
W/CLEARANCE REDUCTION MATERIALS TO PROTECT COMBUSTIBLES
NOT TO SCALE

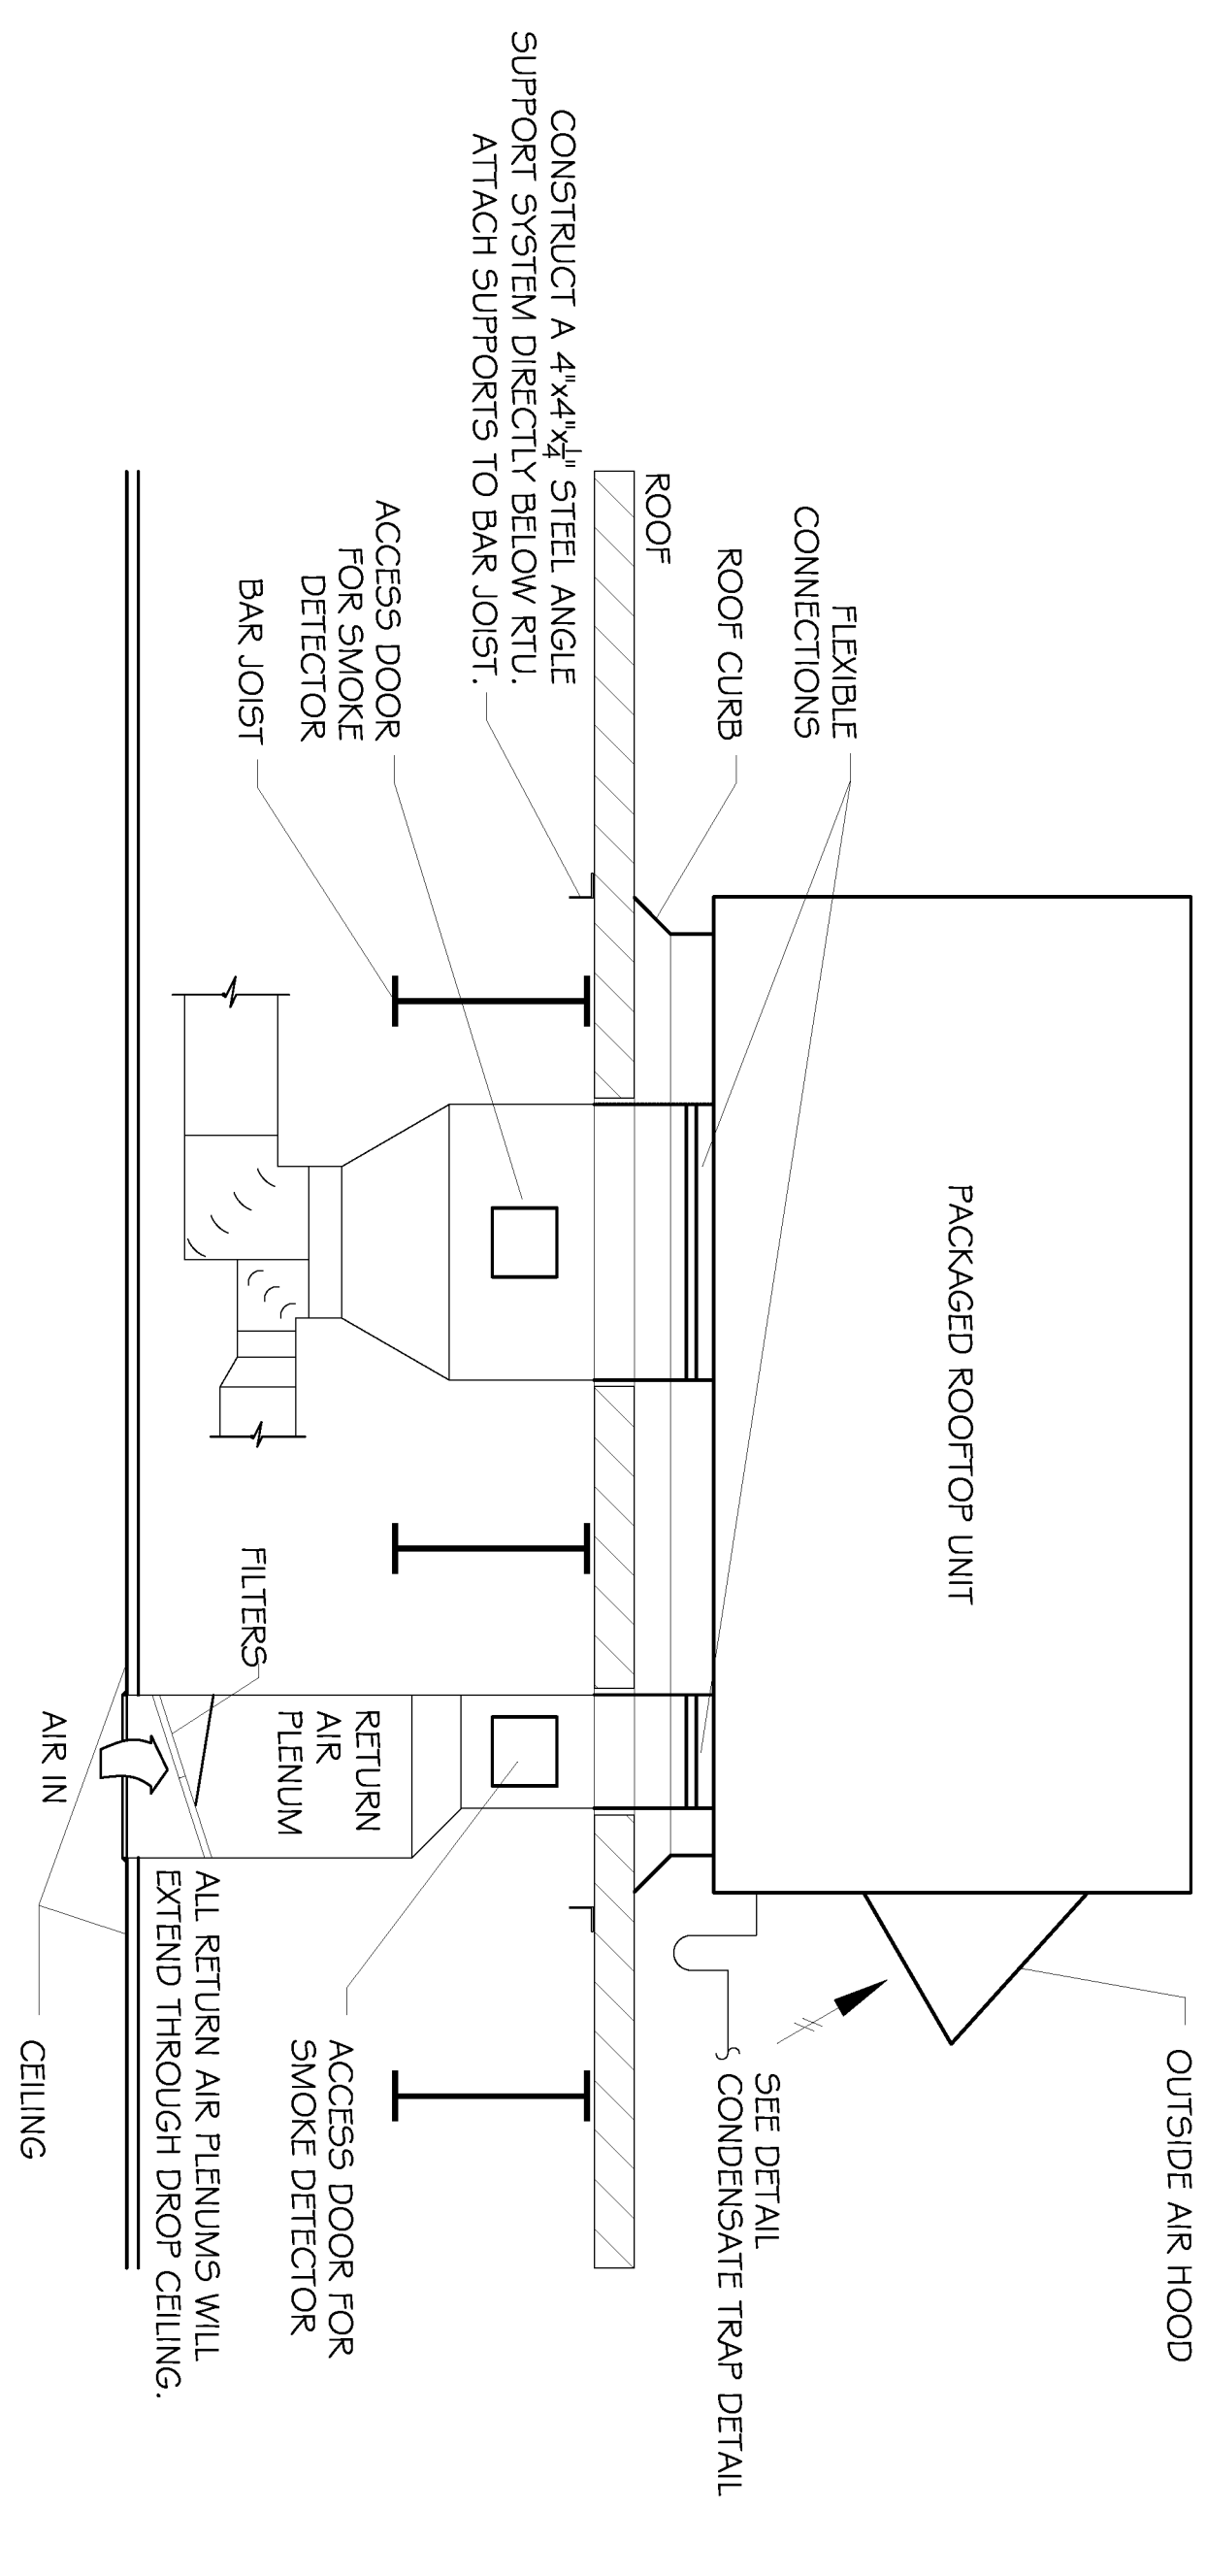


TYPICAL ROOFTOP UNIT DETAIL
NOT TO SCALE

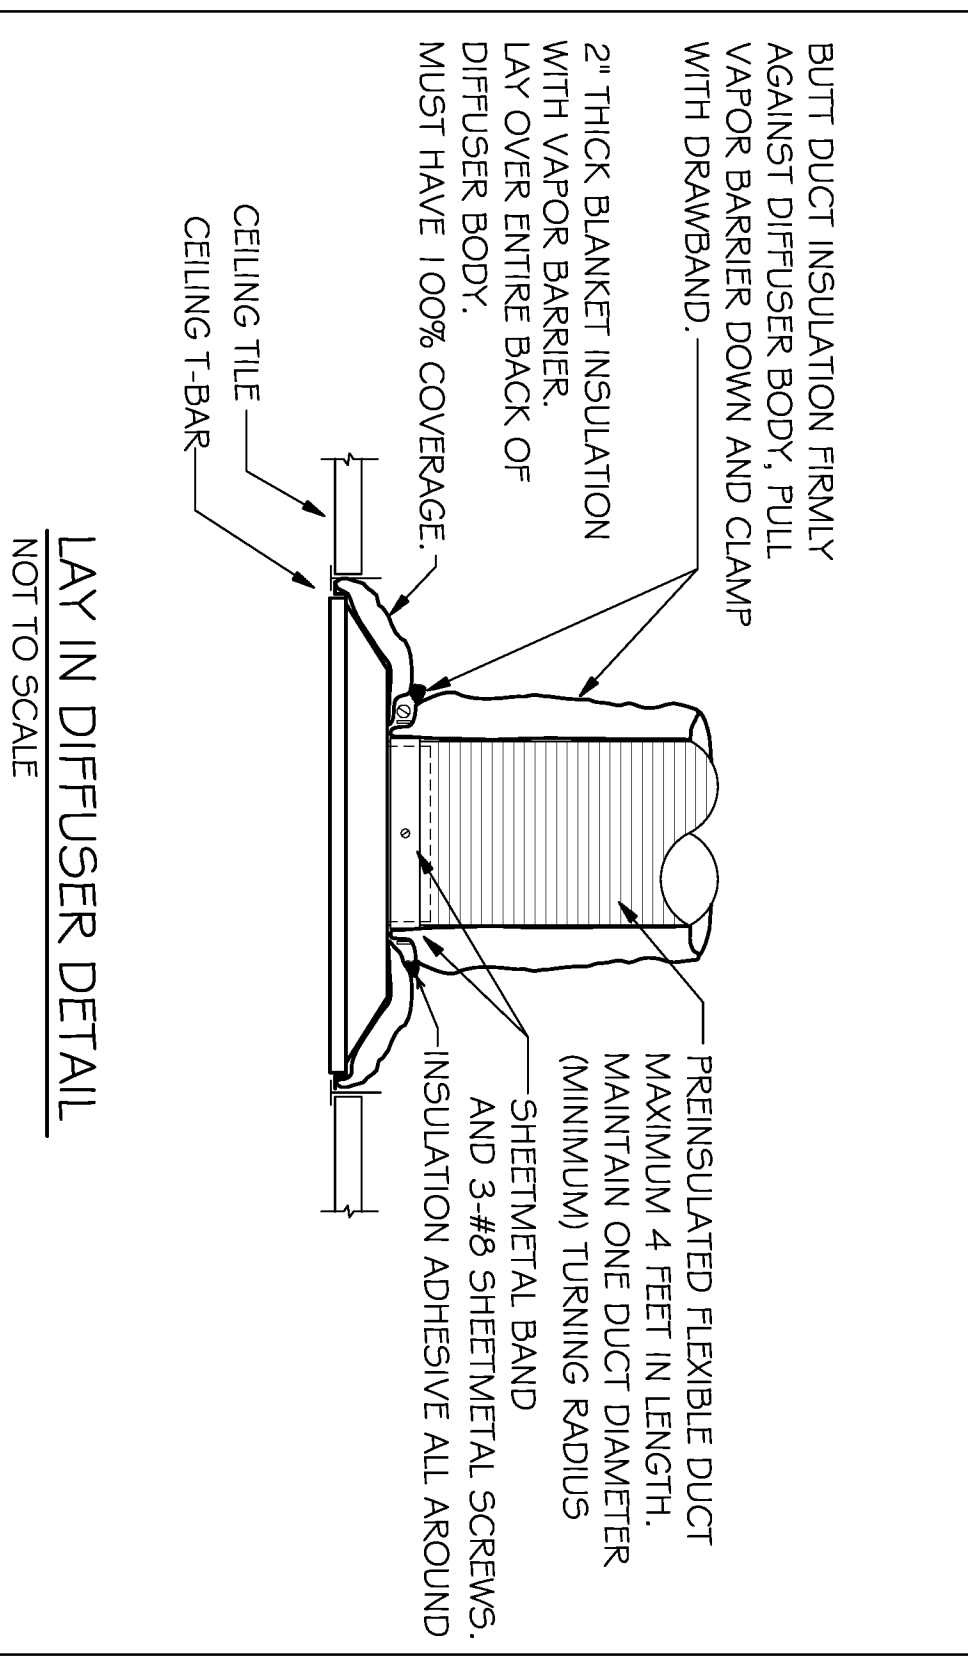


LAY IN DIFFUSER DETAIL
NOT TO SCALE

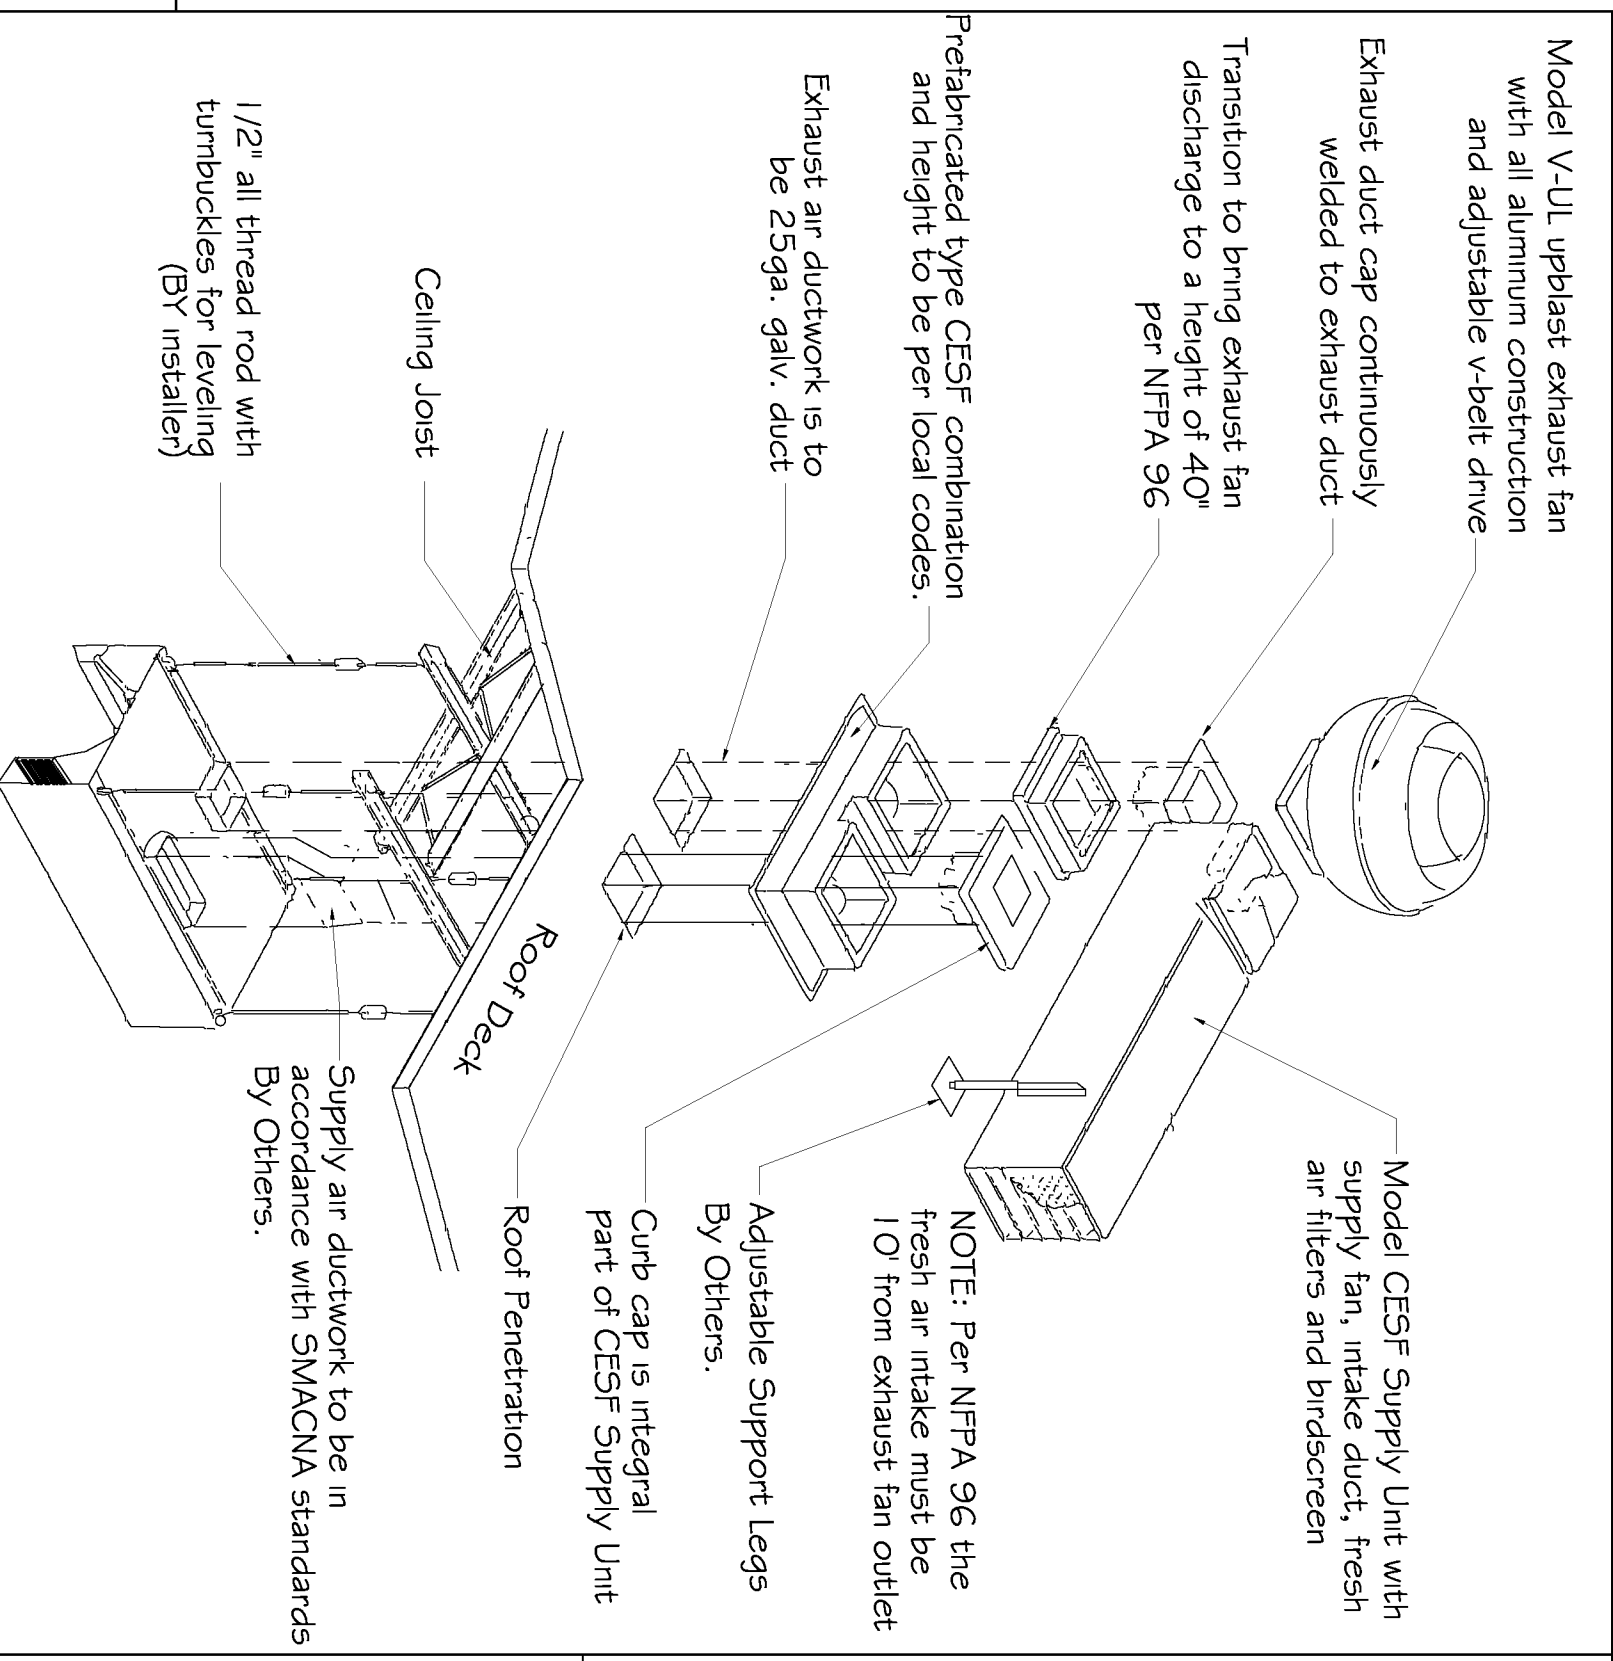


TYPICAL HOOD INSTALLATION
NOT TO SCALE
ACW WALL HOOD & CESF ROOF TOP PACKAGE

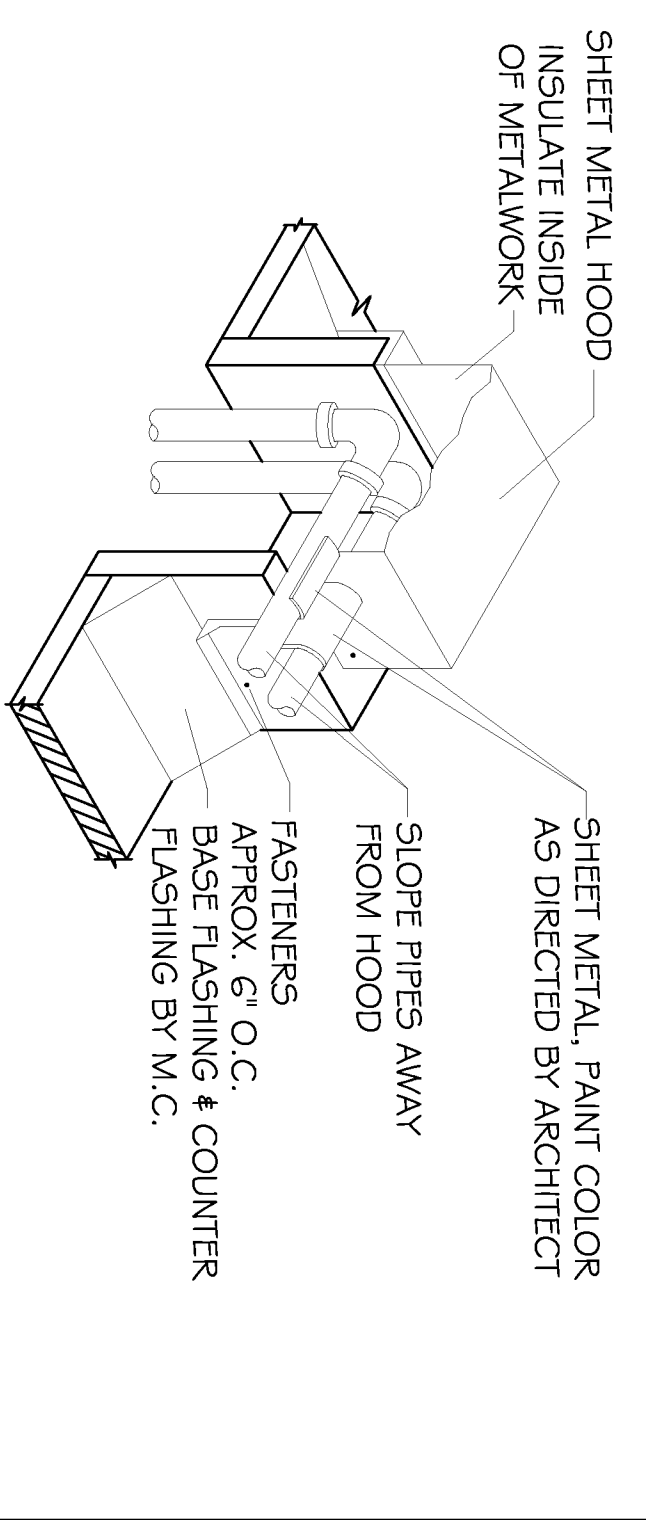


REFRIGERANT LINE/CONDUIT PIPE CURB DETAIL
NOT TO SCALE

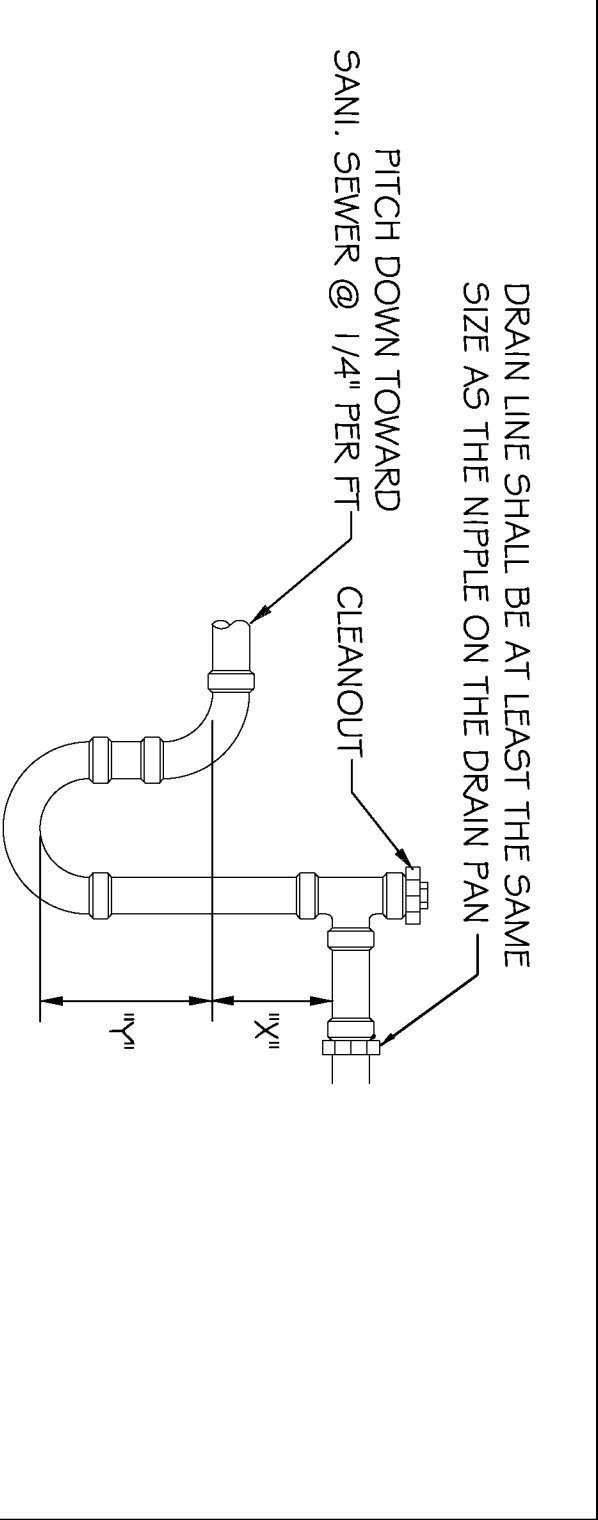

CONDENSATE TRAP DETAIL
NOT TO SCALE

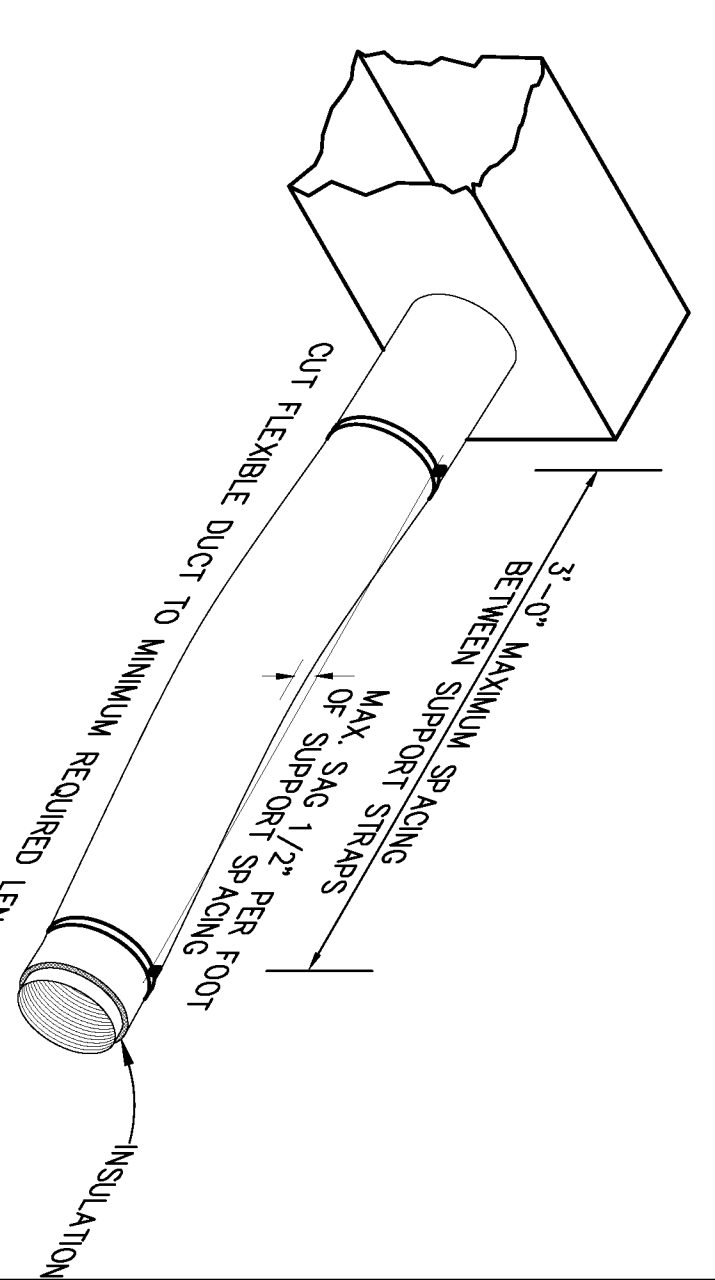


FLEX DUCT SUPPORT DETAIL
NOT TO SCALE

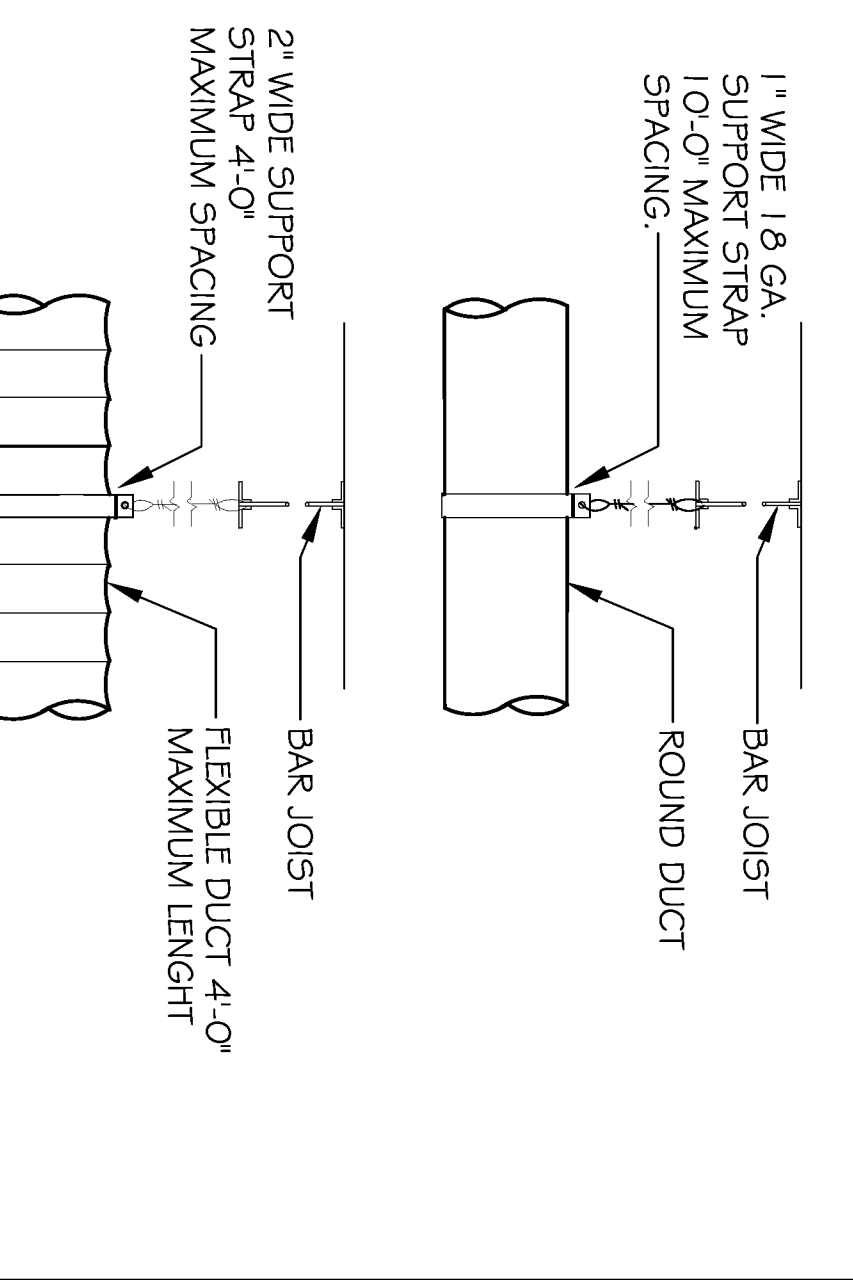

ROUND DUCT SPIN-IN DETAIL
NOT TO SCALE

DUCT SUPPORT DETAIL
NOT TO SCALE

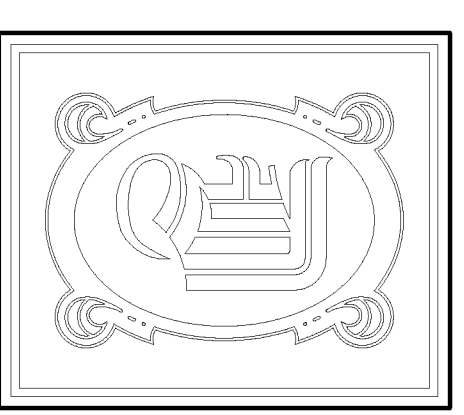

DAMMON ENGINEERING, INC.
CHIEF ENGINEER
ENNETT
DAMMON, P.E.
CHIEF ARCHITECT
ROBERT
WILTSE

554 OLD SPANISH TRAIL
SLIDELL, LA. 70458
OFFICE: 985-649-5632
FAX: 985-641-5950
WEBSITE:
WWW.DAMMONENGINEERING.COM
EMAIL:
DAMMONEN@BELL.SOUTH.NET

MARCOS
PIZZA
TENANT
BUILDOUT
INVESTIGATION
EXPERT WITNESS
PLANNING
STUDIES
ENGINEERING
ARCHITECTURE

9212 WEST
JUDGE PEREZ DR.
CHALMETTE, LA

MECHANICAL
DETAILS

REV:
SCALE: AS NOTED
JOB#: 2126
DATE: 12-08-11
SHEET 6