


ALL REMOTE COMPRESSORS TO BE LOCATED AT REAR OF BUILDING OR ON ROOF.

REMOTE COMPRESSORS WILL BE USED FOR THIS STORE.

PROVIDE STAINLESS STEEL CLOSURE PIECES TO SEAL AIR SPACE BETWEEN WALL AND COOLERS. SEAL WITH CLEAR SEALANT - TYP.

MAINTAIN AIR SPACE PER MANUFACTURER'S RECOMMENDATIONS FOR FREEZER AND COOLER
FREEZER HEIGHT IS 9'-6" A.F.F.
REMOTE UNITS REQUIRE A MINIMUM 10'-0" A.F.F. (CLEAR SPACE)

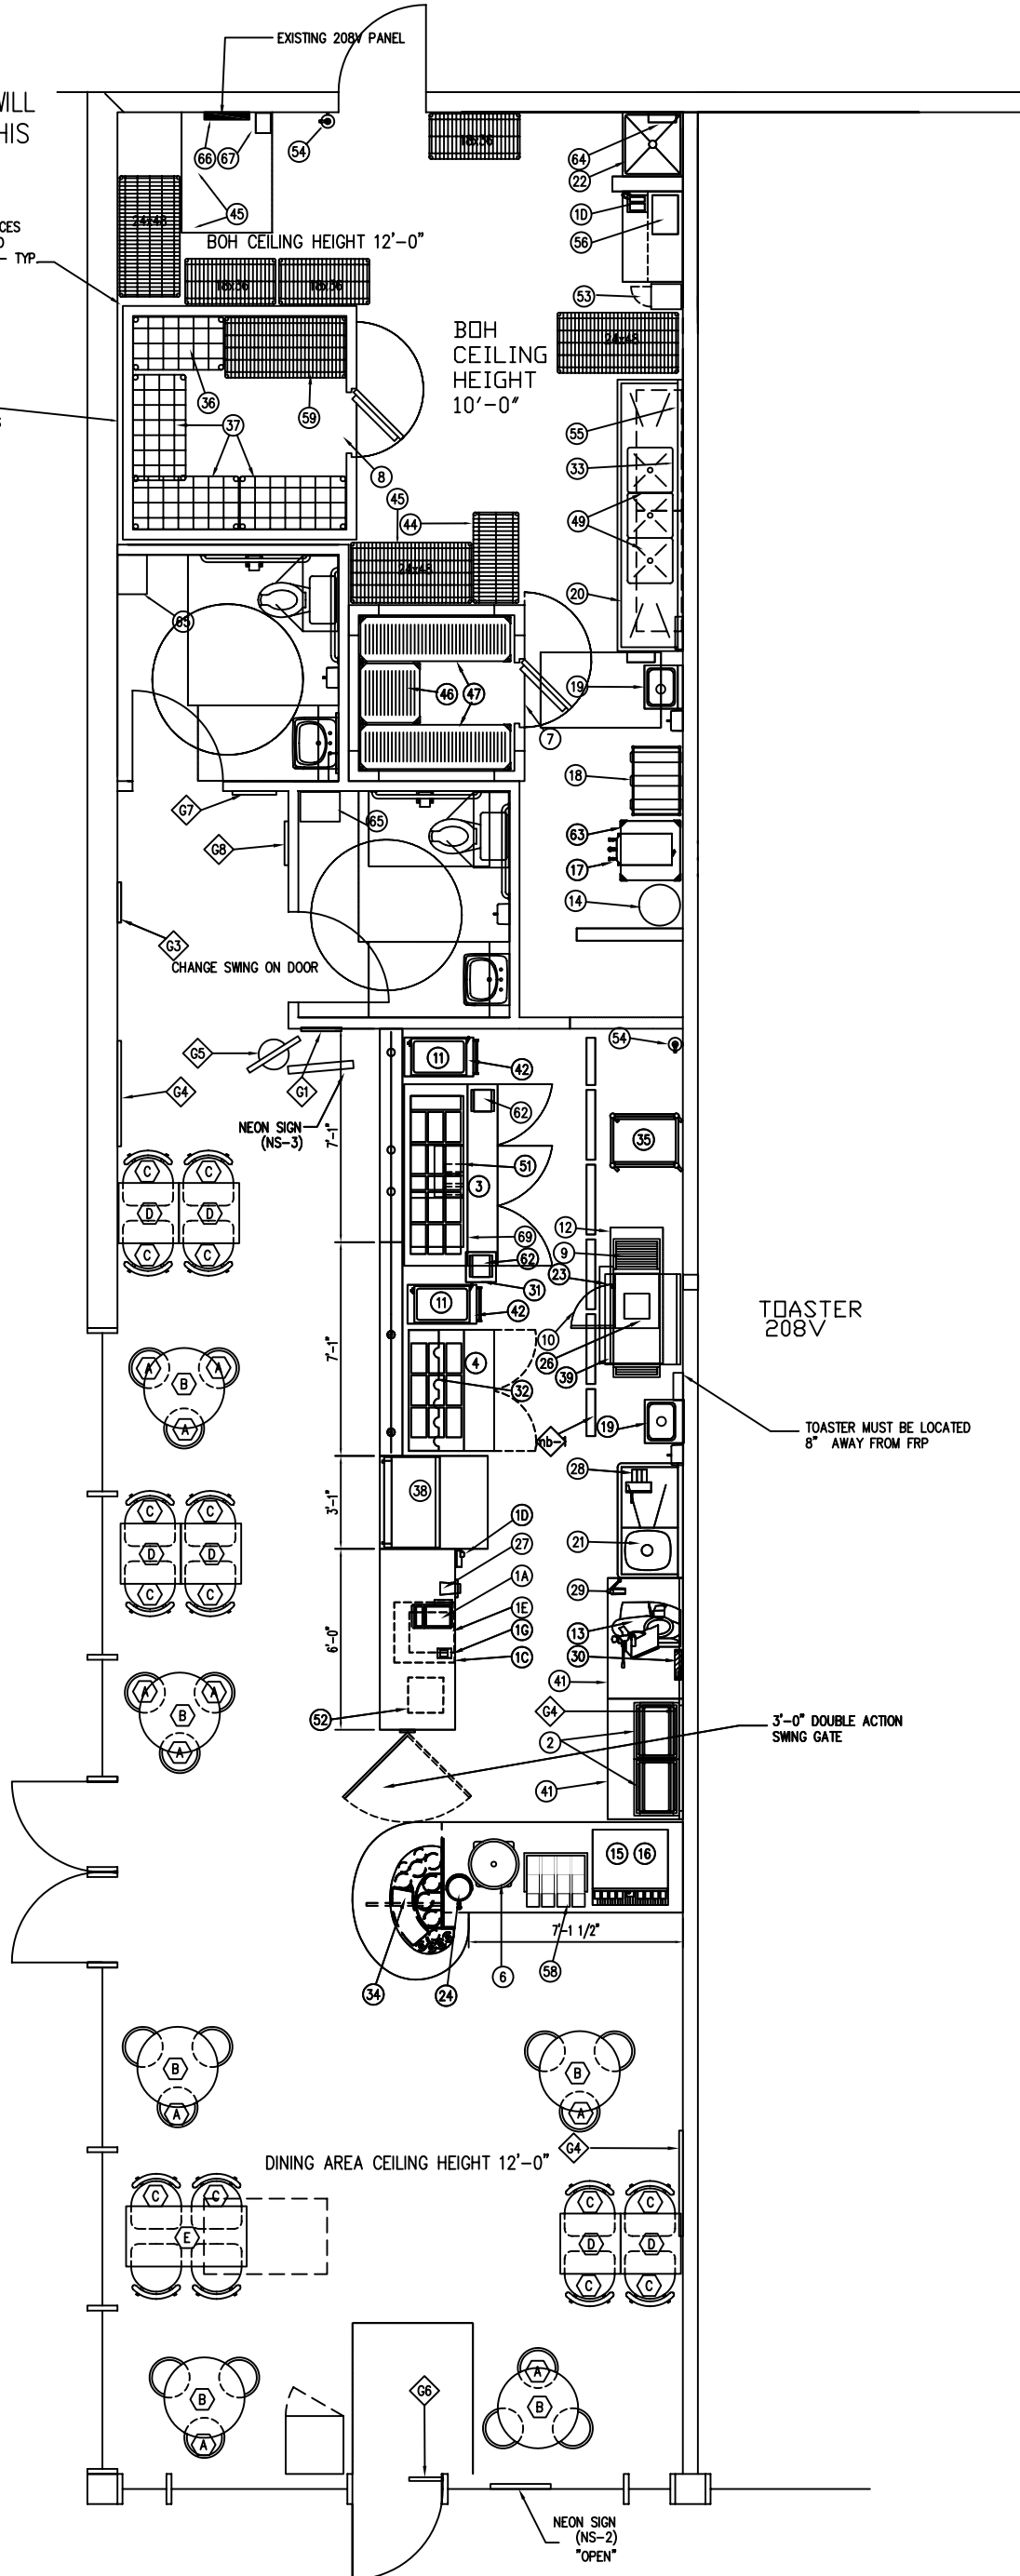

revised STORE

1600 S.F.

#12208 SCHEMATIC