GAS LOAD SCHEDULE

EQUIPMENT	BTUH INPUT
STOVE	140,000
FRYER 1	120,000
FRYER 2	120,000
TOTAL USAGE	380,000
PIPING SIZES BASED ON TOTAL DEV. LENGTH 45 FT. INLET PRESSURE @ 7"-12" WC PRESSURE, 0.3" C PRESSURE DROP, .60 SPECIFIC GRAVITY.	

GAS RISER NOTES

1. GAS PIPING DROP TO PIZZA OVEN.
2. NEW NATURAL GAS SERVICES METER & REGULATOR BY UTILITY COMPANY. CONTRACTOR SHALL CONTACT UTILITY COMPANY WITH TOTAL BLDG. LOAD.

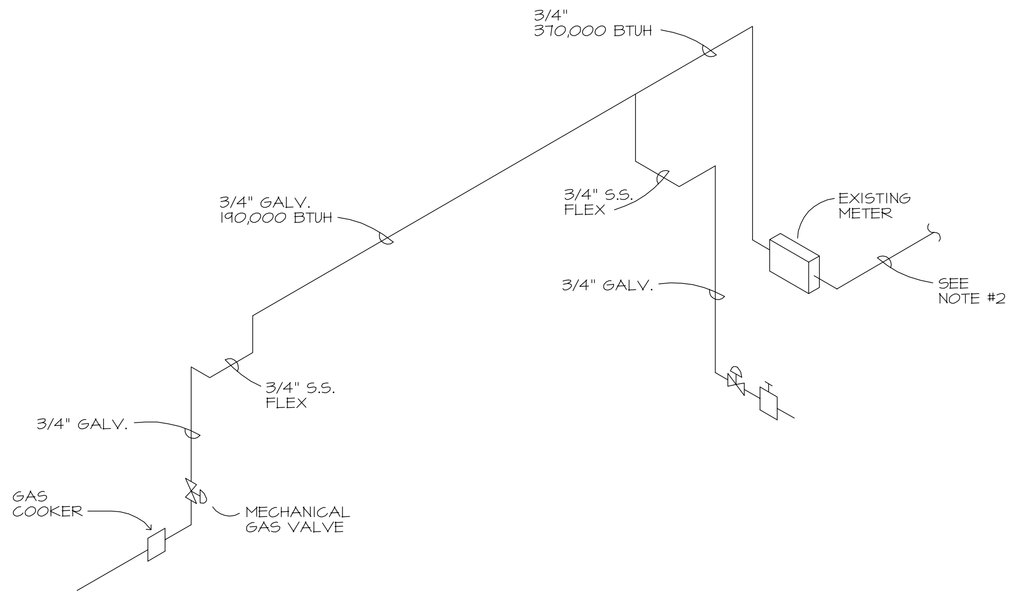

GAS RISER

SCALE: NONE

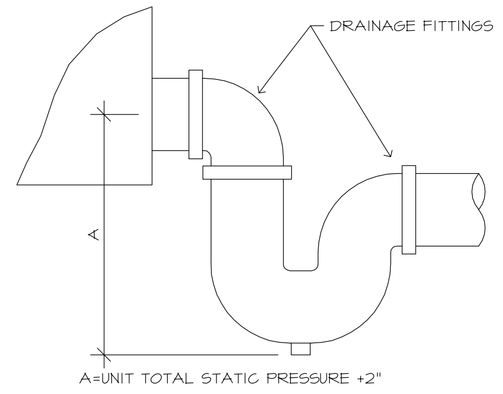

DETAIL OF DRAIN AT UNITS

SCALE: NONE

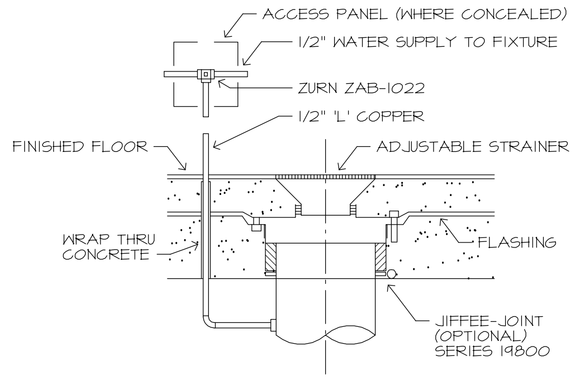

FLOOR DRAIN / TRAP PRIMER (AS REQUIRED BY CODE)

SCALE: NONE

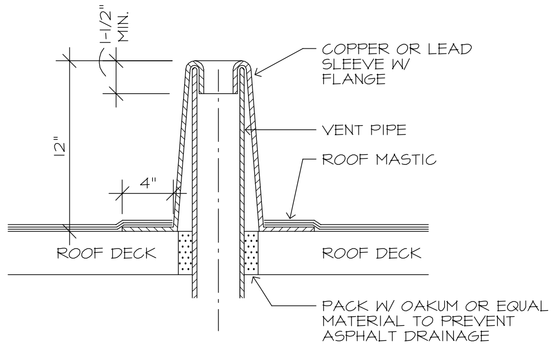

VENT THRU ROOF DETAIL

SCALE: NONE

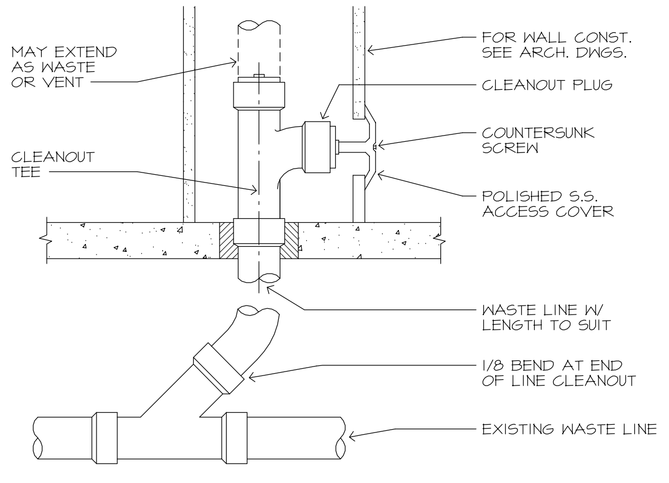

CLEANOUT DETAIL

SCALE: NONE

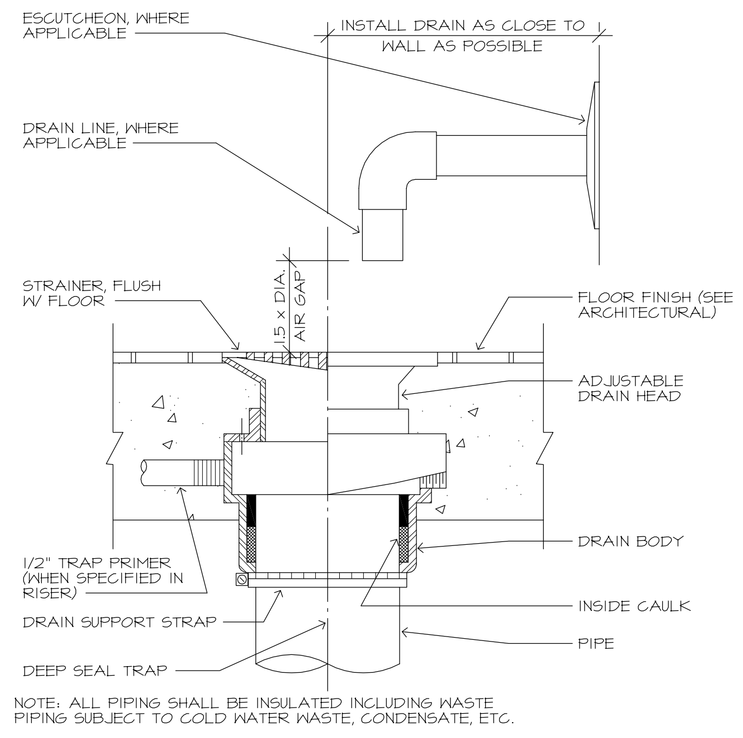

FLOOR DRAIN DETAIL

SCALE: NONE

W • ARCHITECT, P.A.

4100 LEGENDARY DRIVE, SUITE 240
DESTIN, FLORIDA 32541
850.865.0470
Member of American Institute of Architects
DBPR NBR AA 2600-1732

Copyright 2013 W• Architect, P.A.

PROPERTY OF W. ARCHITECT, P.A. (WAPA). DO NOT REPRODUCE THESE DRAWINGS AND OR SPECIFICATIONS WITHOUT THE EXPRESSED WRITTEN CONSENT OF WAPA. THE DRAWINGS AND SPECIFICATIONS ARE INSTRUMENTS OF THE SERVICE AND SHALL REMAIN THE PROPERTY OF WAPA WHETHER THE PROJECT FOR WHICH THEY ARE CREATED IS EXECUTED OR NOT. THESE DRAWINGS AND SPECIFICATIONS SHALL NOT BE USED BY ANYONE ON ANY OTHER PROJECTS, FOR ADDITIONS TO THIS PROJECT, OR FOR COMPLETION OF THIS PROJECT UNLESS THE EXPRESSED WRITTEN PERMISSION OF W. ARCHITECT, P.A. IS GIVEN.

W. ANDREW POPE
LOUISIANA LICENSE 3053

PROJECT

STIX HIBACHI RESTAURANT
CAMELLIA SQUARE
SLIDELL, LOUISIANA

STIX HIBACHI & SUSHI

ISSUED FOR :

- ☐ SCHEMATICS
- ☐ DESIGN DEVELOPMENT
- ☐ 60% REVIEW
- ☐ 100% CONTRACT DOCUMENTS
- ☐ DEVELOPMENT ORDER
- ☐ PRICING
- ☐ BIDDING
- ☒ PERMIT
- ☐ CONSTRUCTION

DATE:
NO. OF PAGES:

SHEET TITLE

PLUMBING DETAILS

DATE

MAY 30 2013

REVISIONS

DATE	REMARKS

P-2

SHEET NO.