GA FILE NO. WP 4136 GENERIC

BASE LAYER 5/8" TYPE X GYPSUM WALLBOARD OR VENEER BASE APPLIED PARALLEL OR AT RIGHT ANGLES TO EACH SIDE OF 2 X 4 WOOD STUDS 16" O.C. WITH 1 1/4" TYPE W DRYWALL SCREWS 12" O.C. FACE LAYER 5/8" TYPE X GYPSUM WALLBOARD OR VENEER BASE APPLIED PARALLEL OR AT RIGHT ANGLES TO EACH SIDE WITH 1 7/8" TYPE W DRYWALL SCREWS 12" O.C. AND OFFEST 6" FROM SCREWS IN BASE LAYER.

JOINTS STAGGERED 16" EACH LAYER AND SIDE. (LOAD BEARING)

2 HOUR FIRE 40 TO 44 STC SOUND

THICKNESS: 6 1/8"
APPROX. WEIGHT: 12 PSF
FIRE TEST: SWRI 01-5920-614, 12-5-94
SOUND TEST: SEE WP 4135 (NGC 2363, 4-1-70)

GA FILE NO. WP 4230 GENERIC

BASE LAYER 5/8" TYPE X GYPSUM WALLBOARD APPLIED AT RIGHT ANGLES TO EACH SIDE OF 2 X 6 WOOD STUDS 24" O.C. WITH 2 1/4" TYPE S OR W DRYWALL SCREWS 24" O.C. FACE LAYER 5/8" TYPE X GYPSUM WALLBOARD APPLIED AT RIGHT ANGLES TO EACH SIDE WITH 2 1/4" TYPE S DRYWALL SCREWS 8" O.C. 5 1/2" MINERAL FIBER INSULATION, NOMINAL 3 PCF, FRICTION FIT IN STUD SPACE.

JOINTS STAGGERED 24" EACH LAYER AND SIDE.

TESTED AT 5,506 LBS. PER STUD OR 100 PERCENT OF DESIGN LOAD. (LOAD BEARING)

2 HOUR FIRE

THICKNESS: 8"
APPROX. WEIGHT: 13 PSF
FIRE TEST: ITS J20-06170.3, 12-00

NOTES:
1 - SEE SHTS S-2, A-3 & A-4 FOR LOCATION OF EXTERIOR WALL CONTROL JOINTS.
2 - INSTALL SOAP (SD), PAPER TOWEL (PT) & TOILET PAPER (TP) DISPENSERS TO BE PROVIDED BY OWNER.

LEGEND
- 1 HR. RATED CONST. DEMISE TO ROOF DECK
- 2 HR. RATED CONST. DEMISE TO ROOF DECK
- ROLLING FIRE SHUTTER
- VAULT CONSTRUCTION
- WD. STD. & GYP. BD. PARTITIONS
- 4" FACE BRICK

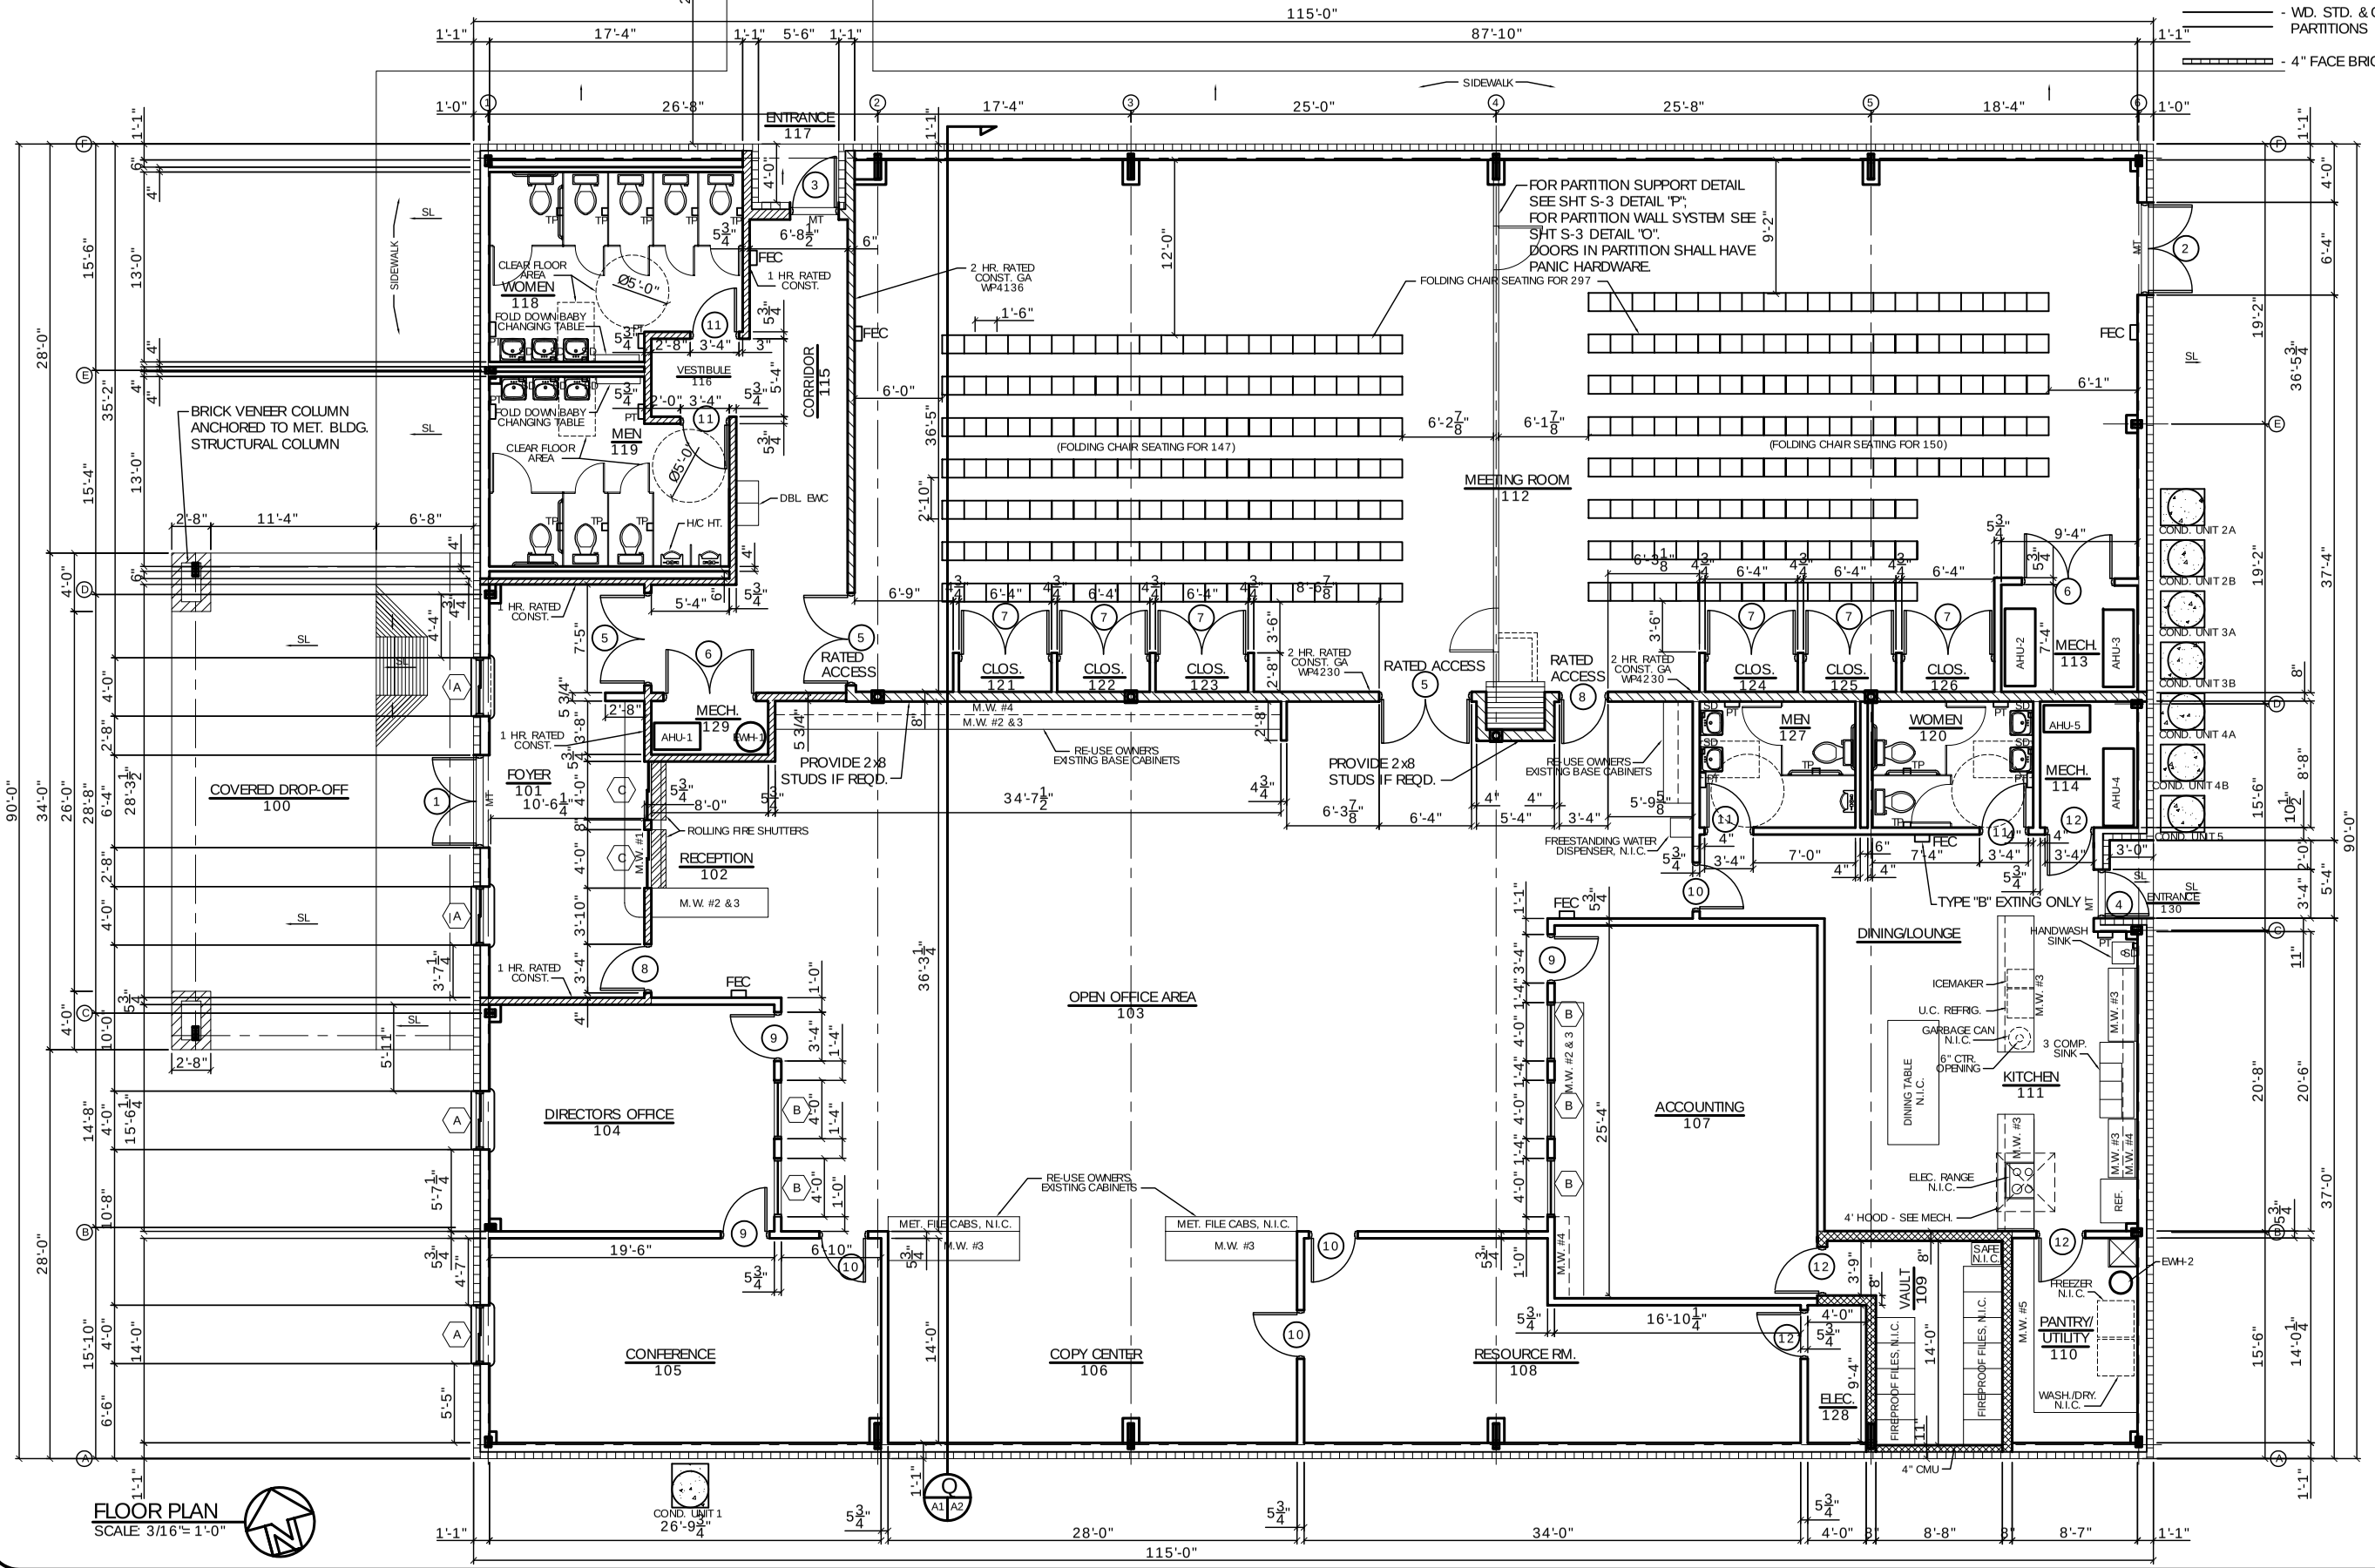

FLOOR PLAN
SCALE: 3/16"= 1'-0"

DAMMON ENGINEERING, INC.

CHIEF ENGINEER
EMMETT
DAMMON, P.E.

CHIEF ARCHITECT
ROBERT
WILTSE

1095 FLORIDA AVENUE
SLIDELL, LA. 70458
OFFICE: 985-649-5832
FAX: 985-641-5950

WEBSITE:
WWW.DAMMONENGINEERING.COM

EMAIL:
DAMMONENG@BELLSOUTH.NET

ARCHITECTURE

ENGINEERING

STUDIES

PLANNING

INVESTIGATION

EXPERT WITNESS

NEW OFFICE COMPLEX

CHILD DEVELOPMENT COUNCIL OF ACADIANA, INC.
OPELOUSAS, LA

FLOOR PLAN

REV: 12-4-09 F.M.
REV. 12-7-09 CONST.

SCALE: AS NOTED

JOB#: 2030

DATE: 10-19-09

SHEET 10

A-1

OF 26