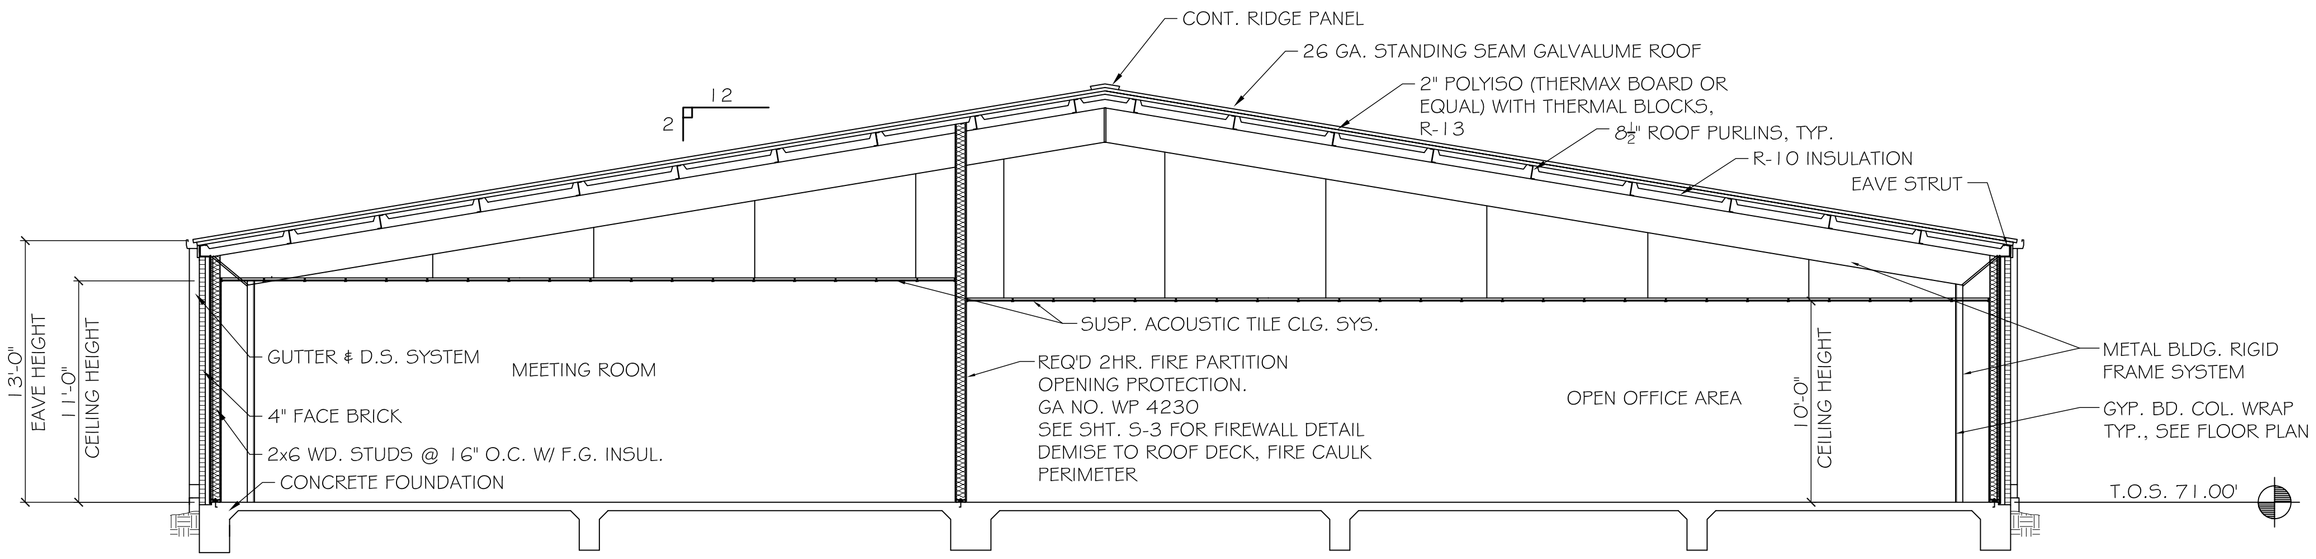

SECTION Q
SCALE: 3/16"=1'-0"

GENERAL NOTES

1. INSULATION AND INSULATION ASSEMBLIES SHALL MEET THE REQUIREMENTS OF SECTION 719.
   A. CONCEALED INSULATION SHALL HAVE A FLAME SPREAD OF 0-25 AND SMOKE DEVELOPED INDEX OF 0-450. EXCEPT THAT IN COMBUSTIBLE (WOOD FRAME) CONSTRUCTION.
   B. FACING SHALL COMPLY WITH IBC 2006.
2. PROVIDE 5'x5' LANDINGS, LEVEL WITH FINISHED FLOOR, OUTSIDE EXTERIOR DOORS. THRESHOLDS SHALL BE NOT MORE THAN 1/2" IN HEIGHT AND SHALL BE BEVELED IF MORE THAT 1/4".
3. DIMENSIONS ARE TO CENTERLINE, FACE OF PARTITIONS CENTER OF COLUMNS, OR FACE OF VENEER.
4. CONTRACTOR TO VERIFY ALL SITE CONDITIONS, BUILDING LOCATIONS, AND DIMENSIONS PRIOR TO CONSTRUCTION.
5. MATERIALS SHALL BE NEW AND U.L. LISTED.
6. NO WORK SHALL BE CONCEALED UNTIL APPROVED BY LOCAL INSPECTORS.
7. CONSTRUCTION SHALL COMPLY WITH ALL PARISH, STATE, AND LOCAL CODES.
8. CONTRACTOR TO GUARANTEE WORK FOR ONE YEAR.
9. CONTRACTOR SHALL FURNISH WATER AND POWER FROM EXISTING SOURCES.
10. EXTERIOR CAULK SHALL BE DOW CORNING 790 SILICONE, INSTALL IN ACCORDANCE WITH MANUFACTURER RECOMMENDATIONS. COORDINATE WITH ARCHITECT/OWNER AS TO COLOR. INTERIOR CAULKING TO BE EQUAL TO DAP PAINTABLE LATEX WITH SILICONE.
11. PAINT GRADE TO SHALL BE SHERWIN WILLIAMS OR EQUIVALENT. ALL WORK TO RECEIVE 3 COATS. COLOR SELECTION BY OWNER.
12. PROVIDE CLEANUP ON A REGULAR BASIS. NO TRASH STORED IN BUILDING.
13. ALL BATT INSULATION SHALL HAVE A CLASS "A" (0-25) FLAME SPREAD IN COMPLIANCE WITH APPLICABLE CODE.
14. PROVIDE GALVANIZED METAL PAN WITH DRAIN AT WATER HEATER LOCATION.
15. ALL CORNERS SHALL BE PROPERLY BRACED FOR WIND LOADS. A 48" SHEATHING SHALL BE PROVIDED EVERY 20 FEET OF WALL LENGTH.
16. FLOORING SHALL BE NON-SLIP.
17. INTERIOR LOCKS ON DOORS IN MEANS OF EGRESS SHALL NOT REQUIRE THE USE OF A KEY, SPECIAL KNOWLEDGE, OR SPECIAL DEVICE TO OPEN IN THE DIRECTION OF EGRESS. ALL DOORS SHALL HAVE LEVER TYPE HANDLES.
18. INTERIOR WALLS AND CEILINGS SHALL HAVE A FLAME SPREAD OF 0-200 AND A SMOKE DEVELOPMENT RATING OF 0-450.
19. ALL WORK SHALL COMPLY WITH THE LATEST EDITION OF ALL LOCAL, STATE, AND NATIONAL CODES COVERING THE TYPE OF WORK BEING PERFORMED.
20. PROVIDE PORTABLE FIRE EXTINGUISHERS IN ACCORDANCE WITH NFPA 101. SEE APPENDIX "E" OF NFPA 101 FOR DISTRIBUTION OF EXTINGUISHERS.
21. ALL FIRE WALLS SHALL EXTEND TIGHT TO ROOF SHEATHING, AND BE SEALED WITH AN APPROVED FIRE CAULK.
22. ALL ELECTRICAL, MECHANICAL, AND PLUMBING MATERIALS PENETRATING FIRE WALLS SHALL BE FIRE CAULKED. (PENETRATIONS THROUGH RATED CONSTRUCTION SHALL BE SEALED WITH A MATERIAL CAPABLE OF PREVENTING THE PASSAGE OF FLAMES AND HOT GASES WHEN TESTED IN ACCORDANCE WITH ASTM-E814.)
23. SERVICE COUNTER SHALL HAVE A HCP ACCESSIBLE WRITING SURFACE, MAX. 36" FROM F.F. (ADAAG MANUAL 1998, PG 135)

DOOR & HARDWARE SCHEDULE

MARK	DETAILS HEAD	DETAILS JAMB	DETAILS SILL	SIZE	DOOR TYPE	FRAME	HDWR. NO.	STC	REMARKS
EXTERIOR DOORS									
1	- -	- -	- -	PR. 3/0x7/0 W/ 1/2 LITE	FLUSH GALV. PTD. STL. INSUL.	GALV. PTD. STL.	1	N/A	PROVIDE REMOVABLE CTR. MULLION
2	- -	- -	- -	PR. 3/0x7/0	FLUSH GALV. PTD. STL. INSUL.	GALV. PTD. STL.	1	N/A	PROVIDE REMOVABLE CTR. MULLION
3	- -	- -	- -	3/0x7/0 W/ 6"x30" LITE	FLUSH GALV. PTD. STL. INSUL.	GALV. PTD. STL.	1	N/A	
4	- -	- -	- -	3/0x7/0	FLUSH GALV. PTD. STL. INSUL.	GALV. PTD. STL.	1	N/A	
INTERIOR DOORS									
5	- -	- -	- -	PR. 3/0x7/0 W/ 6"x36" LITE	FLUSH SOL. CORE WD.	PTD. STL.	2	N/A	1HR. "B" LABEL PROVIDE REMOVABLE CTR. MULLION 1 1/2HR. @ "RATED ACCESS"
6	- -	- -	- -	PR. 3/0x7/0	FLUSH SOL. CORE WD.	PTD. STL.	3	45	1HR. "B" LABEL PROVIDE REMOVABLE CTR. MULLION
7	- -	- -	- -	PR. 3/0x7/0	FLUSH SOL. CORE WD.	PTD. STL.	4	N/A	
8	- -	- -	- -	3/0x7/0 W/ 6"x36" LITE	FLUSH SOL. CORE WD.	PTD. STL.	5	N/A	1HR. "B" LABEL 1 1/2HR. @ "RATED ACCESS"
9	- -	- -	- -	3/0x7/0	FLUSH SOL. CORE WD.	PTD. STL.	6	N/A	
10	- -	- -	- -	3/0x7/0 W/ 6"x36" LITE	FLUSH SOL. CORE WD.	PTD. STL.	6	N/A	
11	- -	- -	- -	3/0x7/0	FLUSH SOL. CORE WD.	PTD. STL.	7	N/A	1HR. "B" LABEL @ RM. 118 & 119
12	- -	- -	- -	3/0x7/0 W/ 6"x36" LITE	FLUSH SOL. CORE WD.	PTD. STL.	8	N/A	1HR. "B" LABEL

DOOR HARDWARE PACKAGES

1. AUTO CLOSER, PANIC BAR, MTL. TRESH., WEATHERSTRIP, DR. STOP, EXT. CYLINDER LOCK (OFFICE/ENT.), BALL BEARING US32 HINGES.
2. AUTO CLOSER, PANIC BAR W/ OFFICE/ENT. LOCK @ RM. 112., DR. STOP, BALL BEARING US26D HINGES.
3. AUTO CLOSER, STOREROOM LOCK, DR. STOP, BALL BEARING US26D HINGES.
4. STOREROOM LOCK/DUMMY KNOB, HEAD & FOOT BOLT ON INACTIVE LEAF, US26D HINGES.
5. AUTO CLOSER, OFFICE/ENT. LOCK, DR. STOP, US26D HINGES.
6. OFFICE/ENT. LOCK, DR. STOP, US26D HINGES.
7. PRIVACY LOCK @ RM.120/127., PUSH-PULL @ RM.$118/_{119}$, AUTO CLOSER, DR. STOP, BALL BEARING US26D HINGES.
8. AUTO CLOSER, STOREROOM LOCK, DR. STOP, BALL BEARING US26D HINGES.

WINDOW SCHEDULE

MARK	DETAILS HEAD	DETAILS JAMB	DETAILS SILL	SIZE	DOOR / WINDOW TYPE	FRAME	GLASS	LITES	REMARKS
A	- -	- -	- -	4/0x4/0	EXT. HORZ. SLIDER	ALUM. W/ 1/2 SCREEN	LOW E	DBL. GLAZED	DARK BRONZE ANODIZED FINISH WIND & MISSLE IMPACT RESISTANT
B	- -	- -	- -	4/0x4/0	INT. FIXED	PTD. HOLLOW MTL.	CLEAR LAMINATED SAFETY	FULL	GLASS SET IN MTL. STOPS
C	- -	- -	- -	4/0x4/0	INT. HORZ. SLIDER	ALUM. TRACKS	CLEAR TEMPERED	FULL	PROVIDE FINGER PULLS PROVIDE ROLLING FIRE SHUTTER

FINISH SCHEDULE

ROOM NUMBER	ROOM NAME	WALLS	EXTEND WALL TO DECK ABOVE	FLOOR	WALL BASE	CEILING	CLG. HT.	CABINETRY	NOTES	COMMENTS
100	COVERED DROP-OFF	BRICK VENEER	YES	BROOM SWEPT CONCRETE	NONE	MET. SOFFIT PANEL	12' NOM.	NONE		
101	FOYER	PTD GWB	N, E, S SIDE	12x12 VCT	4" RUBBER	SAT	10'-0"	RECEPT. WDW.		
102	RECEPTION	PTD GWB	N & W SIDE	12x12 VCT	4" RUBBER	SAT	10'-0"	RECEPT. CTR.		
103	OPEN OFFICE AREA	PTD GWB	NORTH SIDE	12x12 VCT	4" RUBBER	SAT	10'-0"	SEE A-1		
104	DIRECTORS OFFICE	PTD GWB	NORTH SIDE	CARPET	4" RUBBER	SAT	10'-0"	NONE		
105	CONFERENCE	PTD GWB	NO	CARPET	4" RUBBER	SAT	10'-0"	NONE		
106	COPY CENTER	PTD GWB	NO	12x12 VCT	4" RUBBER	SAT	10'-0"	SEE A-1		
107	ACCOUNTING	PTD GWB	NO	12x12 VCT	4" RUBBER	SAT	10'-0"	SEE A-1		
108	RESOURCE ROOM	PTD GWB	NO	12x12 VCT	4" RUBBER	SAT	10'-0"	NONE		
109	VAULT	PTD GWB	NO	12x12 VCT	4" RUBBER	5/8" GYP. BD.	12' NOM.	NONE		
110	PANTRY / UTILITY	PTD GWB	NO	12x12 VCT	4" RUBBER	5/8" GYP. BD.	10'-0"	UTILITY SHELVING		
111	KITCHEN	PTD GWB	NO	12x12 VCT	4" RUBBER	SAT	10'-0"	SEE A-1		
112	MEETING ROOM	PTD GWB	SOUTH & WEST SIDES	12x12 VCT	4" RUBBER	SAT	11'-0"	NONE		
113	MECHANICAL ROOM	PTD GWB	SOUTH SIDE	12x12 VCT	4" RUBBER	5/8" GYP. BD.	12' NOM.	NONE		ADJ. CEILING HGT. AS REQD. FOR EQUIP.
114	MECHANICAL ROOM	PTD GWB	NORTH SIDE	12x12 VCT	4" RUBBER	5/8" GYP. BD.	12' NOM.	NONE		ADJ. CEILING HGT. AS REQD. FOR EQUIP.
115	CORRIDOR	PTD GWB	YES	12x12 VCT	4" RUBBER	5/8" GYP. BD.	10'-0"	NONE		
116	VESTIBULE	PTD GWB	YES	12x12 VCT	4" RUBBER	5/8" GYP. BD.	12' NOM.	NONE		
117	ENTRANCE	BRICK VENEER	EAST & WEST SIDES	BROOM SWEPT CONCRETE	NONE	MET. SOFFIT PANEL	12' NOM.	NONE		
118	WOMEN	PTD GWB	EAST SIDE	QT	QT. BULLNOSE 6" MIN. HT.	SAT	10'-0"	NONE		NONABSORBENT PANEL, MIN. 4' HIGH WITHIN 2' OF W.C.
119	MEN	PTD GWB	EAST SIDE	QT	QT. BULLNOSE 6" MIN. HT.	SAT	10'-0"	NONE		NONABSORBENT PANEL, MIN. 4' HIGH WITHIN 2' OF W.C.
120	WOMEN	PTD GWB	NORTH SIDE	QT	QT. BULLNOSE 6" MIN. HT.	SAT	10'-0"	NONE		NONABSORBENT PANEL, MIN. 4' HIGH WITHIN 2' OF W.C.
121-126	CLOSETS	PTD GWB	SOUTH SIDE	12x12 VCT	4" RUBBER	5/8" GYP. BD.	10'-0"	NONE		
127	MEN	PTD GWB	NORTH SIDE	QT	QT. BULLNOSE 6" MIN. HT.	SAT	10'-0"	NONE		NONABSORBENT PANEL, MIN. 4' HIGH WITHIN 2' OF W.C.
128	ELECTRICAL ROOM	PTD GWB	NO	12x12 VCT	4" RUBBER	5/8" GYP. BD.	12' NOM.	NONE		
129	MECHANICAL ROOM	PTD GWB	YES	12x12 VCT	4" RUBBER	5/8" GYP. BD.	12' NOM.	NONE		ADJ. CEILING HGT. AS REQD. FOR EQUIP.
130	ENTRANCE	BRICK VENEER	YES	BROOM SWEPT CONCRETE	NONE	MET. SOFFIT PANEL	12' NOM.	NONE		

DAMMON
ENGINEERING, INC.

CHIEF ENGINEER
EMMETT
DAMMON, P.E.

CHIEF ARCHITECT
ROBERT
WILTSE

1095 FLORIDA AVENUE
SLIDELL, LA. 70458
OFFICE: 985-649-5832
FAX: 985-641-5950

WEBSITE:
WWW.DAMMONENGINEERING.COM

EMAIL:
DAMMONENG@BELLSOUTH.NET

ARCHITECTURE

ENGINEERING

STUDIES

PLANNING

INVESTIGATION

EXPERT WITNESS

NEW OFFICE COMPLEX

CHILD DEVELOPMENT COUNCIL OF ACADIANA, INC. OPELOUSAS, LA

SECTION & SCHEDULES

REV: 12-7-09 FOR CONST.

SCALE: AS NOTED

JOB#: 2030

DATE: 10-19-09

SHEET 11

A-2

OF 26