



ROOF MECHANICAL EQUIPMENT PLAN
SCALE 1/8" = 1'

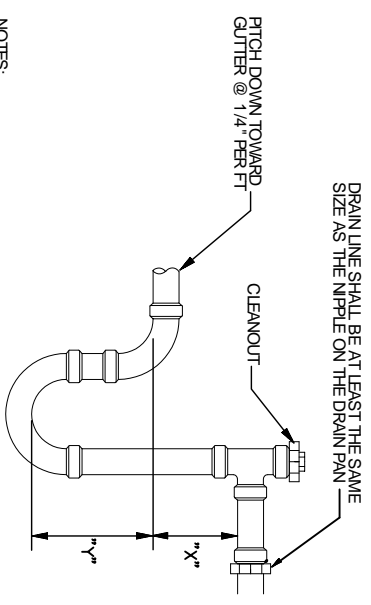


NOTES:
LENGTHS "X" AND "Y" SHALL BE DETERMINED BY ROOFTOP UNIT EQUIPMENT BASED ON TOTAL STATIC PRESSURE
"X" AND "Y" SHALL BE EQUAL TO MINIMUM 1/2 TOTAL UNIT STATIC PRESSURE
ALL CONDENSATE PIPING SHALL BE SLOPED AT 1/4" PER FOOT

CONDENSATE TRAP DETAIL
NOT TO SCALE

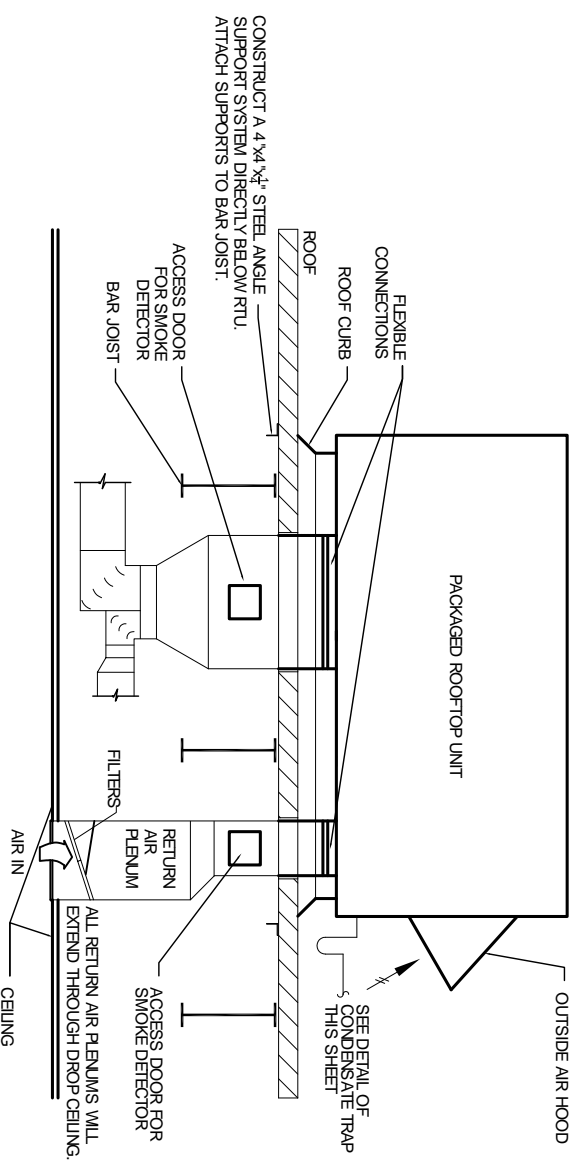

TYPICAL ROOFTOP UNIT DETAIL
NOT TO SCALE



DAMMON ENGINEERING, INC.

CHIEF ENGINEER
EAMETT DAMMON, P.E.
CHIEF ARCHITECT
ROBERT WILTSE

1095 FLORIDA AVENUE
SUDDLE, LA. 70458
OFFICE: 985-649-5832
FAX: 985-641-5950

WEBSITE:
WWW.DAMMONENGINEERING.COM
EMAIL:
DAMMONENG@TELSCOUTH.NET

ARCHITECTURE
ENGINEERING
STUDIES
PLANNING
INVESTIGATION
EXPERT WITNESS

PAUL MITCHELL
SCHOOL
8321 HESSMER AVE
METAIRIE, LA
70002

ROOF MECHANICAL EQUIPMENT PLAN

REV:
SCALE: AS NOTED
JOB#: 2051
DATE: 01-04-10
SHEET

M-6

OF