DOOR & HARDWARE SCHEDULE

DOOR	TYPE: HOLLOW WOOD	TYPE: SOLID WOOD	TYPE: ALUM./GLASS	TYPE: SLIDING/FOLD	FRAME: STEEL	FRAME: ALUMINUM	FRAME: WOOD	HINGE: MFR. BRASS	HINGE: MFR. SATIN	HINGE: MFR. SATIN/BRONZE	LOCK: PASSAGE	LOCK: PRIVACY	LOCK: DEADBOLT	LOCK: KEYED HANDLE	LOCK: PUSH PULL	LOCK: PASSAGE	ACCESSORIES: THRESHOLD	ACCESSORIES: WEATHERSTRIP	ACCESSORIES: DOOR STOP	ACCESSORIES: ALARM	ACCESSORIES: PEEP HOLE	REMARKS
1 3/0x6/8x1 3/4"	●						●		●				●	●		●	●	●	●	●	●	ENTRANCE
2 2/6x6/8x1 3/4"	●						●		●		●											BATHROOM
3 2/0x6/8x1 3/4"	●						●		●		●								●			CLOSET
4 2/0x6/8x1 1/2"	●						●		●		●											PANTRY
5 2/0x3/4x1 1/2"	●						●		●		●								●			MECH. CLOSET
6 3/0x6/8x1 3/4"	●						●		●		●								●			BEDROOM
7 (2) 2/0x6/8x1 1/2"	●						●		●		●											BI-FOLD
8 3/0x6/8x1 3/4"	●						●		●				●									HDP. BATHROOM

WINDOW SCHEDULE

WINDOW	TYPE: FIXED	TYPE: VERTICAL SLIDE	TYPE: HORIZ. SLIDE	FRAME: STEEL	FRAME: ALUMINUM	FRAME: WOOD	GLASS: TEMPERED	GLASS: PLAIN	GLASS: INSULATED	LITES: 2/2	LITES: 4/4	LITES: 6/6	LITES: 9/9	LITES: NONE	ACCESSORIES: SCREEN	ACCESSORIES: SHUTTER	ACCESSORIES: STORM	ACCESSORIES: ALARM	REMARKS
A 2-3/0x5/0	●				●			●						●				●	
B 3/0x3/0	●				●				●					●				●	

FINISH SCHEDULE

ROOM	FLOOR: CARPET	FLOOR: VINYL TILE	FLOOR: CONCRETE	FLOOR: CERAMIC TILE	BASE: VINYL	BASE: WOOD	BASE: CERAMIC	WALLS: BRD. BATTEN PLYWOOD	WALLS: GYP BOARD	WALLS: CMU	CEILING: BEVELED PLYWOOD	CEILING: GYP BOARD	CEILING: ACOUSTIC TILE (SAG)	CLG HT	REMARKS
BEDROOM	●					●			●			●		8'-0"	
BATHROOM		●				●			●			●		8'-0"	
CLOSET	●					●			●			●		8'-0"	
PANTRY		●				●			●			●		8'-0"	
LIVING	●					●			●			●		8'-0"	
KITCHEN		●				●			●			●		8'-0"	

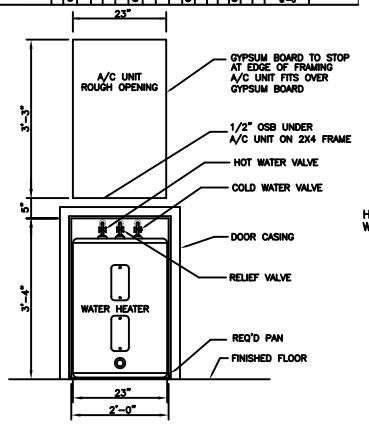

HOT WATER HEATER/ A/C UNIT ELEVATION

SCALE: 1" = 1'-0"



DESIGN NO. L512
UNRESTRAINED ASSEMBLY RATING-1 HR.
FINISH RATING-21 MIN.

SYSTEM NO.-1
FINISH FLOORING-1 BY 3 IN. T & G AND END-MATCHED LAID PERPENDICULAR TO JOISTS, OR 19/32" PLYWOOD, MIN. GRADE "UNDERLAYMENT" OR "STURD-I-FLOOR" WITH T & G LONG EDGES AND CONFORMING WITH PS 1-83 SPECIFICATIONS. FACE GRAIN OF PLYWOOD TO BE PERPENDICULAR TO JOISTS WITH JOINTS STAGGERED.

VAPOR BARRIER-COMMERCIAL ROSIN-SIZED, 0.010" THICK.

SUBFLOORING-1 BY 6" T & G FASTENED DIAGONALLY TO JOISTS, OR 15/32" PLYWOOD, MINIMUM GRADE "C-D" EXPOSURE 1 OR "C-C" WITH EXTERIOR GLUE, AND CONFORMING WITH PS 1-83 SPECIFICATIONS. FACE GRAIN OF PLYWOOD TO BE PERPENDICULAR TO JOISTS WITH JOINTS STAGGERED.

4. CROSS BRIDGING-1 BY 3"
5. WOOD JOISTS-2 BY 10", SPACED 16" O.C. FIRESTOPPED.
6. WALLBOARD, GYPSUM-1/2 OR 5/8" THICK, 4' WIDE, INSTALLED WITH LONG DIMENSION PERPENDICULAR TO JOISTS AND SECURED WITH 24 AND 54 CEMENT-COATED COOLER NAILS SPACED 8" O.C. FOR THE 1/2" AND 5/8" THICK MATERIAL RESPECTIVELY. NAILS SPACED 3/4 AND 1/2" FROM SIDE AND END JOINTS, RESPECTIVELY.

CANADIAN GYPSUM CO., LTD.-TYPE C.
CELOTEX CORP.-TYPE FRP.
DOMINO GYPSUM-TYPE D.
GEORGIA-PACIFIC CORP., GYPSUM DIV.-TYPE GPFS-C
PABCO GYPSUM CO.-TYPE C OR PA-C.
UNITED STATES GYPSUM CO.-TYPE B, C OR IP-X2.

7. JOINT SYSTEM-FOR WALLBOARD OR LATH. PAPER TAPE EMBEDDED IN CEMENTITIOUS COMPOUND OVER JOINTS AND EXPOSED NAIL HEADS COVERED WITH COMPOUND, WITH EDGES OF COMPOUND FEATHERED OUT.
8. ALTERNATE JOINT SYSTEM-(NOT SHOWN)-FOR LATH ONLY. A 3/16" THICKNESS OF GYPSUM PLASTER APPLIED TO ENTIRE EXPOSED SURFACE OVER EMBED PAPER TAPE ON JOINTS EMBEDDED IN CEMENTITIOUS COMPOUND OR 2-1/2" WIDE GLASS FIBER TAPE STAPLED 8" O.C. ON JOINTS.

DETAIL P
N.T.S. A2 A3

DETAIL N
N.T.S. A1 A2

DETAIL O
N.T.S. A1 A2

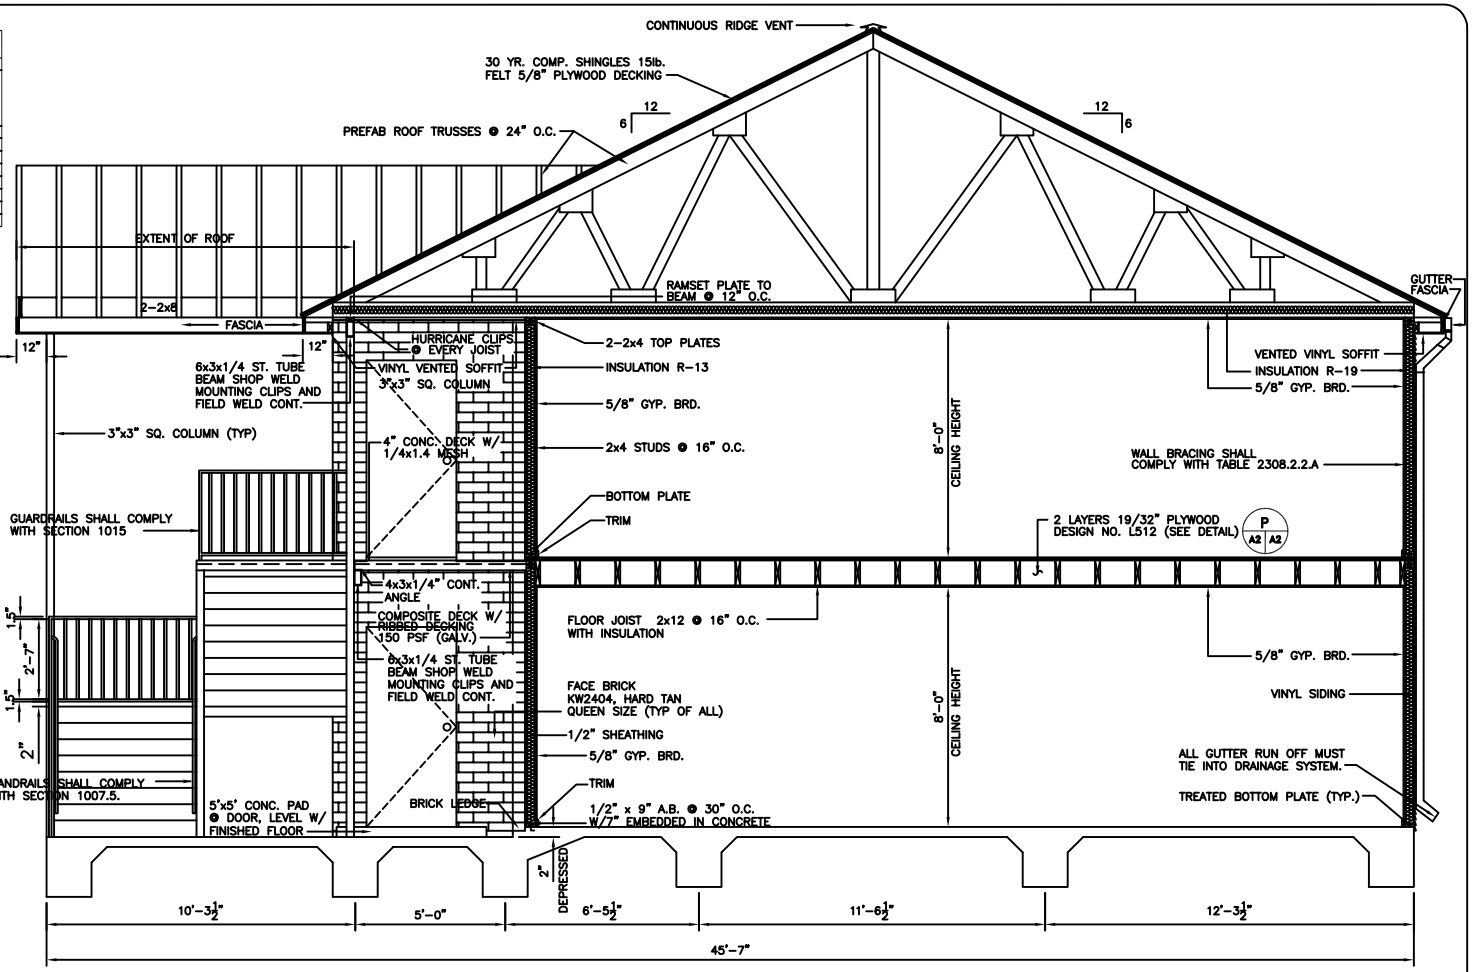

SECTION M
SCALE: 1/2"=1'-0" A1 A2

GENERAL NOTES

1. INSULATION AND INSULATION ASSEMBLES SHALL MEET THE REQUIREMENTS OF SECTION 708 STANDARD BUILDING CODE, 1994 EDITION.
   A. CONCEALED INSULATION SHALL HAVE A FLAME SPREAD OF 0-75 AND A SMOKE DEVELOPED OF 0-450 EXCEPT THAT IN COMBUSTIBLE (WOOD FRAME) CONSTRUCTION.
   B. FACING SHALL COMPLY WITH SBC 708.2
2. PROVIDE 5'X5' LANDINGS OUTSIDE EXTERIOR DOOR LEVEL WITH THE FLOOR. THRESHOLDS SHALL BE NOT MORE THAN 1/2" IN HEIGHT AND SHALL BE BEVELED IF MORE THAN 1/4". ALL GROUND AND FLOOR SURFACES SHALL BE NON SLIP.
3. DIMENSIONS ARE TO CENTER LINE OR FACE OF STUDS, CENTER LINES OF COLUMNS OR FACE OF VINYL.
4. CONTRACTOR TO VERIFY ALL SITE CONDITIONS AND BUILDING LOCATION PRIOR TO CONSTRUCTION & VERIFY ALL DIMENSIONS.
5. MATERIALS SHALL BE NEW AND U.L. LISTED.
6. NO WORK SHALL BE CONCEALED UNTIL APPROVED BY LOCAL INSPECTORS.
7. CONSTRUCTION SHALL COMPLY WITH ALL PARISH, STATE AND LOCAL CODES.
8. CONTRACTOR TO GUARANTEE WORK FOR ONE YEAR.
9. CONTRACTOR SHALL FURNISH WATER AND POWER FROM EXISTING SOURCES.
10. EXTERIOR CAULKING SHALL BE THIOKAL CAULK.
11. PAINT GRADE TO BE SHERWIN WILLIAMS OR EQUIVALENT. ALL WORK TO RECEIVE 3 COATS. COLOR SELECTION BY OWNER.
12. PROVIDE CLEANUP ON A REGULAR BASIS. NO TRASH STORED IN BUILDING.
13. ALL BATT INSULATION SHALL HAVE A CLASS "A" (0-25) FLAME SPREAD IN COMPLIANCE WITH APPLICABLE CODE.
14. USE 6" STUDS AT ALL PLUMBING WALLS.
15. PROVIDE GAL. METAL PAN WITH DRAIN AT WATER HEATER LOCATION.
16. ALL CORNERS SHALL BE PROPERLY BRACED FOR WIND LOADS. A 48" SHEATHING SHALL BE PROVIDED EVERY 20 FEET OF WALL LENGTH.
17. FLOORING SHALL BE NON-SLIP.
18. LOCKS ON DOORS IN MEANS OF EGRESS SHALL NOT REQUIRE THE USE OF A KEY (INTERIOR SIDE). SPECIAL DEVICE OR SPECIAL KNOWLEDGE TO OPEN IN THE DIRECTION OF EGRESS. ALL DOORS SHALL HAVE LEVER TYPE HANDLES.
19. INTERIOR WALLS AND CEILINGS SHALL HAVE A FLAME SPREAD OF 0-200 AND A SMOKE DEVELOPMENT RATING OF 0-450.
20. ALL WORK SHALL COMPLY WITH THE LATEST EDITION OF ALL LOCAL STATE AND NATIONAL CODES THAT COVER THE SECTION OF WORK BEING PERFORMED.
21. PROVIDE PORTABLE FIRE EXTINGUISHERS IN ACCORDANCE WITH NFPA 10. SEE APPENDIX "E" OF NFPA 10 FOR DISTRIBUTION OF EXTINGUISHERS.
22. ALL FIRE WALLS SHALL EXTEND TIGHT TO ROOF SHEATHING & SEALED WITH APPROVED FIRE CAULK.
23. ALL ELECTRICAL, MECHANICAL & PLUMBING PENETRATING FIRE WALLS SHALL BE FIRE CAULKED. (PENETRATIONS THROUGH RATED CONSTRUCTION SHALL BE SEALED WITH A MATERIAL CAPABLE OF PREVENTING THE PASSAGE OF FLAMES AND HOT GASES WHEN TESTED IN ACCORDANCE WITH ASTM-E814.)

SECTION/DETAILS

BRIAN RIENE
JOSEPH STREET
SLIDELL, LOUISIANA

SUN VALLEY APARTMENTS PHASE 2

DAMMON ENGINEERING, INC.
1065 FLORIDA AVENUE 985-649-5532 SLIDELL, LA. 70458
DAMMONENGINEERING.COM

SCALE:AS NOTED
FILE:
JOB NO.1697
DATE:01-06-06
SHEET 11
A-2
OF 27