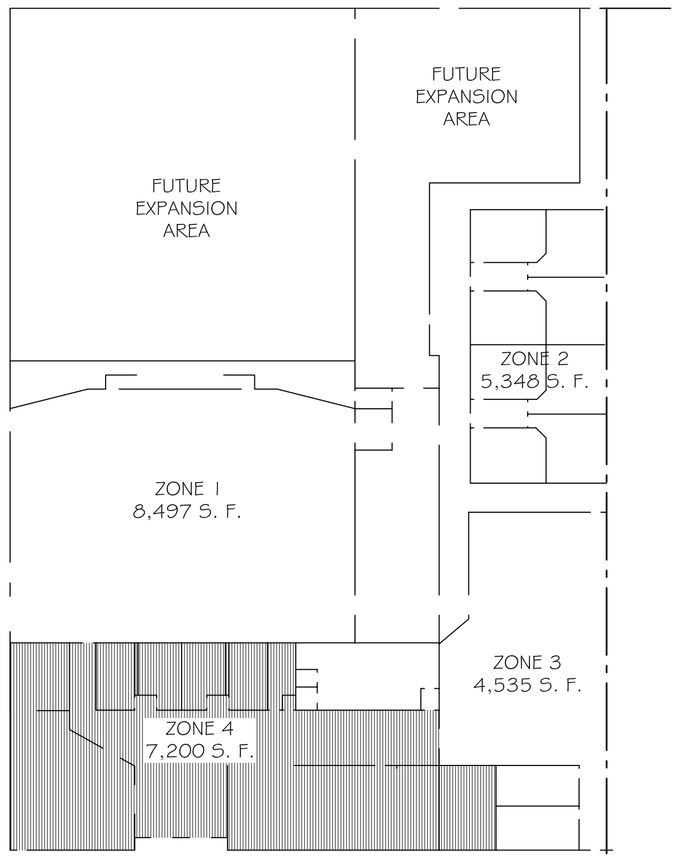

ELECTRICAL KEY PLAN

N. T. S.

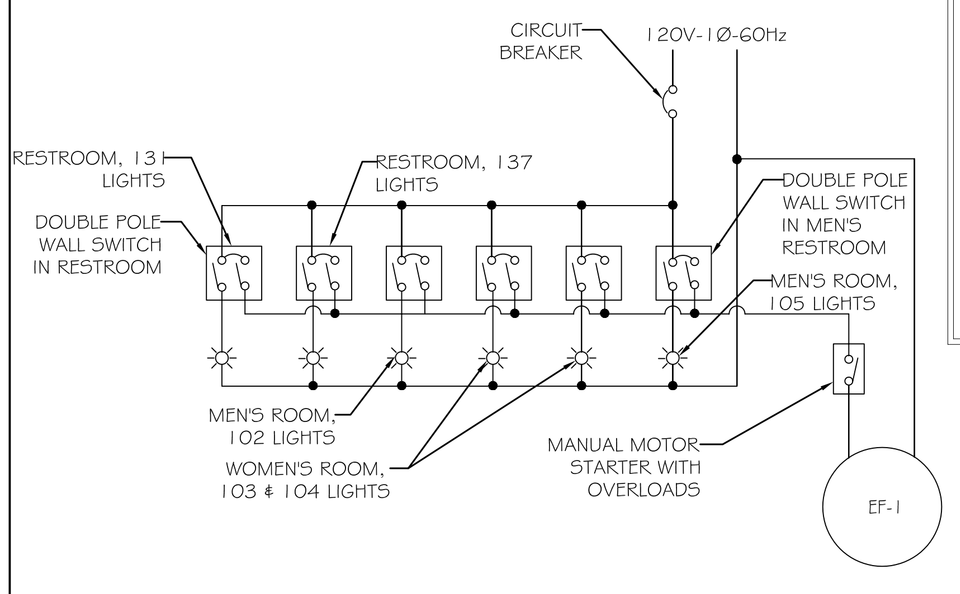

REST ROOM EXHAUST FAN/ LIGHTING DIAGRAM

N. T. S.

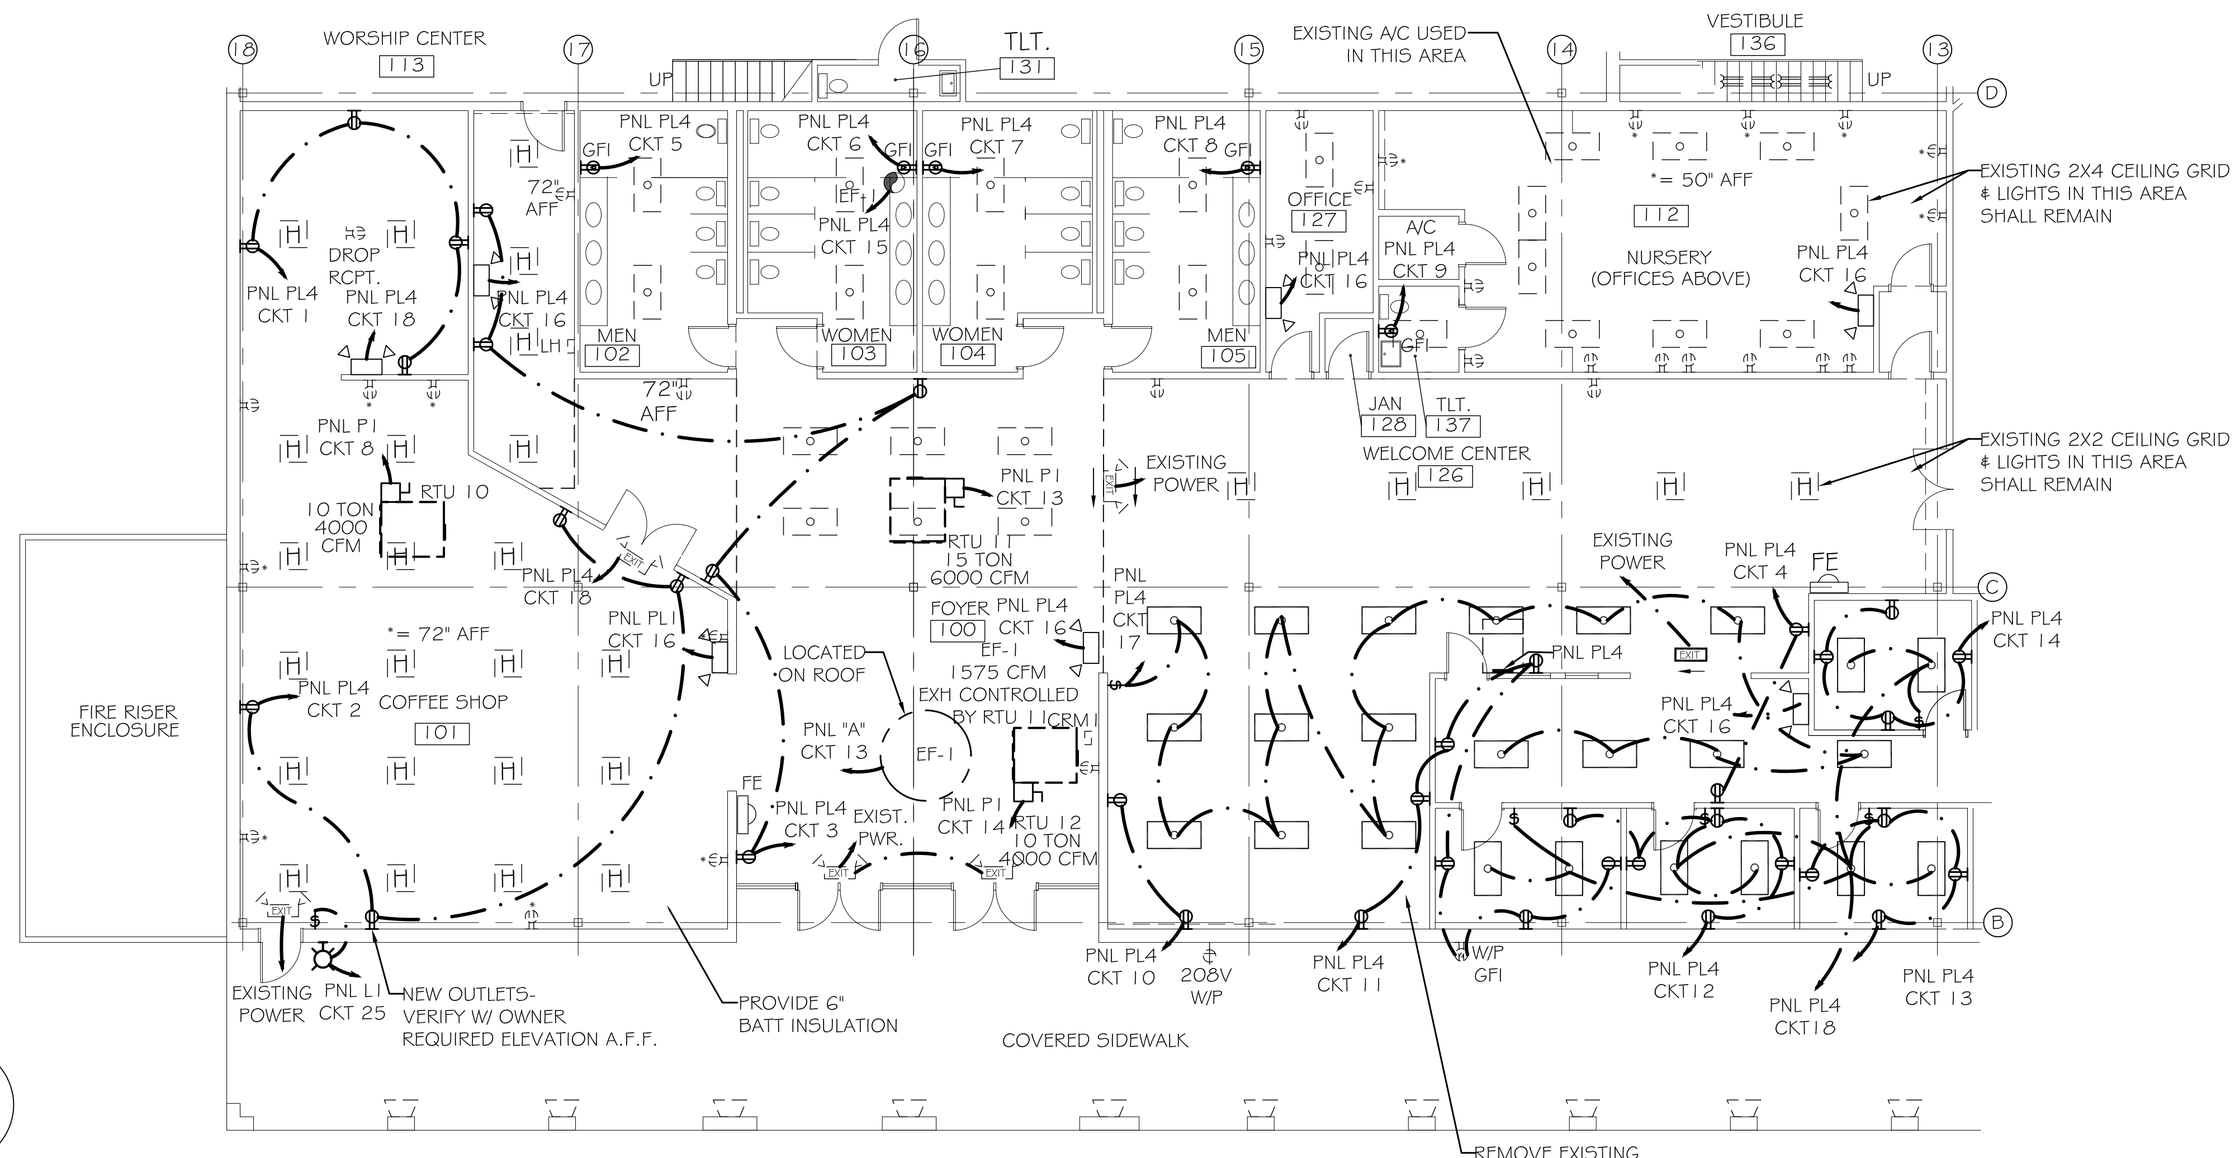

NOTE:
ALL HVAC EQUIPMENT SHOWN IS NEW. EXISTING HVAC EQUIPMENT SHALL BE REMOVED PRIOR TO CONSTRUCTION, UNLESS OTHERWISE NOTED.

PROVIDE EQUIPMENT REQUIRED TO OPERATE 120V HEAT VENT EF-1 FROM LIGHT SWITCH. LOCATE SWITCH PER OWNER.

ZONE 4 POWER & LIGHTING PLAN

SCALE: 1/8"= 1'-0"

LEGEND

- -EXISTING DUPLEX OUTLET
- GFI -EXISTING DUPLEX GFI OUTLET
- W/P GFI -EXISTING DUPLEX WEATHERPROOF GFI OUTLET
- -EXISTING QUAD OUTLET
- 208V -EXISTING 208V OUTLET
- 208V W/P -EXISTING WEATHERPROOF 208V OUTLET
- -EXISTING DISCONNECT
- HENL -EXISTING POWER, LIGHTING PANEL
- -EXISTING SWITCH
- -EXISTING 3 WAY SWITCH
- -EXISTING 2 X 4 FLUORESCENT FIXTURE
- -EXISTING 2 BULB FLUORESCENT FIXTURE
- -EXISTING 2 X 4 FLUORESCENT FIXTURE
- -EXISTING EXIT/ EMERGENCY LIGHT
- -EXISTING HALIDE LIGHT
- -EXISTING HPS FIXTURE
- -EXISTING TELEPHONE/ DATA OUTLET
- -DUPLEX OUTLET
- GFI -DUPLEX GFI OUTLET
- W/P GFI -DUPLEX WEATHERPROOF GFI OUTLET
- -QUAD OUTLET
- 208V -208V OUTLET
- -FUSED DISCONNECT
- PNL PL -POWER, LIGHTING PANEL
- -SWITCH
- -DIMMER SWITCH
- -3 WAY SWITCH
- -2 X 4 FLUORESCENT FIXTURE ("N" INDICATES NIGHT LIGHT- ALWAYS ON)
- -CEILING MOUNTED FIXTURE
- -EXTERIOR WALL SCONCE FIXTURE W/ 90 MIN. BATTERY BACKUP
- -PENDANT LIGHT
- -TRACK LIGHTING
- -REVERSIBLE CEILING FAN (REVERSIBLE @ WALL SWITCH)
- -EXTERIOR WALL SCONCE FIXTURE W. 90 MIN. BACKUP
- EXIT -EXIT LIGHT W/ 90 MIN. BACKUP (ARROW INDICATES DIRECTIONAL EXIT SIGN)
- EXIT -EXIT/ EMERGENCY LIGHT W/ 90 MIN. BACKUP (ARROW INDICATES DIRECTIONAL EXIT SIGN)
- -EMERGENCY LIGHT W/ 90 MIN. BACKUP
- -CABLE TV OUTLET
- -TELEPHONE OUTLET
- -SMOKE DETECTOR
- -VENT
- FE -FIRE EXTINGUISHER AND CABINET- 10 LB. MULTI-USE

DAMMON ENGINEERING, INC.

CHIEF ENGINEER
EMMETT
DAMMON, P.E.

CHIEF ARCHITECT
ROBERT
WILTSE

1095 FLORIDA AVENUE
SLIDELL, LA. 70458
OFFICE: 985-649-5832
FAX: 985-641-5950

WEBSITE:
WWW.DAMMONENGINEERING.COM

EMAIL:
DAMMONENG@BELLSOUTH.NET

ARCHITECTURE

ENGINEERING

STUDIES

PLANNING

INVESTIGATION

EXPERT WITNESS

NORTHSHORE CHURCH
KENSINGTON DR.
SLIDELL, LA

ZONE 4 POWER & LIGHTING PLAN

REV:03-23-09

SCALE: AS NOTED

JOB#: 1988

DATE: 09-30-08

SHEET

E-6

OF