

DAMMON
ENGINEERING, INC.

CHIEF ENGINEER
ENAMETT
DAMMON, P.E.
CHIEF ARCHITECT
ROBERT
WILTSE

554 OLD SPANISH TRAIL
SUDELL, LA. 70458
OFFICE: 985-649-5832
FAX: 985-641-5950

WEBSITE:
WWW.DAMMONENGINEERING.COM
EMAIL:
DAMMONENG@BELLSouth.NET

ARCHITECTURE
ENGINEERING
STUDIES
PLANNING
INVESTIGATION
EXPERT WITNESS

LIVING THE WORD
INTERNATIONAL

2528

OLD SPANISH TRAIL
SUDELL, LA
70461

FLOOR
PLAN

REV:

SCALE: AS NOTED

JOB#: 2128

DATE: 01-27-12

SHEET 3

A-1

OF 15

DOOR & HARDWARE SCHEDULE						
MARK	SIZE	DOOR TYPE	FRAME	HDMR. NO.	STC	REMARKS
EXTERIOR DOORS						
1	PR. 30x70	STORE FRONT	TO MATCH DOOR	1	NA	
2	PR. 30x70	FLUSH GALV. HOL. MET.		1	NA	GALVANIZING TO BE G90 STEEL INSUL.
INTERIOR DOORS						
3	PR. 30x70	FLUSH SOLID CORE WD.	PTD. HOL. MET.	3	NA	PROVIDE 4x36 VISION LITE W/ PANIC HARDWARE
4	30x70	FLUSH GALV. HOL. MET. STEEL INSUL.	PTD. HOL. MET.	3	NA	
5	30x70	STORE FRONT	TO MATCH DOOR	4	NA	W/ SIDELITES, MULLION BAR, TRANSOM LITE ABOVE
6	30x70	FLUSH SOLID CORE WD.	PTD. HOL. MET.	4	NA	PROVIDE 4x36 VISION LITE
7	30x70	FLUSH SOLID CORE WD.	PTD. HOL. MET.	4	NA	
8	30x70	FLUSH SOLID CORE WD.	PTD. HOL. MET.	5	NA	
9	30x70	FLUSH SOLID CORE WD.	PTD. HOL. MET.	3	NA	
10	30x70	FLUSH SOLID CORE WD.	PTD. HOL. MET.	2	NA	1 HR. FIRE RATED
11	20x70	FLUSH SOLID CORE WD.	PTD. HOL. MET.	3	NA	


DOOR HARDWARE SCHEDULE
1. AUTO CLOSER, PANIC BAR, AIR RESISTANT METAL THRESHOLD, WEATHERSTRIP, DOOR STOP, EXTERIOR COULDER LOCK.
2. AUTO CLOSER, DOOR STOP, COULDER LOCK, COUPLER LOCK, COUPLER LOCK, BALL BEARING ISSUED PIECES.
3. PASSAGE LOCK, DOOR STOP, ISSUED PIECES.
4. KERO PADLOCK (CONFORMANCE), DOOR STOP, ISSUED PIECES.
5. AUTO CLOSER, DOOR STOP, PANIC LOCK, BALL BEARING ISSUED PIECES.

WINDOW SCHEDULE					
MARK	SIZE	WINDOW TYPE	FRAME	GLASS	REMARKS
A	OVERALL UNIT SIZE = 40' W x 148' H	ALUMINUM STOREFRONT	ALUMINUM 2" x 4"	LOW E	SEE EXT. ELEVATIONS FOR SIZES
B	OVERALL UNIT SIZE = 40' W x 168' H	ALUMINUM STOREFRONT	ALUMINUM 2" x 4"	LOW E	SEE EXT. ELEVATIONS FOR ARCH TOP
C	OVERALL UNIT SIZE = 60' W x 010' H	ALUMINUM STOREFRONT	ALUMINUM 2" x 4"	LOW E	SEE EXT. ELEVATIONS FOR ARCH TOP

WINDOW SCHEDULE NOTES:
1. GLAZING TO BE DEL. GLAZED LAMINATED LOW E.
2. EXTERIOR WINDOW SYSTEM SHALL BE CAPABLE OF RESISTING 130 MPH WIND LOAD.

GENERAL NOTES

- INSULATION AND INSULATION ASSEMBLIES SHALL MEET THE REQUIREMENTS OF SECTION 719 THAT IN COMBUSTIBLE (WOOD FRAMED) CONSTRUCTION.
- FACING SHALL COMPLY WITH IBC 2009.
- PROVIDE 5'-6" LANDINGS, LEVEL WITH FINISHED FLOOR, OUTSIDE EXTERIOR DOORS ON WEST SIDE OF BUILDING.
- THRESHOLDS SHALL BE NOT MORE THAN 1/2" IN HEIGHT AND SHALL BE BEVELLED IF MORE THAN 1/4".
- MATERIALS SHALL BE NEW AND U.L. LISTED.
- NO WORK SHALL BE CONCEALED UNTIL APPROVED BY LOCAL INSPECTORS.
- CONSTRUCTION SHALL COMPLY WITH ALL PARISH, STATE, AND LOCAL CODES.
- CONTRACTOR TO GUARANTEE WORK FOR ONE YEAR.
- CONTRACTOR SHALL FURNISH WATER AND POWER FROM EXISTING SOURCES.
- EXTERIOR CAULKING SHALL BE THICK CAULK.
- PAINT GRADE TO SHALL BE SHERWIN WILLIAMS OR EQUIVALENT. ALL WORK TO RECEIVE 3 COATS. COLOR SELECTION BY OWNER.
- PROVIDE CLEANUP ON A REGULAR BASIS. NO TRASH STORED IN BUILDING.
- ALL BATT INSULATION SHALL HAVE A CLASS "A" (0-25) FLAME SPREAD IN COMPLIANCE WITH APPLICABLE CODE.
- USE 6" STUDS, OR 4" SPACED STUDS AT ALL PLUMBING WALLS.
- PROVIDE GALVANIZED METAL PAN WITH DRAIN AT WATER HEATER LOCATION.
- ALL CORNERS SHALL BE PROPERLY BRACED FOR WIND LOADS. A 48" STRAPPING SHALL BE PROVIDED EVERY 20 FEET OF WALL LENGTH.
- WALL LOCKS ON DOORS IN MEANS OF EGRESS SHALL NOT REQUIRE THE USE OF A KEY. SPECIAL KNOWLEDGE OR SKILLS TO OPEN IN THE OPERATION OF EGRESS. ALL DOORS SHALL HAVE THE FOLLOWING MINIMUM RATING OF 0.450. 17. ALL WORK SHALL COMPLY WITH THE LATEST EDITION OF ALL LOCAL, STATE, AND NATIONAL CODES COVERING THE TYPE OF WORK BEING PERFORMED.
- PROVIDE PORTABLE FIRE EXTINGUISHERS IN ACCORDANCE WITH NFPA 101. SEE APPENDIX "E" OF NFPA 101 FOR DISTRIBUTION OF EXTINGUISHERS.
- ALL FIRE WALLS SHALL EXTEND TIGHT TO ROOF DECK AND BE SEALED WITH AN APPROVED FIRE CAULK.
- ALL ELECTRICAL, MECHANICAL, AND PLUMBING MATERIALS PENETRATING FIRE WALLS SHALL BE FIRE-CAULKED. PENETRATIONS THROUGH RATED CONSTRUCTION SHALL BE SEALED WITH A MATERIAL CAPABLE OF PREVENTING THE PASSAGE OF FLAMES AND HOT GASES WHEN TESTED IN ACCORDANCE WITH ASTM E814.
- SERVICE COUNTER SHALL HAVE A HCP ACCESSIBLE WRITING SURFACE, MAX. 36" FROM F.F. (ADAAG MANUAL, 1998, PG 135)

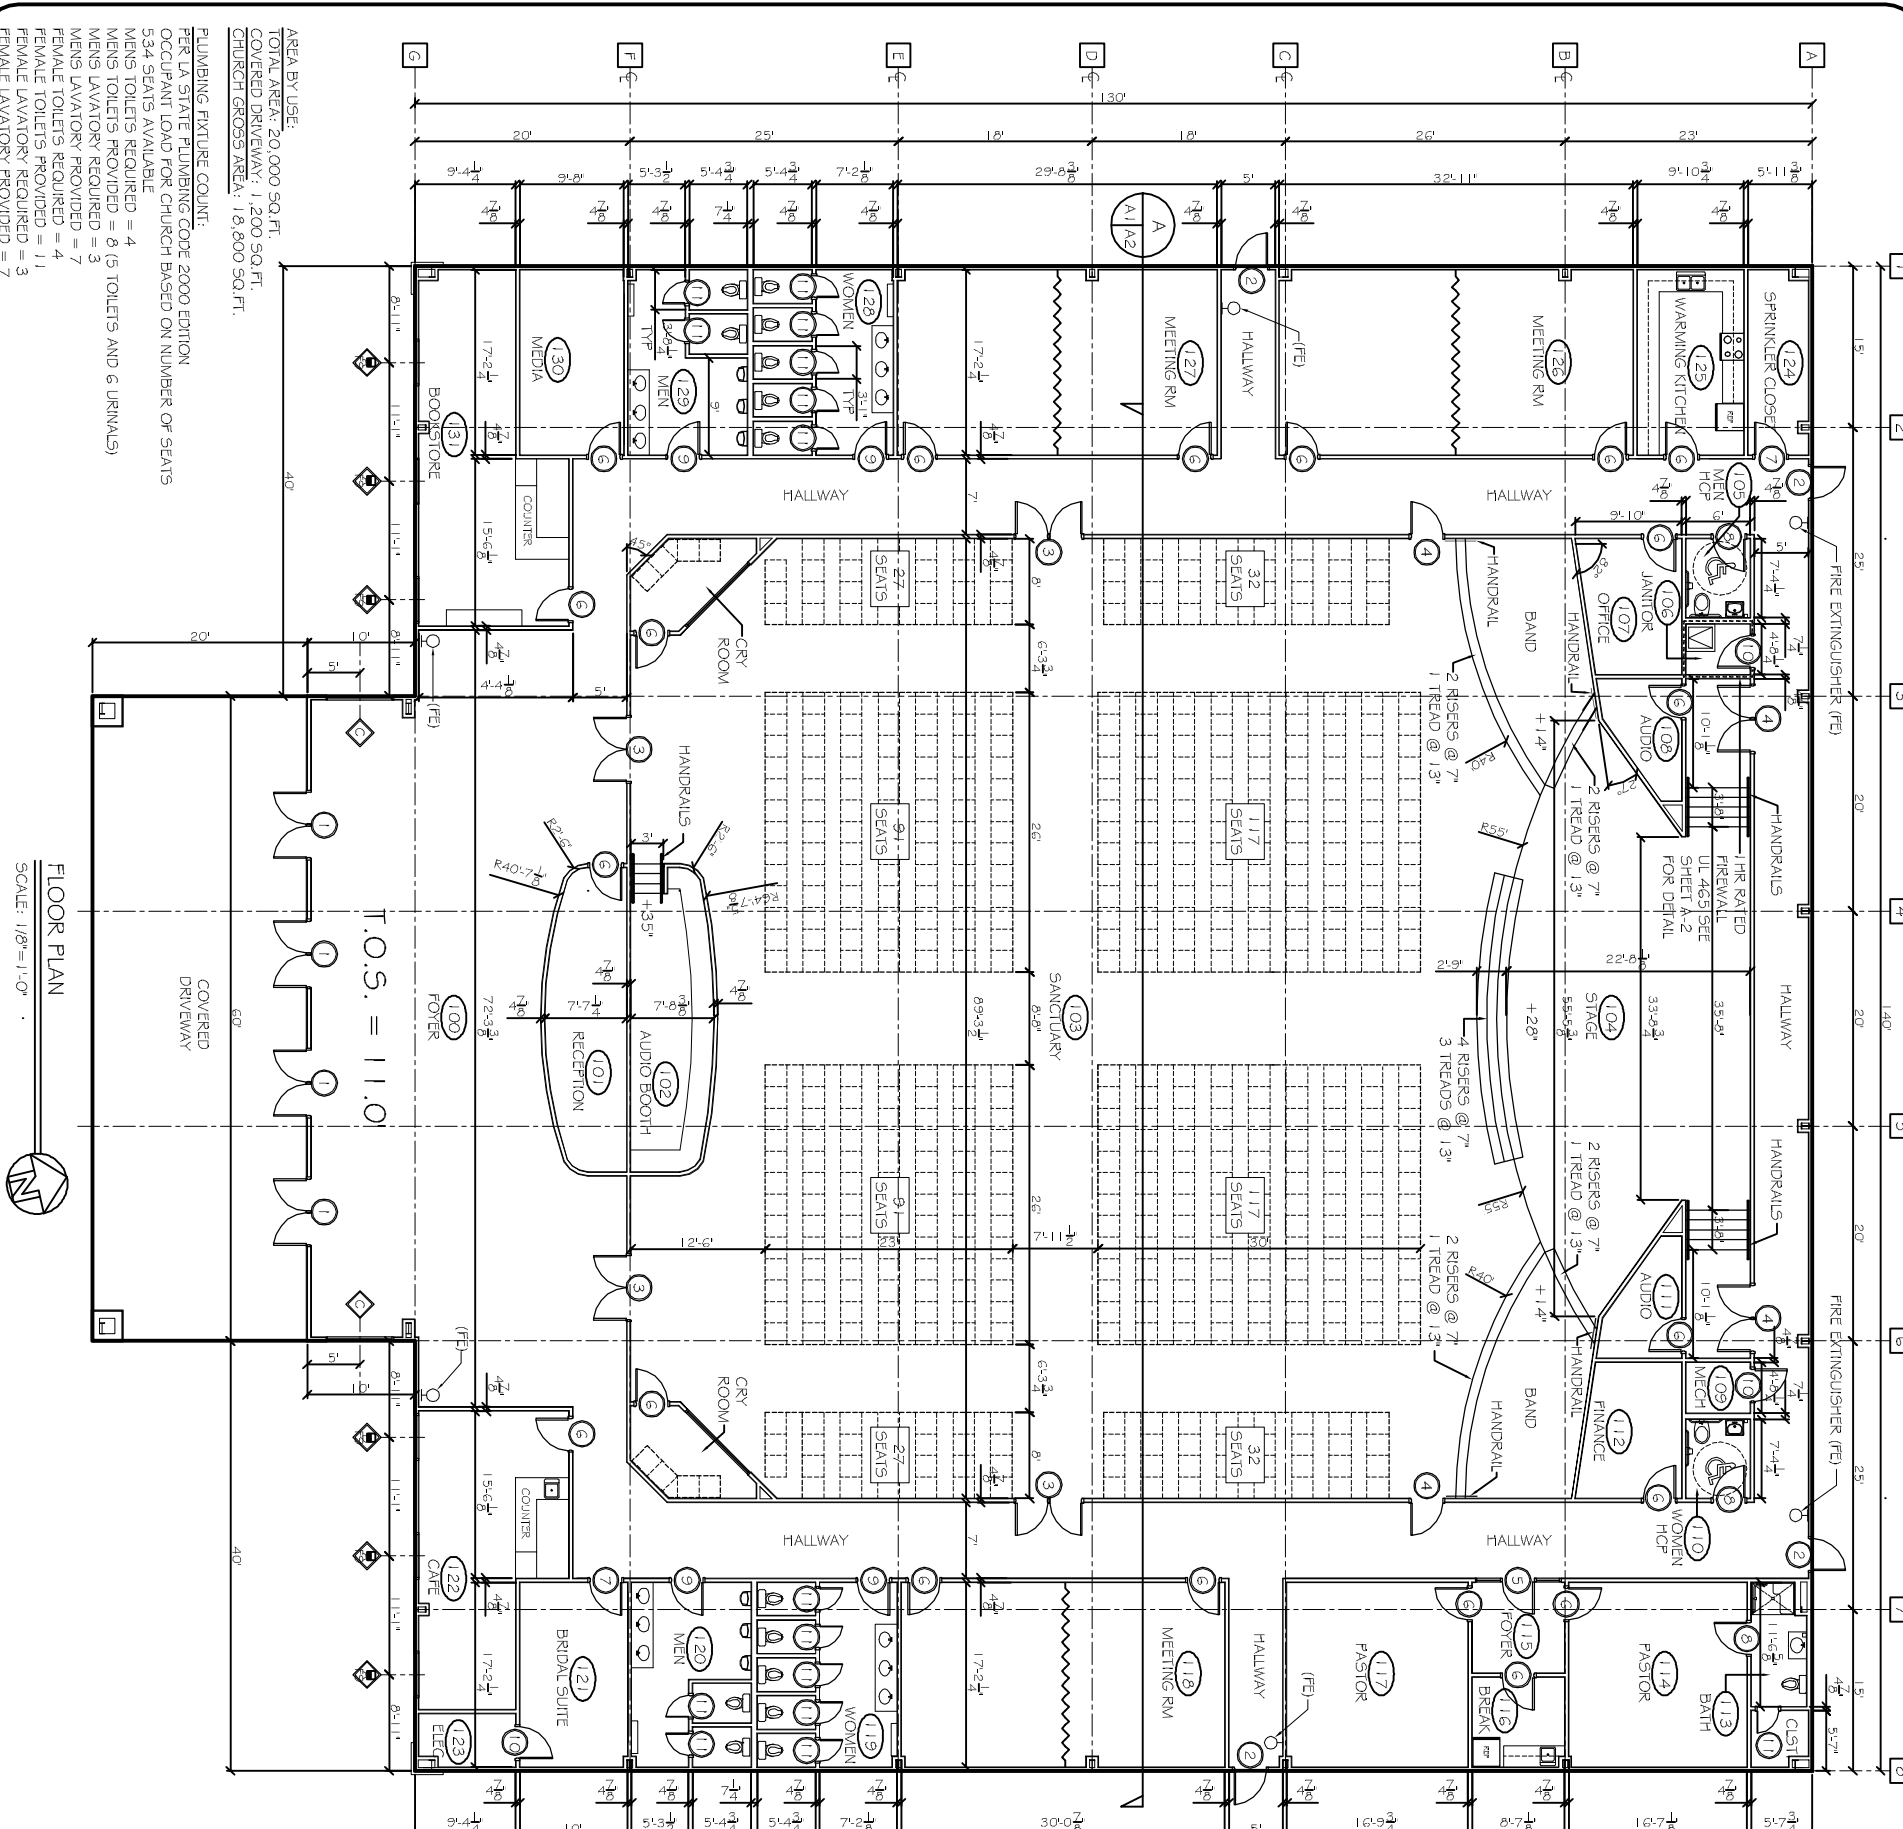

AREA BY USE:
TOTAL AREA: 20,000 SQ. FT.
COVERED DRIVEWAY: 1,200 SQ. FT.
CHURCH GROSS AREA: 18,800 SQ. FT.

PLUMBING-FIXTURE COUNT:
PER LA STATE PLUMBING CODE 2000 EDITION
OCCUPANT LOAD FOR CHURCH BASED ON NUMBER OF SEATS
534 SEATS AVAILABLE
MENS TOILETS REQUIRED = 4 (5 TOILETS AND 6 URINALS)
MENS LAVATORY REQUIRED = 3
MENS LAVATORY PROVIDED = 7
FEMALE TOILETS REQUIRED = 4
FEMALE TOILETS PROVIDED = 11
FEMALE LAVATORY REQUIRED = 3
FEMALE LAVATORY PROVIDED = 7

FLOOR PLAN
SCALE: 1/8"=1'-0"