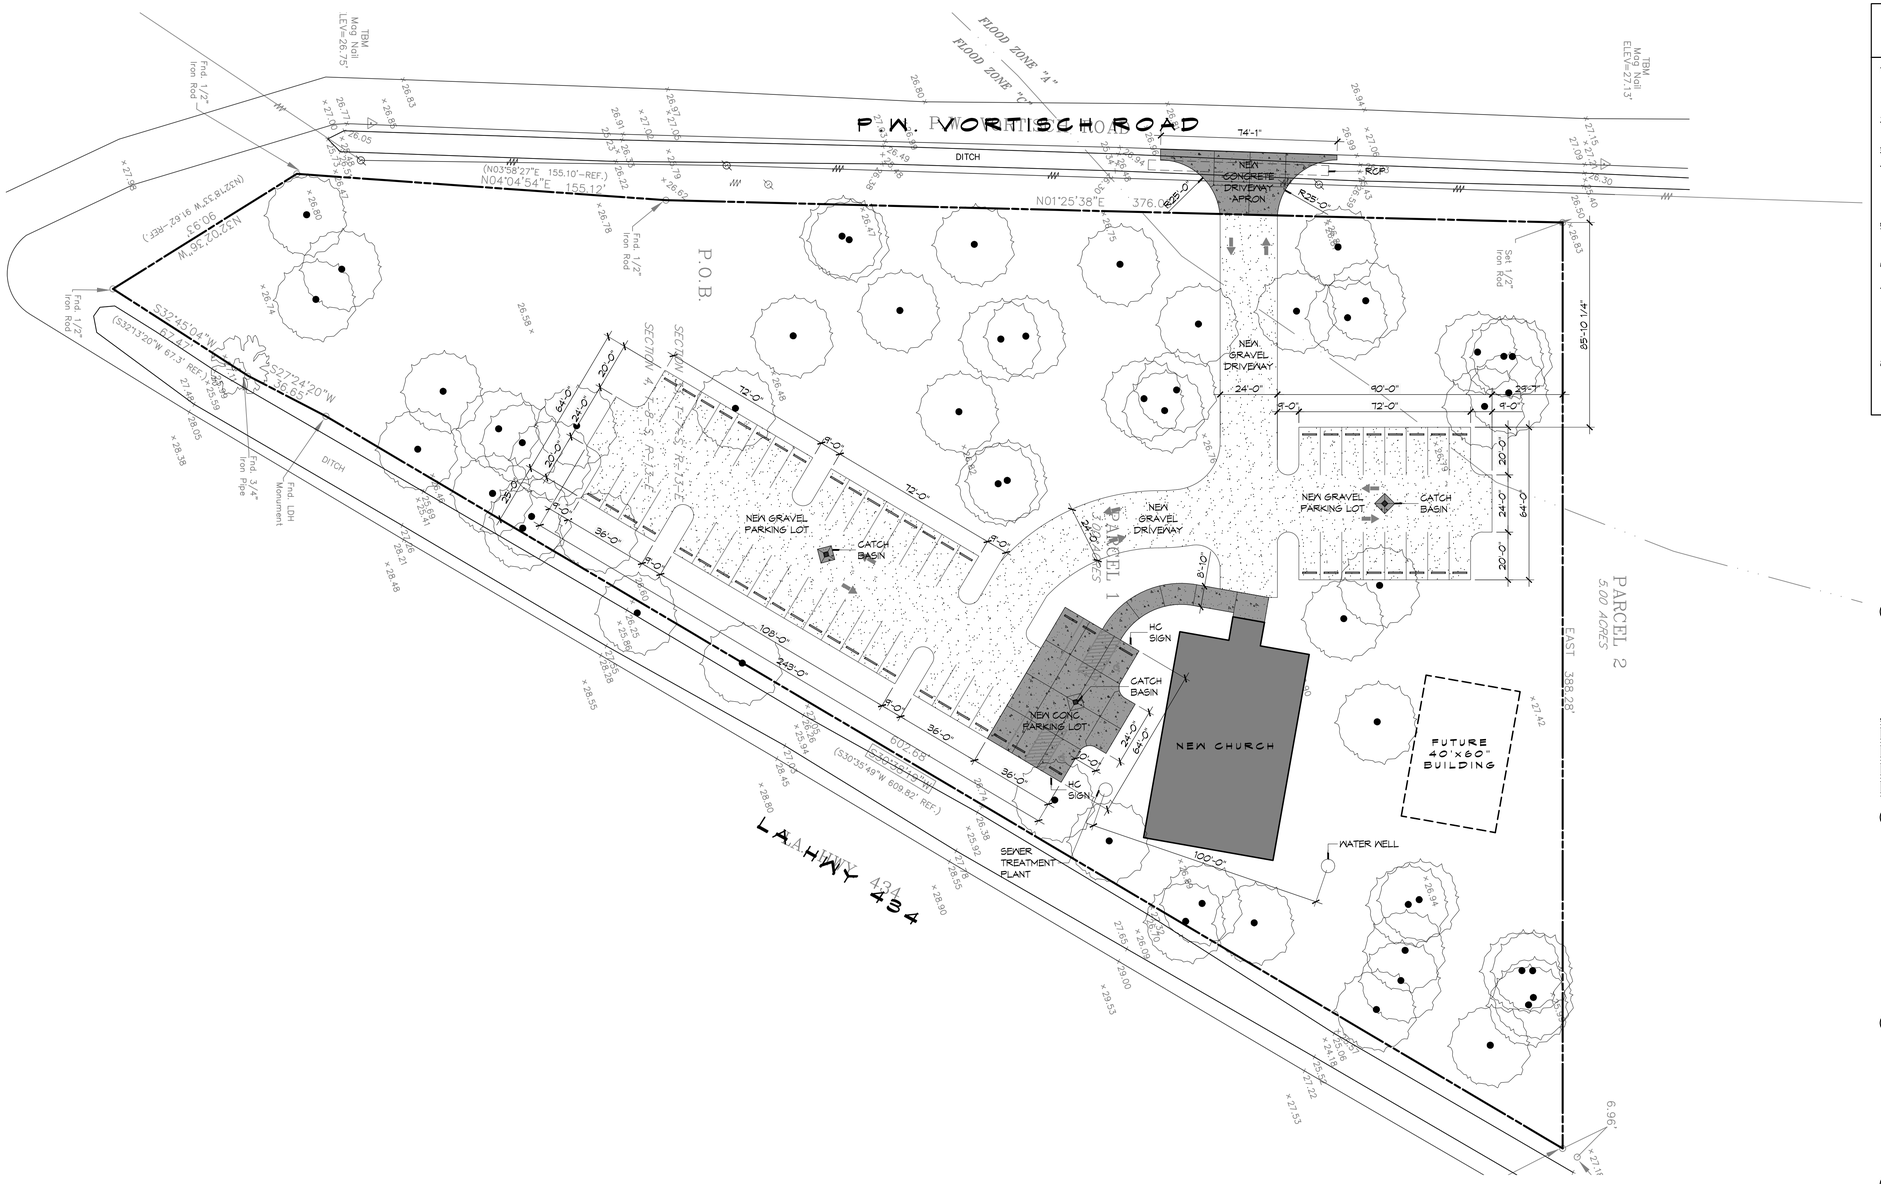

GENERAL SITE NOTES

1. ALL NEW SITE GRADING SHALL PROMOTE POSITIVE DRAINAGE AWAY FROM BUILDING AND NEW SIDEWALKS TOWARD NEW AND EXISTING CATCH BASINS AND NOT CAUSE PONDING OF STORM WATER.
2. SEE SHEET C102 FOR FINISH GRADE ELEVATIONS AND DIRECTION OF SLOPE.

PARKING REQUIREMENTS

1 SPACE PER 4 OCCUPANTS
192 SEATS / 4 = 48 PARKING SPACES REQUIRED
2 HANDICAP PARKING SPACES PROVIDED
56 PARKING SPACES PROVIDED

TOTAL PARKING SPACES PROVIDED 58

GENERAL SITE PAVING NOTES

1. ALL NEW CONCRETE SHALL SHALL HAVE A MINIMUM COMPRESSIVE STRENGTH OF 4,000 PSI AT 28 DAYS AND A MINIMUM THICKNESS OF 6". CONCRETE MIX SHALL BE IN ACCORDANCE WITH THE LATEST REVISION OF ASTM C-150 TYPE 1.
2. CONCRETE PAVING THICKNESS SHALL VARY AS FOLLOWS:
   a. DRIVE LANES & PARKING AREAS = 6" THICKNESS
3. ALL REINFORCING STEEL SHALL MEET ASTM-A615 (GRADE 60).
4. ALL REINFORCING STEEL SHALL BE SECURELY SUPPORTED TO PREVENT BOTH VERTICAL AND HORIZONTAL MOVEMENT DURING CONCRETE PLACEMENT. ALL CONTROL AND EXPANSION JOINTS SHALL BE LOCATED AND INSTALLED AS SHOWN ON THE PAVING PLAN AND IN ACCORDANCE WITH THE MANUFACTURER'S RECOMMENDATIONS.
5. ALL SUB GRADE FILL SHALL BE SELECT GRANULAR MATERIAL COMPACTED TO 95% STANDARD PROCTOR DENSITY IN A MAXIMUM OF 6" LIFTS.
6. CONTRACTOR SHALL CONTACT THEIR REGULATORY DEPARTMENT OF ENGINEERING PRIOR TO CONDUCTING ANY WORK.
7. ANY WORK WITHIN THE ROADWAY OR ADJACENT TO THE ROADWAY CAUSING AN INTERFERENCE TO VEHICULAR TRAFFIC MUST CONFORM TO THE REQUIREMENTS SET FORTH BY THE UNIFORM MANUAL OF TRAFFIC CONTROL DEVICES OF THE STATE OF LOUISIANA. THE CONTRACTOR MUST FURNISH ALL NECESSARY TRAFFIC SIGNS AND/OR BARRICADES AND MAINTAIN THEM DURING CONSTRUCTION ACTIVITY.
8. SEE SHEET C102 FOR TOP OF CONCRETE, CATCH BASIN GRATE, AND INVERT ELEVATIONS.

6" MTL KEYWAY JOINT SYSTEM NOTE:
LONGITUDINAL JOINTS (LJ): NO.5 DEFORMED DOWEL ROD 24" L @ 24" O.C.
TRANSVERSE JOINTS (TJ): NO.5 SMOOTH DOWEL ROD 24" L @ 24" O.C.



D TYPICAL PAVEMENT JOINT

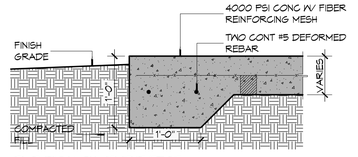

C TYPICAL PAVEMENT EDGE

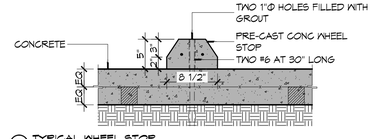

B TYPICAL WHEEL STOP

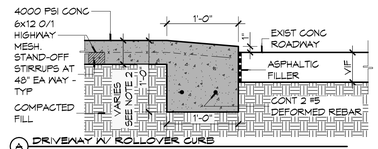

A DRIVEWAY W/ ROLLOVER CURB

1 DETAILS
SCALE: 1" = 1'-0"
TYPICAL PAVEMENT

2 SITE PLAN
SCALE: 1" = 30'

DAMMON ENGINEERING, INC.
Architects & Engineers
www.dammonengineering.com
info@dammonengineering.com
Ph: 985.649.5832
F: 985.641.5950
Chief Engineer: Kevin J. Kinchen, NCARB
Chief Architect: Brian Mistich, PE
550 Chestnut Trail
Slidell, LA 70458

#	DESCRIPTION	REVISIONS	DATE

SEAL:

PRO MULTIS
LACOMBE CHAPEL

PIN VORTISCH ROAD AND LA HWY 434
LACOMBE, LOUISIANA 70445

JOB No: 2250 | DATE: SEPTEMBER 3, 2015
DRAWN BY: JTL | CHECKED BY: CKD

All ideas, designs, arrangements and plans indicated or represented by this drawing are the property of Dammon Engineering, and shall not be used in other work except by agreement with Dammon Engineering. They are not to be changed or copied in any form or manner whatsoever, nor are they to be assigned to any third party, without first obtaining the expressed written permission of Dammon Engineering. No part of this drawing shall be used for any other project. Visual contact with these plans shall constitute conclusive evidence of acceptance of these restrictions.

SHEET TITLE:
SITE PLAN & PAVING

DRAWING NUMBER:
C101

SHEET No: 3 of 14