

LEVEL 2 LIGHTING PLAN  
SCALE: 3/16"=1'-0"

LEVEL 1 LIGHTING PLAN  
SCALE: 3/16"=1'-0"

**GENERAL NOTES**

1. ALL WORK SHALL COMPLY WITH APPLICABLE NATIONAL, STATE AND LOCAL CODES, RULES, REGULATIONS, AND REQUIREMENTS OF THE SERVICE UTILITY COMPANY.
2. GENERAL CONTRACTOR SHALL NOTIFY THE ARCHITECT IMMEDIATELY IF ANY CONFLICTS OCCUR BETWEEN LIGHTING AND ANY OTHER TRADE. DO NOT PROCEED WITH INSTALLATION IN THAT AREA UNTIL CONFLICT HAS BEEN RESOLVED TO THE SATISFACTION OF THE ARCHITECT AND ENGINEER.
3. REFER TO ARCHITECTURAL DRAWINGS FOR EXACT LOCATION AND MOUNTING INSTRUCTIONS FOR ALL LIGHT FIXTURES. NOTIFY THE ARCHITECT IMMEDIATELY IF ANY CONFLICTS OCCUR BETWEEN THESE PLANS AND THE ARCHITECTURAL PLANS RELATING TO EXACTITY, TYPE AND LOCATION OF DEVICES AND/OR FIXTURES.
4. WHEN SPECIFIC LIGHT FIXTURE HAS BEEN SPECIFIED IN THE FINISH SCHEDULE ELECTRICAL, SHALL PROVIDE COMPLETE ASSEMBLY INCLUDING ALL PARTS AND HARDWARE TO INSURE PROPER FUNCTIONING FIXTURE.
5. ALL CONDUCTORS SHALL BE #12 AWG UNLESS NOTED OTHERWISE.
6. ALL 120V RINGS LONGER THAN 60 FEET SHALL BE #10 AWG AND 277V RINGS LONGER THAN 150 FEET SHALL BE #10 AWG UNLESS NOTED OTHERWISE.
7. ALL CONDUCTORS SHALL BE COPPER.
8. WHERE CONDUCTOR SIZES ARE NOTED ON DRAWINGS, THAT WIRE SIZE SHALL BE THROUGH THE ENTIRE RUN UNLESS OTHERWISE NOTED.
9. MOUNTED LIGHT SWITCHES 48" AFF UNLESS NOTED OTHERWISE ON ARCHITECTURAL DRAWINGS.
10. ALL GANGED SWITCHES SHALL HAVE A COMMON SEAMLESS FACEPLATE EACH MULTI-GANGED BOX SHALL BE NO MORE THAN SIX (6) SWITCHES WIDE. WHERE MORE THAN SIX (6) SWITCHES ARE SHOWN AT ONE (1) LOCATION, ADDITIONAL MULTI-GANGED BOXES SHALL BE STACKED VERTICALLY AND THE WIDTH OF THE MULTI-GANGEDS SHALL BE AS EVEN AS POSSIBLE.
11. DIMMER SWITCH SHALL HAVE A MINIMUM RATING 25% HIGHER THAN THE TOTAL WATTAGE OF ALL FIXTURES TO BE CONTROLLED BY THE DIMMER. DIMMER SIZES 600, 1000, 1500, AND 2000 WATTS. LITRON NOVA T-STAR. WHERE SWITCHES ARE GANGED WITH DIMMERS, THE SWITCHES SHALL ALSO BE LITRON NOVA T-STAR. FLUORESCENT AND LOW VOLTAGE DIMMERS SHALL BE LITRON NOVA T-STAR.
12. WHERE FLUORESCENT FIXTURES ARE SHOWN TO BE DIMMED, THE FIXTURES SHALL HAVE DIMMING TYPE BALLASTS WHICH ARE COMPATIBLE WITH THE SPECIFIED DIMMERS.
13. WHERE LED FIXTURES/LAMPS ARE SHOWN TO BE DIMMED, THE DIMMER SHALL BE COMPATIBLE WITH THE FIXTURE/LAMP SPECIFIED OR PROVIDED.
14. ALL EMERGENCY LIGHT FIXTURES SHALL HAVE 90 MINUTE BATTERY BACKUP WITH TEST BUTTON AND SHALL BURN CONTINUOUSLY.
15. ALL FLUORESCENT FIXTURES THAT UTILIZE DOUBLE-ENDED LAMPS AND SWITCH WITH INTERVAL TEST BUTTON AND SHALL BE DISCONNECTED MENUS IN ACCORDANCE WITH NEC 410.136.


**LEGEND**

- |  |  |  |  |
|--|--|--|--|
|  | EMERGENCY LIGHT FIXTURE                            |  | ELECTRIC PANEL BOARD   |
|  | EXT LIGHT FIXTURE - WALL MOUNTED                   |  | CIRCUIT HOME RUN   |
|  | EXT LIGHT FIXTURE - CEILING MOUNTED                |  | SWITCHED CIRCUIT   |
|  | LED WALL MOUNTED LIGHT FIXTURE WITH 90 MIN. BACKUP |  | UNSWITCHED CIRCUIT   |
|  | RECESSED CEILING LIGHT FIXTURE                     |  | WALL VTD SPEAKER - PROVIDE RATED HOISING FOR RATED WALLS WHERE INDICATED   |
|  | RING MOUNTED FLOOR STRIP FIXTURE (3 BULB)          |  | RING MTD SPEAKER - PROVIDE RATED HOISING FOR RATED CEILING WHERE INDICATED |
|  | SURFACE MOUNTED LIGHT FIXTURE                      |  | EXTEND TO FIXTURE(S) NOT SHOWN - SEE NOTE                                  |
|  | LED EXTERIOR FLOOD LIGHT FIXTURE (PHOTO TRIER)     |  | LIGHT SWITCH - 120V COMMERCIAL GRADE                                       |
|  | EXHAUST FAN - SEE MECH                             |  | LIGHT SWITCH - 3-WAY 120V COMMERCIAL GRADE                                 |
|  |  |  | LIGHT SWITCH - DIMMER 120V COMMERCIAL GRADE                                |

**DAMMON ENGINEERING, INC.**  
LOUISIANA & MISSISSIPPI

Chief Engineer: Brian Mitchel, PE  
554 Old Spanish Trail  
Stidell, LA 70458  
www.dammonengineering.com  
info@dammonengineering.com  
PH: 985.649.5832 F: 985.641.5950

| NO. | DESCRIPTION | DATE |
|-----|-------------|------|
|     |             |      |
|     |             |      |
|     |             |      |

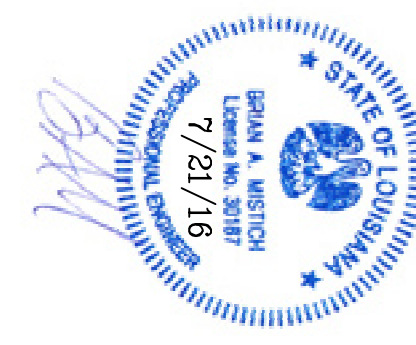

**BAYOU BAPTIST CHURCH**  
1941 SULLIVAN DR.  
SLIDELL, LA 70460

JOB No: 2274 DATE: 07/21/2016  
DRAWN BY: NMM/JTL CHECKED BY: BAM

SHEET TITLE: LIGHTING PLAN  
DRAWING NUMBER: E101  
SHEET NO.: 15 OF 17