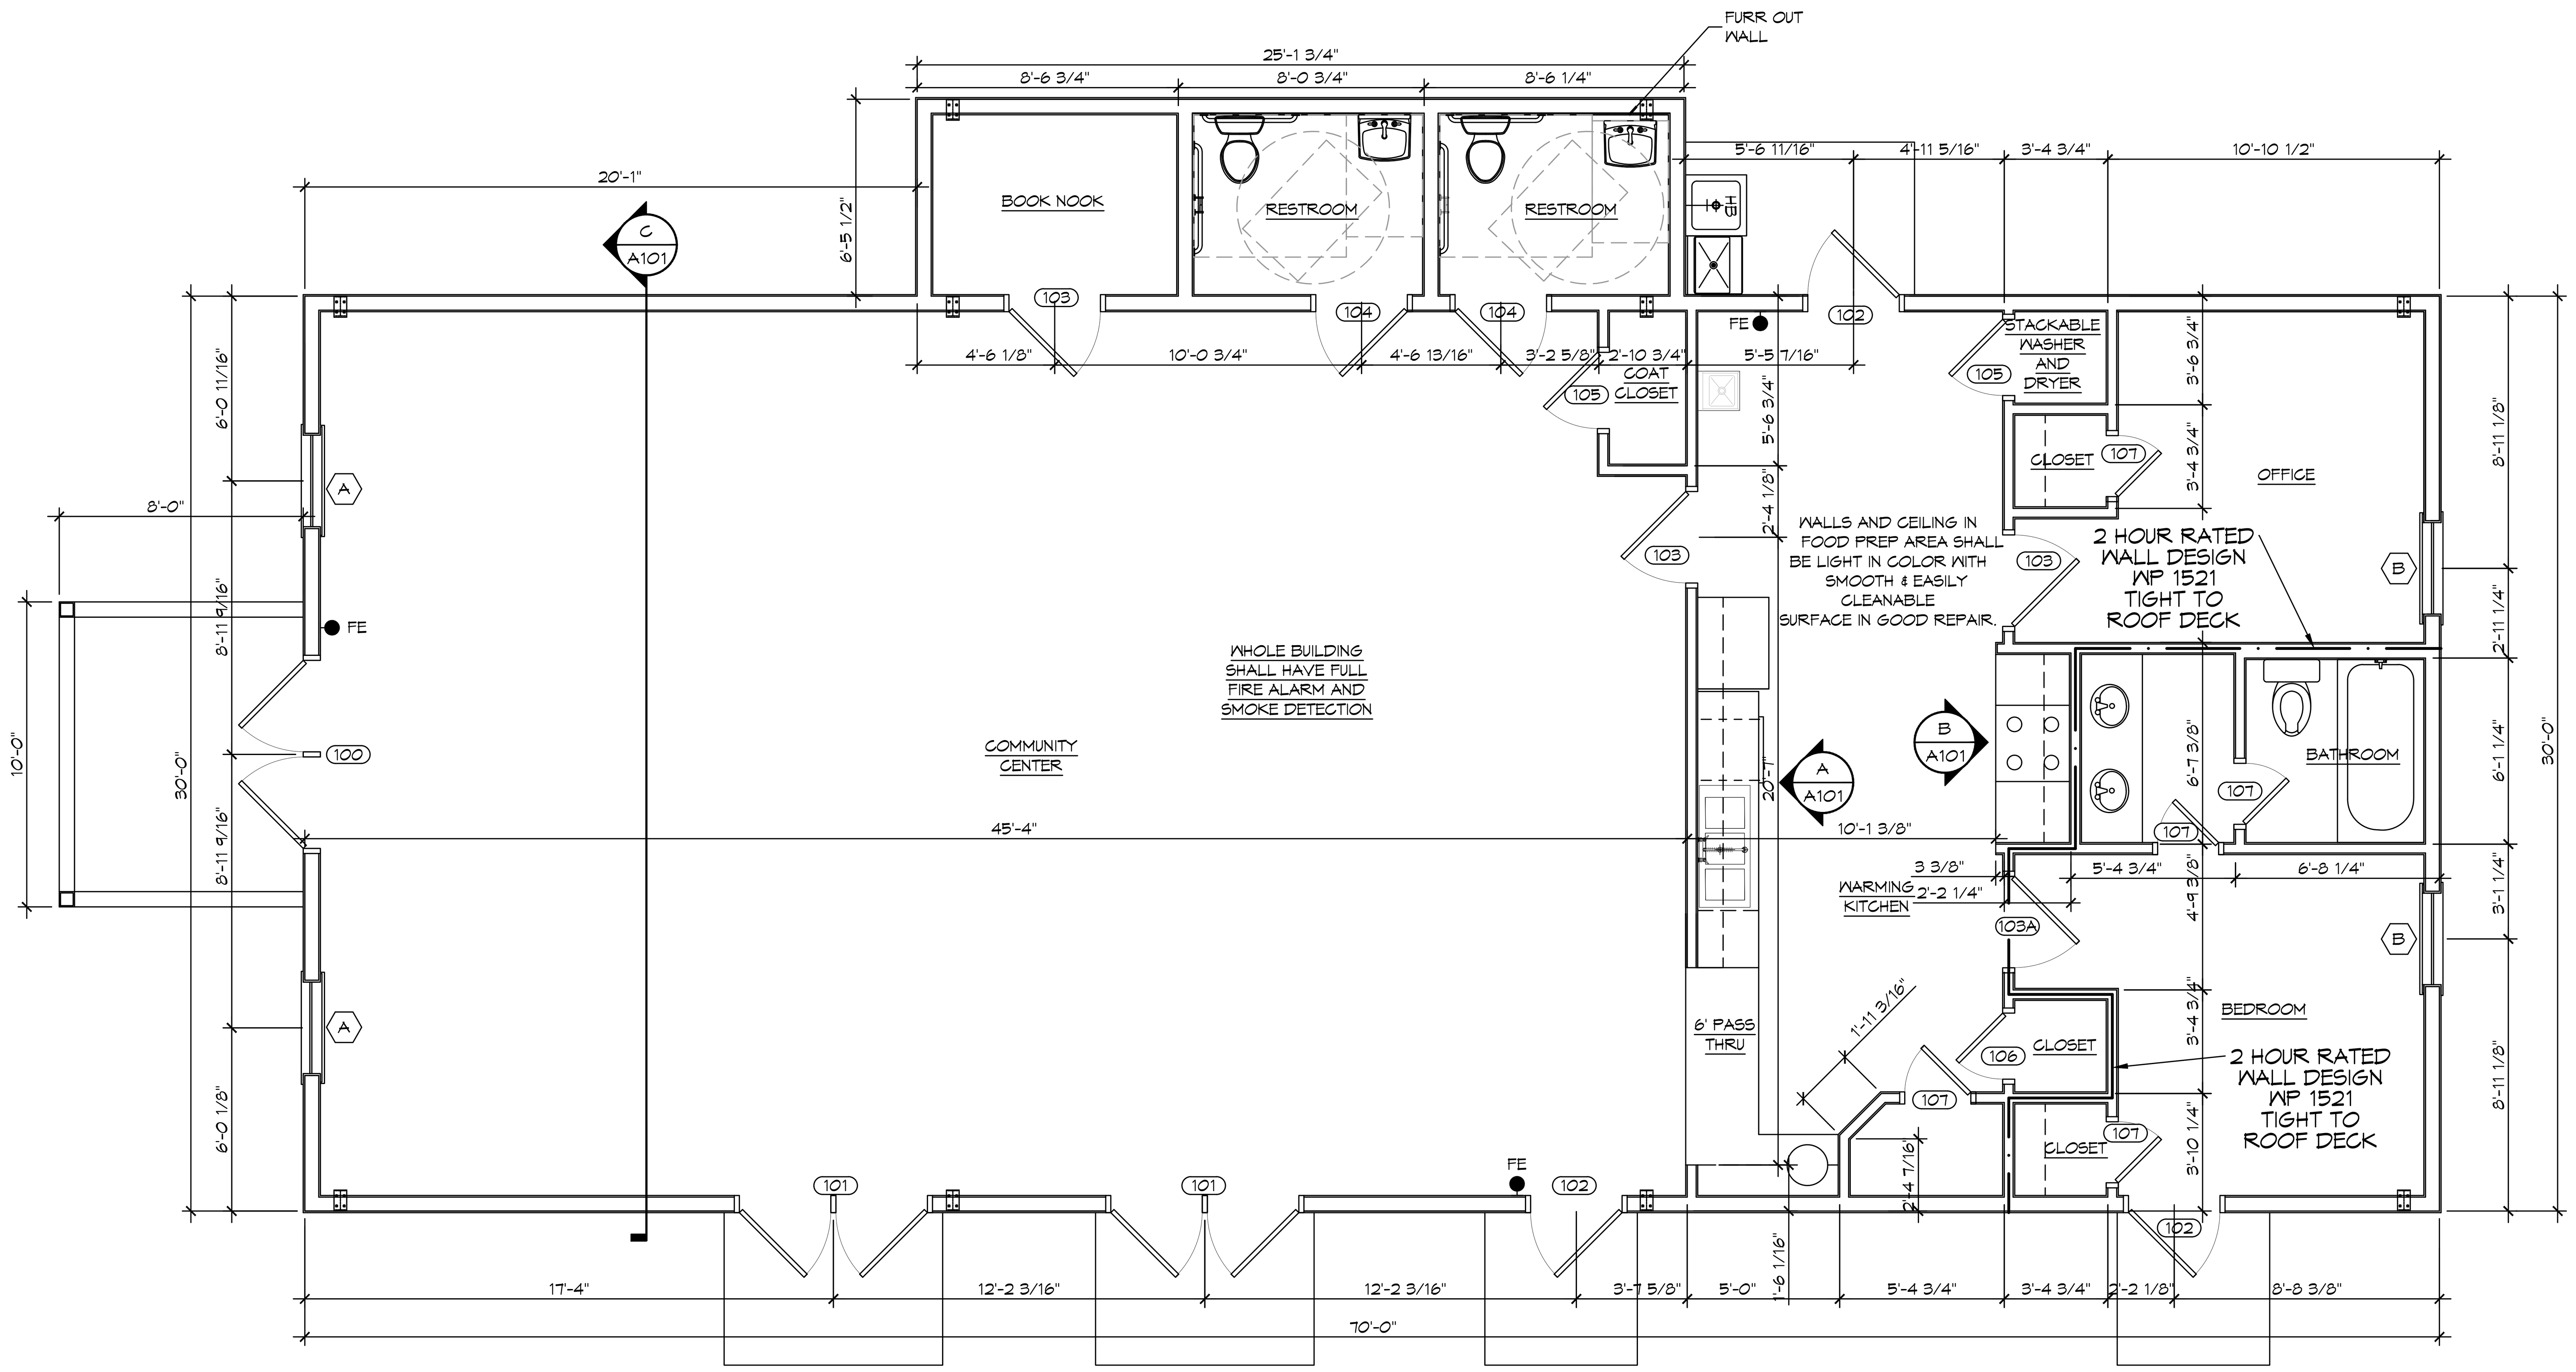


# 6 FLOOR PLAN

SCALE: 1/4" = 1'-0"

GA FILE NO. WP 1521 GENERIC

GYPSUM WALLBOARD, STEEL STUDS

BASE LAYER 5/8" TYPE X GYPSUM WALLBOARD OR GYPSUM VENEER BASE APPLIED PARALLEL TO EACH SIDE OF 3 5/8" STEEL STUDS 24" O.C. WITH 1" TYPE S DRYWALL SCREWS 24" O.C. FACE LAYER 1/2" TYPE X GYPSUM WALLBOARD OR GYPSUM VENEER BASE APPLIED PARALLEL TO EACH SIDE WITH 1 5/8" TYPE S DRYWALL SCREWS 12" O.C.

JOINTS STAGGERED 24" EACH LAYER AND SIDE. SOUND TESTED WITH 3 1/2" GLASS FIBER FRICTION FIT IN STUD SPACE (NLB).

2 HOUR FIRE — 55 TO 59 STC SOUND

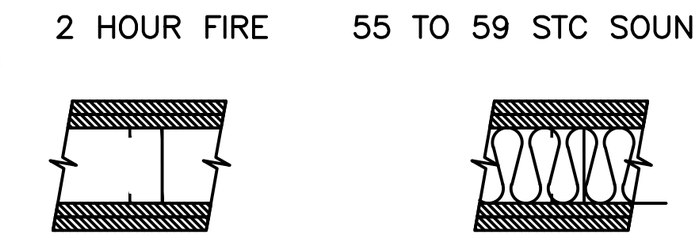

THICKNESS: 5 5/8"
LIMITING HEIGHT: REFER TO SECTION V
APPROX. WEIGHT: 9 PSF
FIRE TEST: SEE WP 1545 (UC, 9-7-64; ULC 80T499, 3-26-81 ULC DESIGN W414
SOUND TEST: NRCC 815-NV, 2-3-81

# TWO HOUR RATED WALL

SCALE: N.T.S.

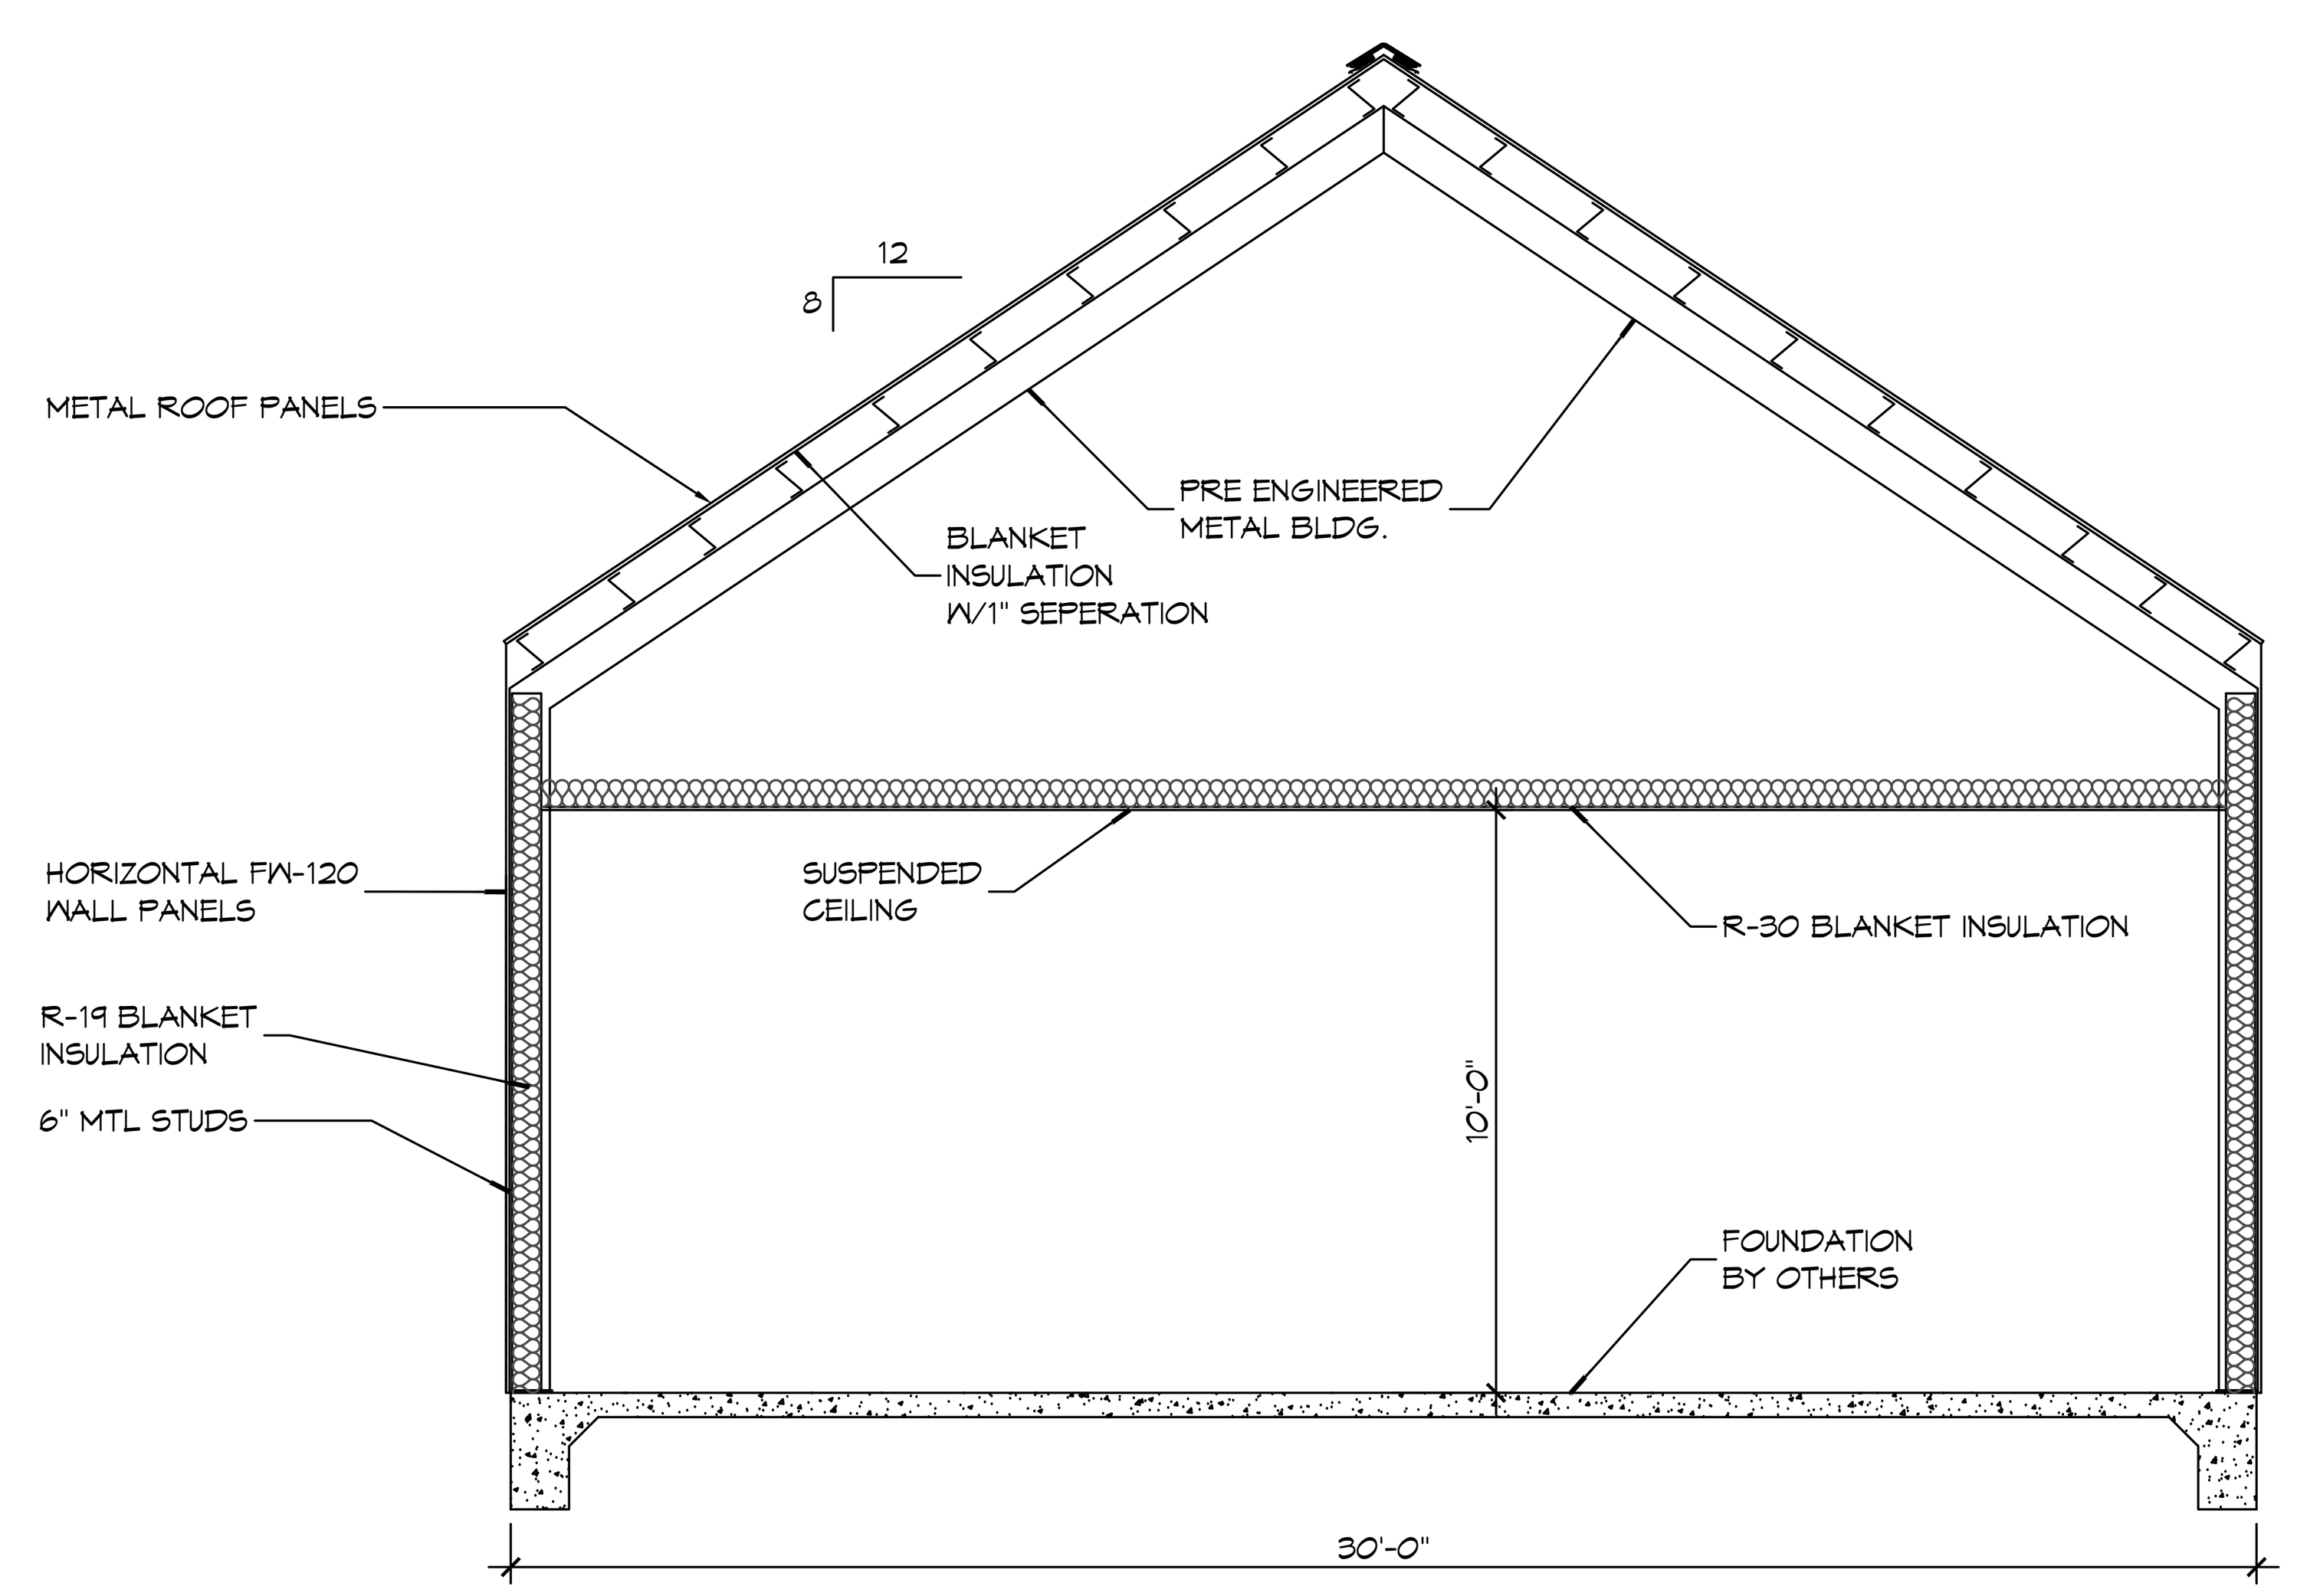


# C SECTION

SCALE: 1/4" = 1'-0"

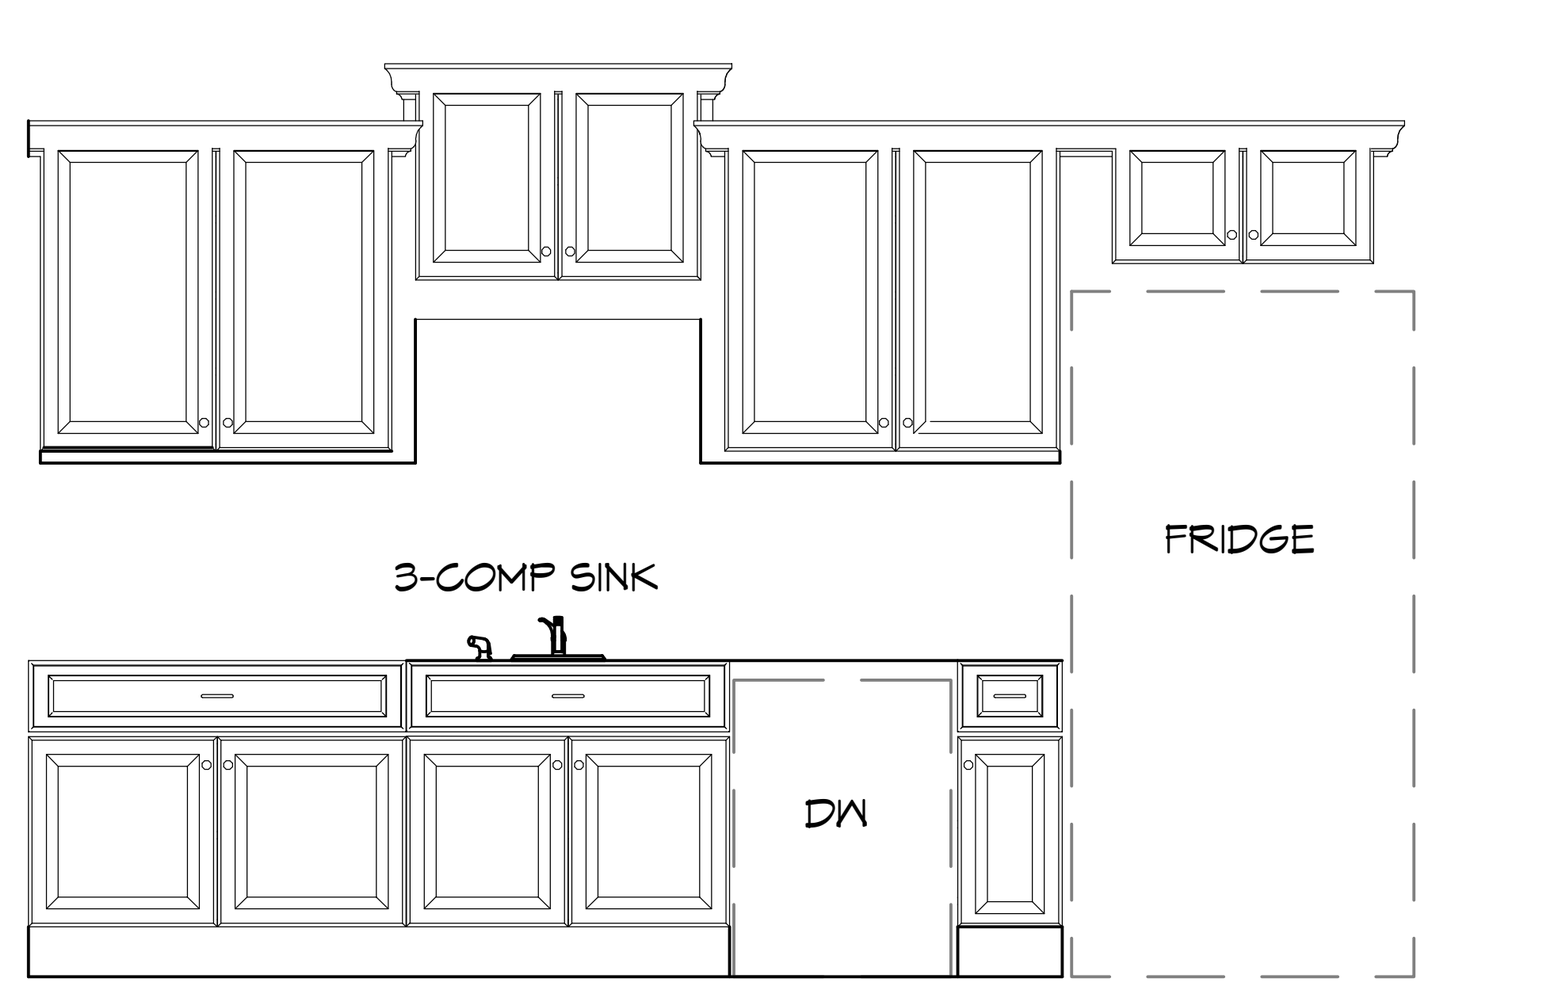


# A ELEVATION

SCALE: 3/8" = 1'-0"

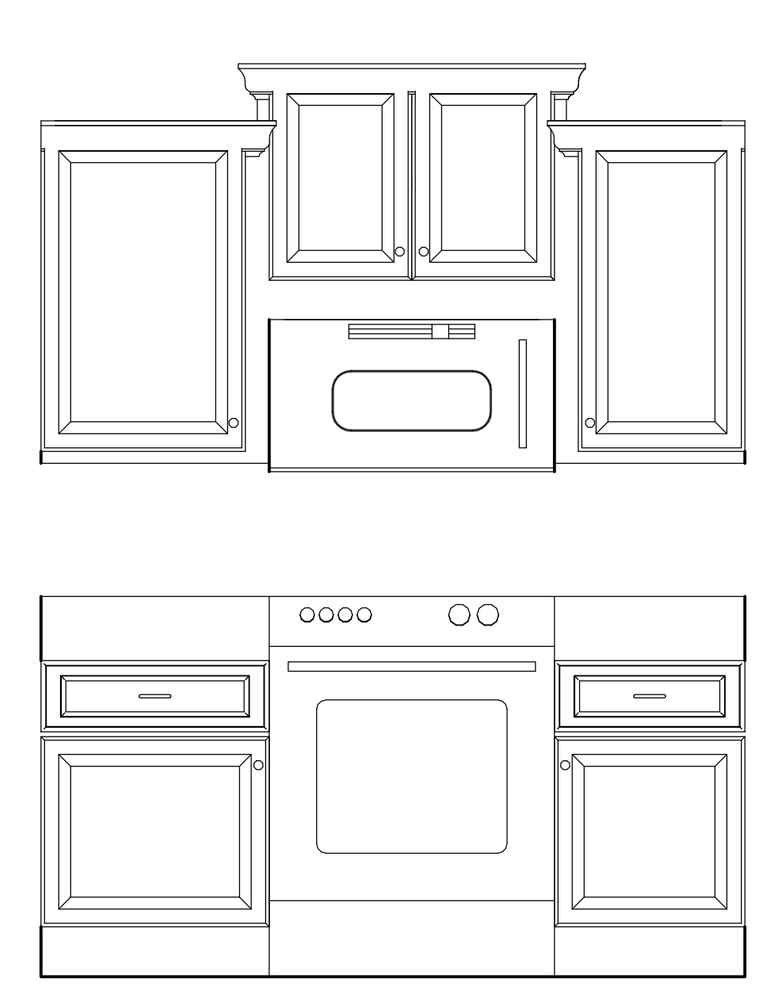

# B ELEVATION

SCALE: 3/8" = 1'-0"

## GENERAL NOTES

1. INSULATION AND INSULATION ASSEMBLIES SHALL MEET THE REQUIREMENTS OF IBC 2012 SECTION 719.
   A. CONCEALED INSULATION SHALL HAVE A FLAME SPREAD OF 0-25 AND SMOKE DEVELOPED INDEX OF 0-450. EXCEPT THAT IN COMBUSTIBLE (WOOD FRAME) CONSTRUCTION.
   B. FACING SHALL COMPLY WITH IBC 2012.
2. ALL MATERIALS SHALL BE NEW AND UL LISTED.
3. NO WORK SHALL BE CONCEALED UNTIL APPROVED BY LOCAL INSPECTORS.
4. CONSTRUCTION SHALL COMPLY WITH ALL PARISH, STATE, AND LOCAL CODES.
5. CONTRACTOR TO GUARANTEE WORK FOR ONE YEAR FROM DATE OF SUBSTANTIAL COMPLETION.
6. CONTRACTOR SHALL FURNISH WATER AND POWER FROM EXISTING SOURCES.
7. EXTERIOR CAULKING SHALL BE THIOKAL CAULK.
8. PAINT SHALL BE SHERWIN WILLIAMS OR EQUIVALENT AND APPROPRIATE FOR THE SUBSTRATE TO WHICH IT IS APPLIED AS RECOMMENDED BY PAINT MANUFACTURER. ALL WORK TO RECEIVE THREE COATS (ONE PRIMER COAT, TWO FINISH COATS) UNLESS OTHERWISE RECOMMENDED BY PAINT MANUFACTUER. COLORS TO BE SELECTED BY OWNER.
9. PROVIDE CLEANUP ON A REGULAR BASIS. NO TRASH SHALL BE STORED INSIDE BUILDING PREMISES.
10. ALL BATT INSULATION SHALL HAVE A CLASS "A" (0-25) FLAME SPREAD IN COMPLIANCE WITH IBC 2012.
11. USE 2x6 STUDS, OR TWO 2x4 STAGGERED STUDS WITH 2x6 SILL PLATE AT ALL WALLS WHERE 4" PIPE IS INDICATED. SEE PLUMBING RISER DIAGRAM FOR PIPE SIZE.
12. PROVIDE GALVANIZED METAL PAN WITH DRAIN AT ALL WATER HEATERS.
13. ALL FLOORING SHALL MEET OR EXCEED ADA GUIDELINES REQUIREMENTS FOR SLIP RESISTANCE.
14. INTERIOR LOCKS ON DOORS IN MEANS OF EGRESS SHALL NOT REQUIRE THE USE OF A KEY, SPECIAL KNOWLEDGE, OR SPECIAL DEVICE TO OPEN IN THE DIRECTION OF EGRESS. ALL DOORS SHALL HAVE LEVER TYPE HANDLES.
15. INTERIOR WALLS AND CEILINGS SHALL HAVE A FLAME SPREAD OF 0-200 AND A SMOKE DEVELOPMENT RATING OF 0-450.
16. ALL WORK SHALL COMPLY WITH THE LATEST EDITION OF ALL LOCAL, STATE, AND NATIONAL CODES COVERING THE TYPE OF WORK BEING PERFORMED.
17. PROVIDE PORTABLE FIRE EXTINGUISHERS IN ACCORDANCE WITH NFPA 101. SEE APPENDIX "E" OF NFPA 101 FOR DISTRIBUTION OF EXTINGUISHERS.
18. ALL FIRE WALLS SHALL EXTEND TIGHT TO ROOF DECK AND BE SEALED WITH AN APPROVED FIRE CAULK.
19. ALL ELECTRICAL, MECHANICAL, AND PLUMBING MATERIALS PENETRATING FIRE WALLS SHALL BE FIRE CAULKED. (PENETRATIONS THROUGH RATED CONSTRUCTION SHALL BE SEALED WITH A MATERIAL CAPABLE OF PREVENTING THE PASSAGE OF FLAMES AND HOT GASES WHEN TESTED IN ACCORDANCE WITH ASTM-E814.)
20. SERVICE COUNTERS SHALL HAVE AN ACCESSIBLE WRITING SURFACE IN COMPLIANCE WITH ADAAG ACCESSIBILITY GUIDELINES 2010, SECTION 902.3.

## DOOR SCHEDULE

| MK | WIDTH | HEIGHT | THK | DOOR MAT | FRAME MAT | FR | REMARKS |
|---|---|---|---|---|---|---|---|
| 100 | (2)3'-0" | 6'-8" | 1-3/4" | ALUM/GLASS | ALUM | NR | ALUMINUM STOREFRONT WITH DOOR CLOSURE/PANIC HARDWARE |
| 101 | (2)3'-0" | 6'-8" | 1-3/4" | STEEL | STEEL | NR | WITH DOOR CLOSURE |
| 102 | 3'-0" | 6'-8" | 1-3/4" | STEEL | STEEL | NR | WITH DOOR CLOSURE/PANIC HARDWARE |
| 103 | 3'-0" | 6'-8" | 1-3/4" | SOLID WOOD | WOOD | NR | WITH DOOR CLOSURE |
| 103 A | 3'-0" | 6'-8" | 1-3/4" | SOLID WOOD | STEEL | 90 MIN | WITH DOOR CLOSURE |
| 104 | 3'-0" | 6'-8" | 1-3/4" | SOLID WOOD | WOOD | NR | WITH DOOR CLOSURE |
| 105 | 2'-6" | 6'-8" | 1-3/4" | SOLID WOOD | WOOD | NR | |
| 106 | 2'-2" | 6'-8" | 1-3/4" | SOLID WOOD | WOOD | NR | |
| 107 | 2'-0" | 6'-8" | 1-3/4" | SOLID WOOD | WOOD | NR | |

## WINDOW SCHEDULE

| MK | SIZE | FRAME | TYPE | REMARKS |
|---|---|---|---|---|
| A | 3'-0"W x 8'-0"H | ALUM | FIXED | NEW WINDOW |
| B | 3'-0"W x 5'-0"H | ALUM | SLIDER | NEW WINDOW |

## FINISH SCHEDULE

| ROOM NAME | FLOOR | BASE | WALL | CEILING | REMARKS |
|---|---|---|---|---|---|
| COMMUNITY CENTER | VCT | VINYL | 5/8" GYP BD | ACT | |
| BOOK NOOK | VCT | VINYL | 5/8" GYP BD | 5/8" GYP BD | |
| RESTROOM | CERAMIC TILE | CERAMIC TILE | 5/8" GYP BD | 5/8" GYP BD | MOISTURE RESISTANT |
| RESTROOM | CERAMIC TILE | CERAMIC TILE | 5/8" GYP BD | 5/8" GYP BD | MOISTURE RESISTANT |
| COAT CLOSET | VCT | VINYL | 5/8" GYP BD | ACT | |
| WARMING KITCHEN | VCT | VINYL | 5/8" GYP BD | 5/8" GYP BD | |
| CLOSET | VCT | VINYL | 5/8" GYP BD | ACT | |
| BEDROOM | VCT | VINYL | 5/8" GYP BD | 5/8" GYP BD | |
| BATHROOM | CERAMIC TILE | CERAMIC TILE | 5/8" GYP BD | 5/8" GYP BD | MOISTURE RESISTANT |
| BEDROOM | VCT | VINYL | 5/8" GYP BD | 5/8" GYP BD | |
| CLOSET | VCT | VINYL | 5/8" GYP BD | 5/8" GYP BD | |
| CLOSET | VCT | VINYL | 5/8" GYP BD | 5/8" GYP BD | |
| CLOSET | VCT | VINYL | 5/8" GYP BD | 5/8" GYP BD | |

DAMMON ENGINEERING, INC.
LOUISIANA & MISSISSIPPI
Chief Engineer: Brian Mistich, PE
554 Old Spanish Trail
Slidell, LA 70458
www.dammonengineering.com
info@dammonengineering.com
PH: 985.649.5832

| REVISIONS | | |
|---|---|---|
| # | DESCRIPTION | DATE |

SEAL:

MULTI PURPOSE BUILDING

OUR LADY OF FATIMA

6610 VORTISCH ROAD
LACOMBE, LOUISIANA 70445

| JOB No: | 2310 | DATE: | 08-22-2023 |
|---|---|---|---|
| DRAWN BY: | CKD | CHECKED BY: | CKD |

SHEET TITLE: FLOOR PLAN

DRAWING NUMBER: A101

SHEET No: 6 of 12