


DOOR & HARDWARE SCHEDULE						
MARK	SIZE	DOOR TYPE	FRAME	HWDR. NO.	STC	REMARKS
<b>EXTERIOR DOORS</b>						
1	PR. 3/0x7/0	STORE FRONT	TO MATCH DOOR	1	NA	STOREFRONT UNIT, PROVIDE TRANSOM, SEE ELEVATIONS
2	PR. 3/0x6/8	FLUSH GALV. HOL. MET. STEEL INSUL.	GALV. PTD. HOL. MET.	1	NA	GALVANIZING TO BE G90
3	3/0x6/8	FLUSH GALV. HOL. MET. STEEL INSUL.	GALV. PTD. HOL. MET.	1	NA	GALVANIZING TO BE G90 45 MIN. FIRE RATED
<b>INTERIOR DOORS</b>						
4	3/0x7/0	FLUSH SOLID CORE WD.	PTD. HOL. MET.	5	NA	STAIN SELECT BY OWNER
5	3/0x7/0	FLUSH SOLID CORE WD.	PTD. HOL. MET.	3	NA	STAIN SELECT BY OWNER
6	3/0x7/0	FLUSH SOLID CORE WD.	PTD. HOL. MET.	4	NA	STAIN SELECT BY OWNER
7	2/6x7/0	FLUSH SOLID CORE WD.	PTD. HOL. MET.	3	NA	STAIN SELECT BY OWNER
8	2/6x7/0	FLUSH SOLID CORE WD.	PTD. HOL. MET.	3	NA	STAIN SELECT BY OWNER PROVIDE RETURN AIR GRILLE
9	3/0x7/0	FLUSH SOLID CORE WD.	PTD. HOL. MET.	5	NA	STAIN SELECT BY OWNER 45 MIN. FIRE RATED

**DOOR HARDWARE SCHEDULE:**  
 1. AUTO CLOSER, PANIC BAR, AIR RESISTANT METAL THRESHOLD, WEATHERSTRIP, DOOR STOP, EXTERIOR CYLINDER LOCK.  
 2. OFFICE/ENTRANCE, BALL BEARING US22D HINGES.  
 3. AUTO CLOSER, DOOR STOP, CYLINDER LOCK, OFFICE/ENTRANCE, BALL BEARING US32D HINGES.  
 4. PASSAGE LOCK, DOOR STOP, US26D HINGES.  
 5. KEYED HANDLE (OFFICE/ENTRANCE), DOOR STOP, US26D HINGES.  
 6. AUTO CLOSER, DOOR STOP, PRIVACY LOCK, BALL BEARING US26D HINGES.

WINDOW SCHEDULE					
MARK	SIZE	WINDOW TYPE	FRAME	GLASS	REMARKS
A	OVERALL UNIT SIZE = 11'W x 9'-4"H WITH TRANSOM	ALUMINUM STOREFRONT	ALUMINUM 2" x 4"	LOW E	SEE EXTERIOR ELEVATIONS
B	OVERALL UNIT SIZE = 6'-4"W x 7'-6"H	ALUMINUM STOREFRONT	ALUMINUM 2" x 4"	LOW E	SEE EXTERIOR ELEVATIONS
C	OVERALL UNIT SIZE = 16'W x 8'-10"H	ALUMINUM STOREFRONT	ALUMINUM 2" x 4"	1/4" CLEAR TEMPERED	INTERIOR WINDOW

**WINDOW SCHEDULE NOTES:**  
 1. GLAZING TO BE DBL. GLAZED LAMINATED LOW E.  
 2. EXTERIOR WINDOW SYSTEM SHALL BE CAPABLE OF RESISTING 130 MPH WIND LOAD.

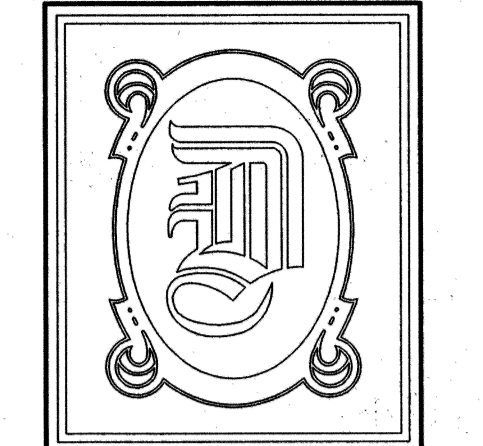

**DAMMON ENGINEERING, INC.**

CHIEF ENGINEER  
EMMETT DAMMON, P.E.

CHIEF ARCHITECT  
ROBERT WILTSE

554 OLD SPANISH TRAIL  
SLIDELL, LA. 70458  
OFFICE: 985-649-5832  
FAX: 985-641-5950

WEBSITE:  
WWW.DAMMONENGINEERING.COM


EMAIL:  
DAMMONENG@BELLSOUTH.NET

ARCHITECTURE  
ENGINEERING  
STUDIES  
PLANNING  
INVESTIGATION  
EXPERT WITNESS

**BROCK BEAUTY INC.**

K.B. KAUFMANN  
OAK HARBOR BLVD.  
LOT 3  
SLIDELL, LA  
70458

**FIRST FLOOR PLAN**

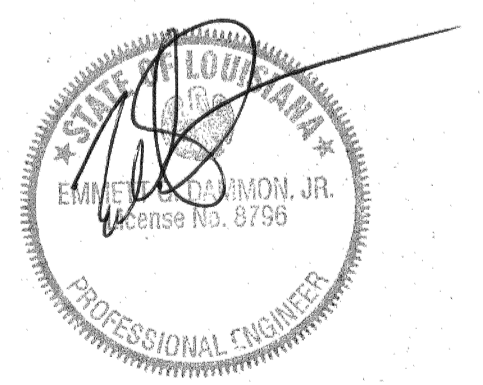

REV:

SCALE: AS NOTED

JOB#: 2125

DATE: 12-21-11

SHEET 7

**A-1**

OF 18

**UL465**  
**1 HOUR FIREWALL (U465)**

- FLOOR AND CEILING RUNNER: (NOT SHOWN) 25 MSG MIN. GALV. STEEL 1" HIGH, RETURN LEGS 3-5/8" (MIN), ATTACHED TO FLOOR AND CEILING WITH FASTENERS AT 24" O.C.
- STEEL STUDS: 3-5/8" WIDE (MIN.), 1-1/4" LEGS, 3/8" RETURN, FORMED OF 25 MSG GALV. STEEL, MAX. SPACING 24" O.C.
- GYPSUM WALLBOARD: 5/8" THICK, 4' WIDE, ATTACHED TO STEEL STUDS AND FLOOR AND CEILING TRACK WITH 1" LONG TYPE "S" SELF-TAPPING STEEL SCREWS SPACED 8" O.C. ALONG EDGES OF BOARD AND 12" O.C. IN THE FIELD OF THE BOARD. JOINTS ORIENTED VERT. AND STAGGERED ON OPPOSITE SIDES OF THE ASSEMBLY.
- BAITTS AND BLANKETS: MINERAL WOOL INSULATION, PARTIALLY OR COMPLETELY FILLING STUD CAVITY.
- JOINT AND TAPE COMPOUND: VINYL, DRY OR PREMIXED JOINT COMPOUND, APPLIED IN TWO COATS TO JOINTS AND SCREW HEADS; PAPER TAPE, 2" WIDE, EMBEDDED IN FIRST LAYER OF COMPOUND OVER ALL JOINTS. AS AN ALTERNATE, NOMINAL 3/32" THICK GYPSUM VENEER PLASTER MAY BE APPLIED TO THE ENTIRE SURFACE OF CLASSIFIED VENEER BASEBOARD. JOINT REINFORCED.

**UL425**  
**1 HOUR FIREWALL (U425)**

- EXTERIOR SIDE: 5/8" DENSGLASS FIREGUARD SHEATHING APPLIED VERT. TO MIN. 3-1/2" CORROSION RESISTANT 20ga STEEL STUDS @ 24" O.C. WITH 1" TYPE S CORROSION RESISTANT BULGE HEAD SCREWS @ 8" O.C. AT BOARD EDGES AND 8" O.C. AT INTERMEDIATE STUDS.
- INTERIOR SIDE: 5/8" TOUGHROCK FIREGUARD OR DENSARMOR PLUS FIREGUARD GYPSUM BOARD APPLIED VERT. TO FRAMING WITH 1" TYPE S BULGE SCREWS @ 8" O.C. AT BOARD EDGES AND 12" O.C. AT INTERMEDIATE STUDS. INSULATION TO COMPLETELY FILL STUD CAVITY.
- INSULATION

**AREA BY USE:**  
 TOTAL AREA: 6,000 SQ.FT.  
 1ST FLOOR GROSS AREA: 3,000 SQ.FT.  
 OFFICE NET AREA = 745 SQ.FT.  
 SHOWROOM NET AREA = 1,500 SQ.FT.

**2ND FLOOR GROSS AREA: 3,000 SQ.FT.**  
 OFFICE NET AREA = 1,395 SQ.FT.

**PLUMBING FIXTURE COUNT:**  
 PER LA STATE PLUMBING CODE 2000 EDITION  
 BUILDING GROSS SQ.FT. = 6,000  
 BUILDING NET SQ.FT. = 3,640  
 OCCUPANT LOAD FOR OFFICE = 100 SQ.FT. PER 1 OCC.  
 LOAD = 3,640/100 = 36.4 (37) OCCUPANTS

MENS TOILETS REQUIRED = 2  
 MENS LAVATORY PROVIDED = 2  
 FEMALE TOILETS REQUIRED = 2  
 FEMALE LAVATORY PROVIDED = 2  
 FEMALE LAVATORY PROVIDED = 2

**GENERAL NOTES**

- INSULATION AND INSULATION ASSEMBLIES SHALL MEET THE REQUIREMENTS OF SECTION 719.
  - CONCEALED INSULATION SHALL HAVE A FLAME SPREAD OF 0-25 AND SMOKE DEVELOPED INDEX OF 0-450. EXCEPT THAT IN COMBUSTIBLE (WOOD FRAME) CONSTRUCTION.
  - FACING SHALL COMPLY WITH IBC 2009.
- PROVIDE 5x5" LANDINGS, LEVEL WITH FINISHED FLOOR, OUTSIDE EXTERIOR DOORS ON WEST SIDE OF BUILDING. THRESHOLDS SHALL BE NOT MORE THAN 1/2" IN HEIGHT AND SHALL BE BEVELED IF MORE THAN 1/4".
- CONTRACTOR TO VERIFY ALL SITE CONDITIONS, BUILDING LOCATIONS, AND DIMENSIONS PRIOR TO CONSTRUCTION.
- MATERIALS SHALL BE NEW AND U.L. LISTED.
- NO WORK SHALL BE CONCEALED UNTIL APPROVED BY LOCAL INSPECTORS.
- CONSTRUCTION SHALL COMPLY WITH ALL PARISH, STATE, AND LOCAL CODES.
- CONTRACTOR TO GUARANTEE WORK FOR ONE YEAR.
- CONTRACTOR SHALL FURNISH WATER AND POWER FROM EXISTING SOURCES.
- EXTERIOR CAULKING SHALL BE THIKOKAULK.
- PAINT GRADE TO SHALL BE SHERWIN WILLIAMS OR EQUIVALENT. ALL WORK TO RECEIVE 3 COATS. COLOR SELECTION BY OWNER.
- PROVIDE CLEANUP ON A REGULAR BASIS. NO TRASH STORED IN BUILDING.
- ALL BATT INSULATION SHALL HAVE A CLASS "A" (0-25) FLAME SPREAD IN COMPLIANCE WITH APPLICABLE CODE.
- USE 6" STUDS, OR 4" STAGGERED STUDS AT ALL PLUMBING WALLS.
- PROVIDE GALVANIZED METAL PAN WITH DRAIN AT WATER HEATER LOCATION.
- ALL CORNERS SHALL BE PROPERLY BRACED FOR WIND LOADS. A 48" SHEATHING SHALL BE PROVIDED EVERY 20 FEET OF WALL LENGTH.
- INTERIOR LOCKS ON DOORS IN MEANS OF EGRESS SHALL NOT REQUIRE THE USE OF A KEY, SPECIAL KNOWLEDGE, OR SPECIAL DEVICE TO OPEN IN THE DIRECTION OF EGRESS. ALL DOORS SHALL HAVE LEVER TYPE HANDLES.
- INTERIOR WALLS AND CEILINGS SHALL HAVE A FLAME SPREAD OF 0-200 AND A SMOKE DEVELOPMENT RATING OF 0-450.
- ALL WORK SHALL COMPLY WITH THE LATEST EDITION OF ALL LOCAL, STATE, AND NATIONAL CODES COVERING THE TYPE OF WORK BEING PERFORMED.
- PROVIDE PORTABLE FIRE EXTINGUISHERS IN ACCORDANCE WITH NFPA 101. SEE APPENDIX "E" OF NFPA 101 FOR DISTRIBUTION OF EXTINGUISHERS.
- ALL FIRE WALLS SHALL EXTEND TIGHT TO ROOF DECK AND BE SEALED WITH AN APPROVED FIRE CAULK.
- ALL ELECTRICAL, MECHANICAL, AND PLUMBING MATERIALS PENETRATING FIRE WALLS SHALL BE FIRE CAULKED. (PENETRATIONS THROUGH RATED CONSTRUCTION SHALL BE SEALED WITH A MATERIAL CAPABLE OF PREVENTING THE PASSAGE OF FLAMES AND HOT GASES WHEN TESTED IN ACCORDANCE WITH ASTM-E814.)
- SERVICE COUNTER SHALL HAVE A HCP ACCESSIBLE WRITING SURFACE, MAX. 36" FROM F.F. (ADAAG MANUAL 1998, PG 135)