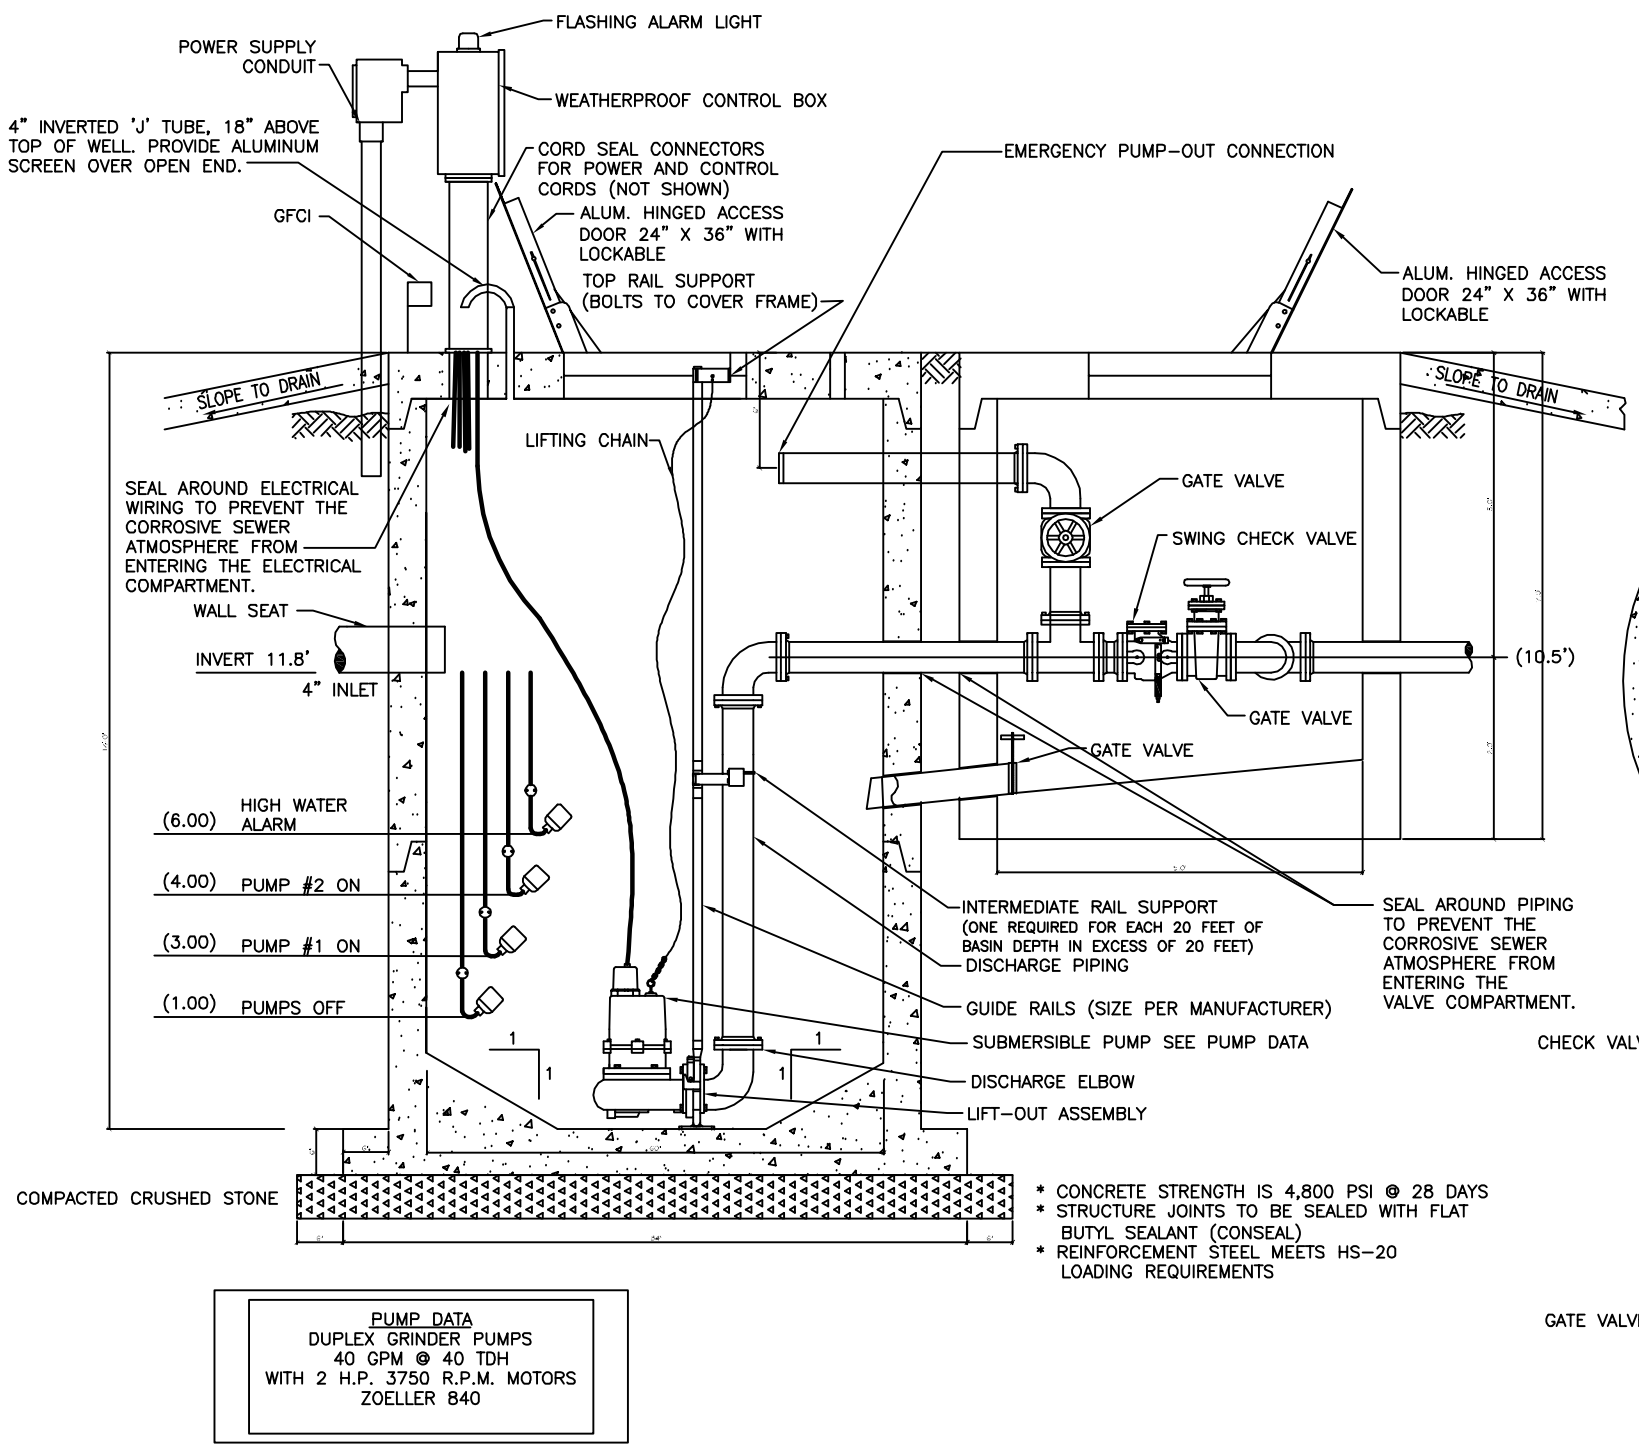

* CONCRETE STRENGTH IS 4,800 PSI @ 28 DAYS
* STRUCTURE JOINTS TO BE SEALED WITH FLAT BUTYL SEALANT (CONSEAL)
* REINFORCEMENT STEEL MEETS HS-20 LOADING REQUIREMENTS

PUMP DATA
DUPLEX GRINDER PUMPS
40 GPM @ 40 TDH
WITH 2 H.P. 3750 R.P.M. MOTORS
ZOELLER 840

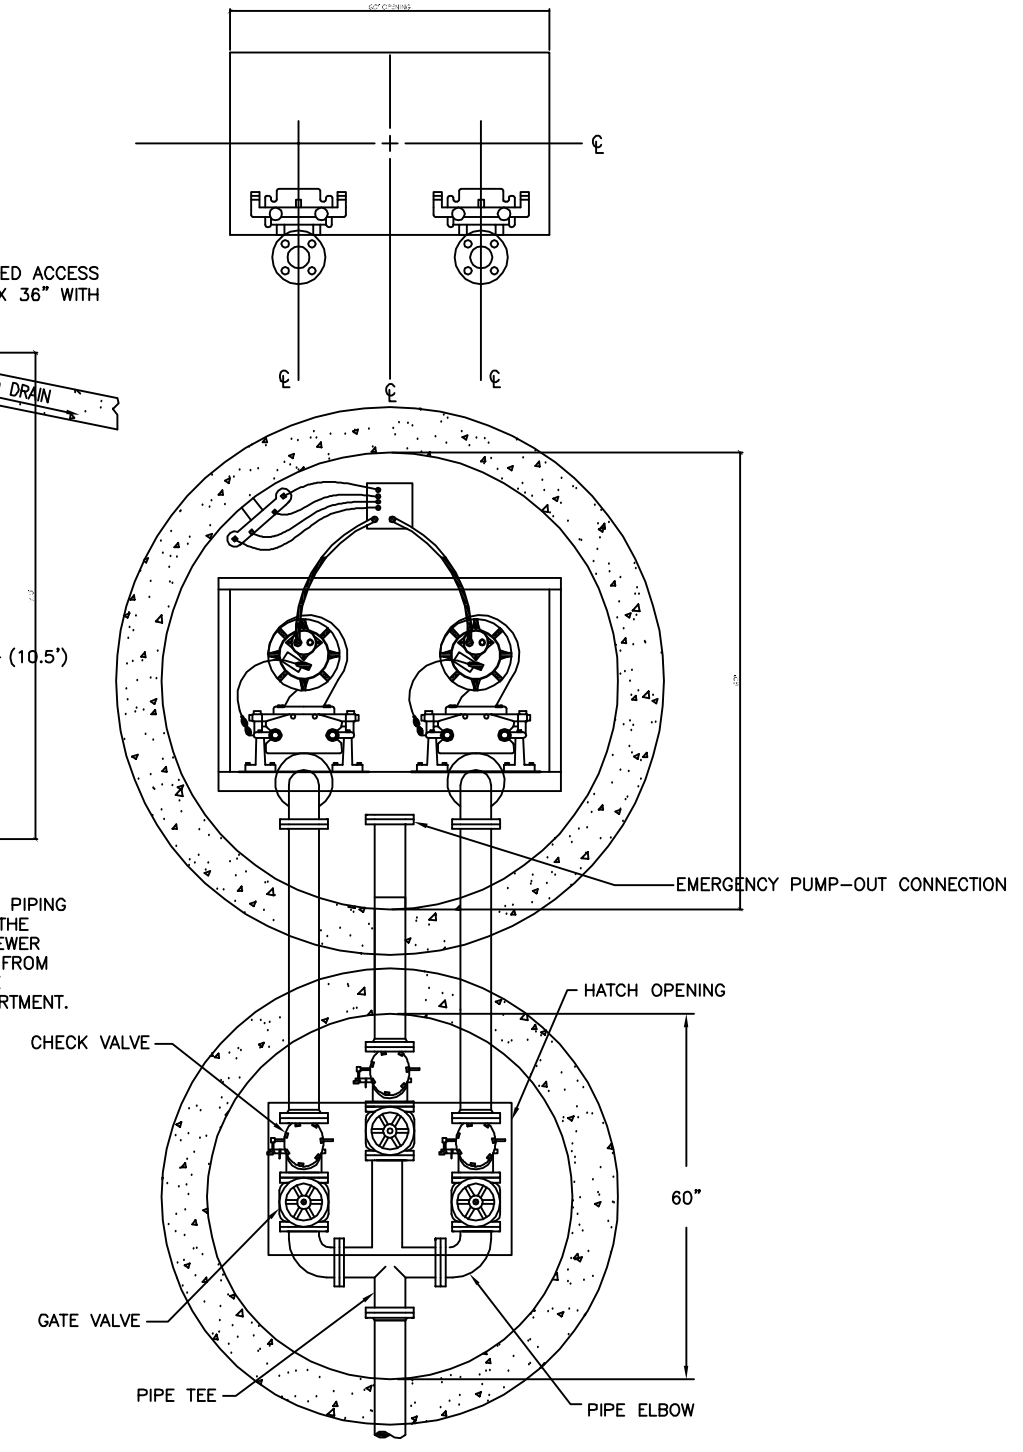

DUPLEX LIFT STATION DETAIL

NOT TO SCALE

DAMMON ENGINEERING, INC.
Architects & Engineers

CHIEF ENGINEER: BRIAN MISTICH, P.E.
CHIEF ARCHITECT: KEVIN KINCHEN
554 OLD SPANISH TRAIL
SLIDELL, LA 70458
dammonengineering.com
dammonengr@bellsouth.net
PHONE: 985-641-5932
FAX: 985-641-5953

DREAMLAND MOBILE HOME PARK
ALLIE ESSENCE LANE
NICHOLSON, MISSISSIPPI

JOB No: 2182 | DATE: 05-19-2014
DRAWN BY: CKD | CHECKED BY: BM

REVISIONS

#	DESCRIPTION	DATE

SEWER LIFT STATION

SHEET No: 03 OF 04

C2A