

**GENERAL NOTES**

1. INSULATION AND INSULATION ASSEMBLIES SHALL MEET THE REQUIREMENTS OF SECTION 1104.
  - A. CONCEALED INSULATION SHALL HAVE A FLAME SPREAD OF 0-25 AND SMOKE DEVELOPED INDEX OF 0-450, EXCEPT THAT IN COMBUSTIBLE (WOOD FRAME) CONSTRUCTION.
  - B. FACING SHALL COMPLY WITH IBC 2006.
2. CONTRACTOR TO VERIFY ALL SITE CONDITIONS AND DIMENSIONS PRIOR TO CONSTRUCTION.
3. MATERIALS SHALL BE NEW AND UL LISTED.
4. NO WORK SHALL BE CONCEALED UNTIL APPROVED BY LOCAL AUTHORITIES HAVING JURISDICTION.
5. CONSTRUCTION SHALL COMPLY WITH ALL FEDERAL, STATE, AND LOCAL CODES.
6. CONTRACTOR TO GUARANTEE ALL NEW WORK FOR A PERIOD OF ONE YEAR FROM THE DATE OF SUBSTANTIAL COMPLETION.
7. CONTRACTOR SHALL FINISH WATER AND POWER FROM EXISTING SOURCES.
8. ANY EXTERIOR CALLING SHALL BE THICK CAULK.
9. PAINT GRADE TO SHALL BE GYPSUM WALLS OR EQUIVALENT. ALL WORK TO NEED TO BE DONE (ONE COAT PRIMER AND TWO FINISH COATS) TO BE SCHEDULED BY THE CONTRACTOR.
10. FURNISH SITE CLEANUP ON A VESSEL'S BASIS. NO TRASH STORED IN BUILDING.
11. ALL BATT INSULATION SHALL HAVE A CLASS "X" (0-25) FLAME SPREAD IN COMPLIANCE WITH APPLICABLE CODE.
12. USE 6" STUDS OR 4" STAGGERED STUDS AT ALL PLUMBING WALLS.
13. PROVIDE GALVANIZED METAL SAFE PAN WITH DRAIN AT BELOW WATER HEATER.
14. ALL EXTERIOR BUILDING CORNERS SHALL BE PROPERLY BRACKED FOR WIND LOADS. A 48\"/>


**NOTES**

- 1.
- 2.
- 3.
- 4.

**KEYNOTES**

- 1.
- 2.
- 3.
- 4.
- 5.
- 6.

**DOOR AND FRAME TYPES**

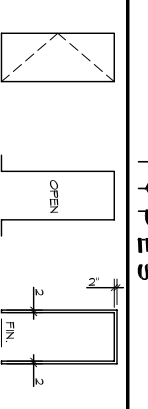

**PARTITION TYPES**

- 6A FILE NO. W-1072
- GENERIC**
- ONE LAYER 5/8\"/>

**RENOVATION FOR**

**0 - Z W A S N**

300 KENSINGTON BOULEVARD  
SLIDELL, LOUISIANA 70458

JOB NO: 2232 DATE: 04-09-15

DRAWN BY: JTL CHECKED BY: CKD

REVISIONS

| # | DESCRIPTION | DATE |
|---|-------------|------|
|   |             |      |
|   |             |      |
|   |             |      |
|   |             |      |
|   |             |      |

**DAMMON ENGINEERING, INC.**

Architects & Engineers

Chief Architect: Kevin J. Kinchen, NCARB  
Chief Engineer: Brian Mistich, PE

www.dammoneengineering.com  
info@dammoneengineering.com  
PH: 985.649.5832  
F: 985.641.5950

SHEET NO. **A101**