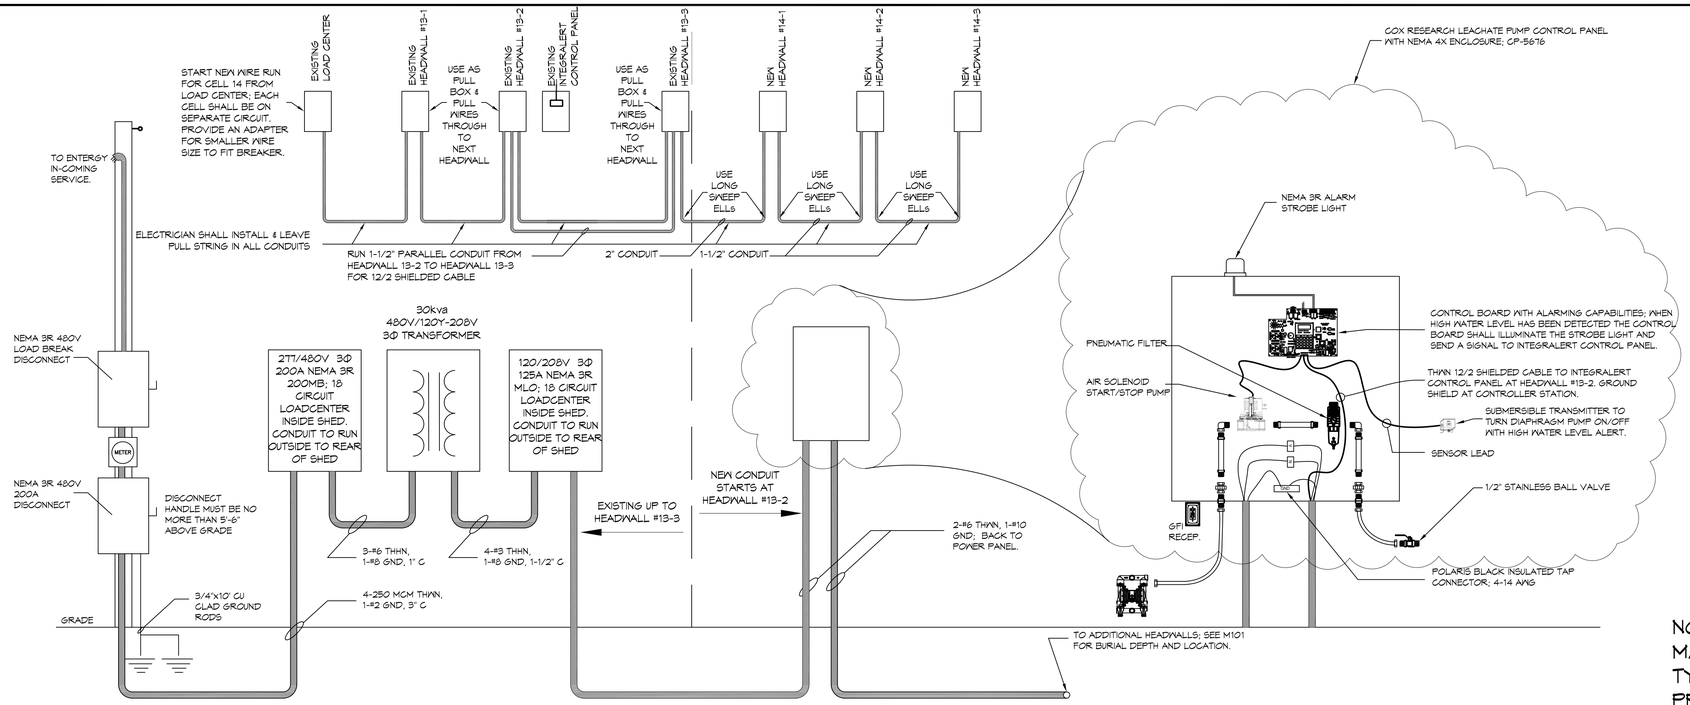

EXISTING 480V SERVICE ENTRANCE (3)
N.T.S. SHED E101 E101

HEADWALL ELECTRICAL CONNECTION (TYP) (4)
N.T.S. E101 E101

ELECTRICAL EQUIPMENT LIST	
QUANTITY	ITEM
1	LEACHATE PUMP CONTROL PANEL AND TRANSDUCER, MANUFACTURER COX, MDL CP-5676
9	POLARIS BLACK INSULATED TAP CONNECTOR; 4-14 AWG

COX RESEARCH & TECHNOLOGY LEACHATE PUMP CONTROL PANEL AND TRANSDUCER EQUIPMENT LIST, MODEL CP-5676	
QUANTITY	ITEM
1	HOFFMAN NEMA 4X ENCLOSURE, PART # CSD242010SS
1	COX RESEARCH BACKPLATE/SWING PANEL, PART # CAMO242010CSD
1	SQUARE D CIRCUIT 40 AMP BREAKER, PART # QOU140
1	SQUARE D CIRCUIT 15 AMP BREAKER, PART # QOU115
1	SQUARE D CIRCUIT 10 AMP BREAKER, PART # QOU110
1	HUBBELL GFI RECEPTACLE
1	TPS SURGE SUPPRESSOR, PART # TK-LT120-15A-DIN2
1	PRECISION DIGITAL SETPOINT CONTROLLER, PART # PD6000-6R7
1	MJK SUBMERSIBLE TRANSDUCER, PART # 3400
1	ABB H.O.A. SWITCH, PART # C3SS110B-20
1	ABB BLUE PILOT LIGHT, PART # CL513L
1	CONERY ALARM LIGHT, PART # R40-XLS
1	ASCO AIR SOLENOID VALVE, PART # 8210G002
2	IDEC ELECTROMECHANICAL RELAY, PART # RY4SULCAC120
1	HOFFMAN PAD LOCK HANDLE, PART # GPDLOCKHDL
1	MASTER PNEUMATIC FILTER, PART # CF5AR350
2	1/2" x 1/2" BULKHEAD COPPER ADAPTER
2	1/2" COPPER UNION
2	1/2" x 6" COPPER PIPE
2	1/2" 90° COPPER ELBOW
1	1/2" MALE TO MALE FITTING

NOTE: NAMING A CERTAIN BRAND, MAKE OR MANUFACTURER IS TO DESIGNATE THE GENERAL STYLE, TYPE, CHARACTER AND QUALITY STANDARD OF THE PRODUCT DESIRED. SUBSTITUTION REQUESTS MUST BE SUBMITTED PRIOR TO BIDDING.

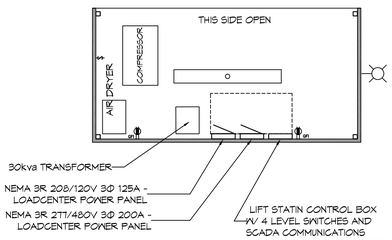

COMPRESSOR SHED ELECTRICAL PLAN (2)
N.T.S. E101 E101

EXISTING INTEGRALERT SYSTEM LOCATED AT HEADWALL 13-2, CONTROL PANEL CONNECTIONS.								
	IN1	IN2	IN3	IN4	IN5	IN6	IN7	IN8
HEADWALL	13-1	13-2	13-3	14-1	14-2	14-3	SPARE	SPARE

1. ELECTRICIAN SHALL MAKE CONNECTIONS FROM THE NEW CONTROL PANEL'S ALARM CONTACT TO THE EXISTING INTEGRALERT SYSTEM LOCATED AT HEADWALL 13-2 USING THE TABLE ABOVE.
2. ELECTRICIAN SHALL TEST THE NEW CONTROL PANEL TO ENSURE THAT WHEN A HIGH WATER LEVEL HAS BEEN DETECTED THAT IT:
   A. TURNS ON THE STROBE LIGHT AT THAT CONTROL PANEL.
   B. SENDS AN ALERT VIA INTEGRALERT SYSTEM.

PUMP CONTROLLER SETTINGS:				
	PUMP ON	PUMP OFF	HIGH LEVEL ON	HIGH LEVEL OFF
LEACHATE DEPTH	1.5	0.75	2.0	1.6

ELECTRICAL NOTES

1. ALL WORK SHALL CONFORM TO THE LATEST EDITION OF THE NATIONAL ELECTRICAL CODE, THE GOVERNING ELECTRICAL CODE AND ALL OTHER INSPECTION DEPARTMENTS HAVING JURISDICTION. OBTAIN CERTIFICATES OR APPROVAL WHERE REQUIRED.
2. ALL MATERIALS FURNISHED SHALL BE NEW AND SHALL BE U.L. LISTED.
3. THE DRAWINGS INDICATE SIZE AND GENERAL LOCATION OF WORK. SCALE DIMENSIONS SHALL NOT BE USED. THE EXACT LOCATION AND LOCATION OF ALL POWER POLES AND ALL RISERS SHALL BE DETERMINED BY ACTUAL CONDITIONS IN THE FIELD.
4. PRIOR TO BIDDING, CONTRACTOR SHALL VISIT THE JOB SITE AND FAMILIARIZE THEMSELVES WITH THE EXISTING CONDITIONS.
5. ELECTRICAL CONTRACTOR SHALL COORDINATE HIS WORK WITH OTHER TRADES AND WITH OTHER CONTRACTORS WHOSE WORK MAY AFFECT THIS INSTALLATION.
6. PERFORM TEST REQUIRED BY THE OWNER OR THE ENGINEER IN CONNECTION WITH THE OPERATION OF THE ELECTRICAL SYSTEM IN THE BUILDING.
7. ALL TESTS SHALL BE MADE IN ACCORDANCE WITH THE LATEST STANDARD OF THE IEEE AND THE NATIONAL ELECTRICAL CODE.
8. MINIMUM CONDUCTOR SIZE SHALL BE #12, 600V INSULATION.
9. CONTRACTOR SHALL INSTALL WIRING AND OTHER CIRCUIT COMPONENTS TO MATCH EQUIPMENT ACTUALLY INSTALLED.
10. INSTALL GROUND FAULT RECEPTACLES AT RECEPTACLE LOCATIONS AT EXTERIOR LOCATIONS. EXTERIOR RECEPTACLES SHALL ALSO BE WATERPROOF.
11. BONDING AND GROUNDING SHALL BE IN ACCORDANCE WITH NFPA 70:230-63, NFPR 250-23, 250-71 & 250-72.
12. GROUND NEUTRAL IN ACCORDANCE WITH NFPA 70:250-23b.
13. FUSES SHALL BE ITT CLASS K5, 250 VOLT, 200,000 AMP INTERRUPTING CAP.
14. MDP SHALL HAVE THERMAL-MAGNETIC CIRCUIT BREAKERS FOR ALL MOTORS.
15. MINIMUM SIZE ELECTRICAL CONDUIT SHALL BE 1" FOR EXTERIOR USE, UNLESS OTHERWISE SHOWN. ALL ELECTRICAL CONDUIT SHALL BE SCHEDULE 40 PIPE BELOW GRADE AND SCHEDULE 80 PIPE ABOVE GRADE.
16. 1-1/2" OR 2" UNDERGROUND CONDUITS SHALL BE INSTALLED BETWEEN HEADWALLS. EACH 20 AMP CIRCUIT BREAKER AT COMPRESSOR SHED SHALL SUPPORT 1 CELL OR 3 HEADWALLS.
17. TERMINATE ALL EQUIPMENT ACCORDING TO MANUFACTURER'S RECOMMENDATION.
18. CONNECT AND TEST CONTROL PANEL(S) TO EXISTING INTEGRALERT SYSTEM. THE TESTING OF THE CONTROL PANEL SHALL BE PERFORMED BY SETTING THE HIGH WATER LEVEL THE SAME AS THE PUMP-ON AND PUMP-OFF LEVELS. AFTER TEST IS COMPLETE SET HIGH WATER LEVEL ACCORDING TO PUMP CONTROLLER SETTING SCHEDULE.
19. CONTRACTOR SHALL PROVIDE AS-BUILT DRAWINGS FOR ALL WORK PERFORMED.

WORK AREA : ONLY CELL 14 IS BEING CONSTRUCTED UNDER THIS PROJECT, BUT SOME WORK OCCURS THROUGH CELL 13 TO DISTRIBUTION PANEL.

PANEL SCHEDULE

PANEL: P-1
LOCATION: COMPRESSOR SHED
FEEDER SOURCE: MDP
VOLTAGE: 120/208V 3Ø 125Amp, MLO
ENCLOSURE: FLUSH MOUNTED W/ EQUIPMENT GND BAR SQ D TYPE QO LOAD CENTER

CKT NO	THHN WIRE SIZE	LOAD DESCRIPTION: LOCATION	BREAKER: AMP	BREAKER: POLE	LOAD (KVA)	AØ	BØ	CØ	LOAD (KVA)	BREAKER: POLE	BREAKER: AMP	LOAD DESCRIPTION: LOCATION	THHN WIRE SIZE	CKT NO
1					4.2				1.8	1	20	CELL 13 CONTROLLERS (EXISTING)	#6	2
3	#5	REFRIGERATED DRYER	50	3	4.2				1.8	1	20	CELL 14 CONTROLLERS	#6	4
5					4.2				1.8	1	20	CELL 15 CONTROLLERS (FUTURE)	#6	6
7	#12	LIGHTING	20	1	0.2				1.8	1	20	CELL 16 CONTROLLERS (FUTURE)	#6	8
9	#12	BLDG OUTLETS	20	1	0.5				-	1	20	SPARE	-	10
11	-	SPARE	20	1	-				-	1	20	SPARE	-	12
13														14
15														16
17	-	SPACE	--	--	-				-	--	--	SPACE	-	18

SOLID NEUTRAL
NEUTRAL WIRE (N)
NOTE: USE THERMAL-MAGNETIC CIRCUIT BREAKERS FOR ALL MOTORS

TOTAL CONNECTED LOAD (VA) = ####
AØ = #### BØ = #### BØ = ####

GROUND BUS
GROUND WIRE (G)

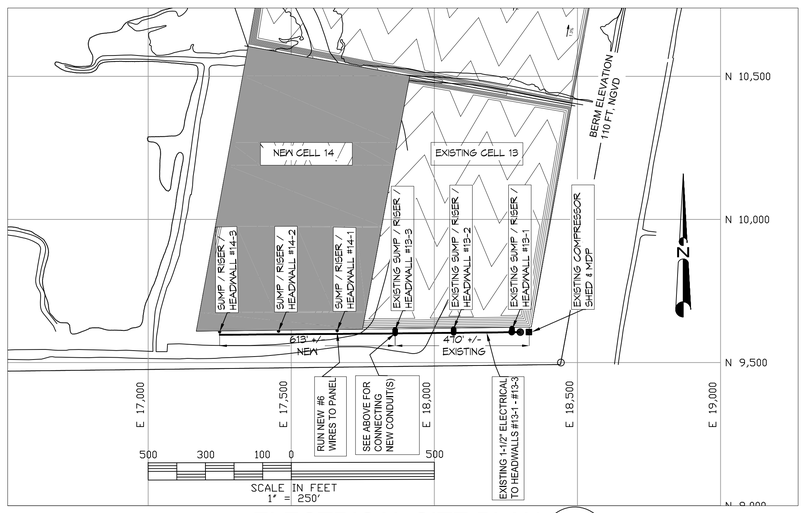

ELECTRICAL SITE PLAN (1)
SCALE 1" = 250' E101 E101

DAMMON ENGINEERING, INC.
LOUISIANA & MISSISSIPPI
www.dammonengineering.com
info@dammonengineering.com
PH: 985.649.5832
Chief Engineer: Brian Mistich, PE
554 Old Spanish Trail
Slidell, LA 70458

#	DESCRIPTION	DATE

REVISIONS

SEAL:

TANGIPAHOA CELL 14 BUILDOUT

TANGIPAHOA REGIONAL SOLID WASTE FACILITY
57510 HANO ROAD
INDEPENDENCE, LOUISIANA

JOB No: 2574 DATE: 4/25/2014
DRAWN BY: DPD CHECKED BY: BM

The above drawings and specifications, designs and arrangements represented herein, as an instrument of service, are the property of Dammon Engineering, and must remain at all times in our possession and control. Any use, publication, or reproduction without our consent is prohibited. Copyright © 2014 Dammon Engineering. Revisions, if made, shall be dated and shall become the property of Dammon Engineering, and such revisions shall be subject to the same restrictions and conditions as the original drawings and specifications, and shall be returned upon request.

SHEET TITLE:
ELECTRICAL PLAN

DRAWING NUMBER:
E101

SHEET No: of #